


TEXAS UTILITIES GENERATING COMPANY
SKYWAY TOWER - 400 NORTH OLIVE STREET, L.B. 81 - DALLAS, TEXAS 75201

November 17, 1986

WILLIAM G. COUNCIL
EXECUTIVE VICE PRESIDENT

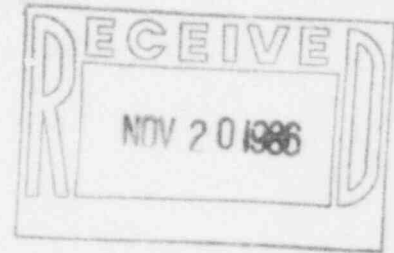

Mr. Eric H. Johnson, Director
Division of Reactor Safety and Projects
U. S. Nuclear Regulatory Commission
611 Ryan Plaza Drive, Suite 1000
Arlington, TX 76012

SUBJECT: COMANCHE PEAK STEAM ELECTRIC STATION (CPSES)
DOCKET NOS. 50-445 AND 50-446
CONAX ADAPTOR MODULES AND ELECTRICAL PENETRATIONS
SDAR: CP-86-49 (INTERIM REPORT)

Dear Mr. Johnson:

On October 10, 1986, we notified you of a reportable deficiency involving the effects of polar-organic solvents on the sealants of Conax adaptor modules and electrical penetrations. This is a follow-up interim report of a reportable item under the provisions of 10CFR50.55(e).

Applicable construction procedures and the coating engineering verification program were modified to include provisions which ensure solvents, that affect end sealants, do not contact the sealants during the application of coatings. Procurement and replacement of the affected modules is continuing.

We anticipate submitting our next report by January 30, 1987.

Very truly yours,

W. G. Council

JDS/mlh

c - NRC Region IV (0 + 1 copy)

Director, Inspection & Enforcement (15 copies)
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

8611250463 861117
PDR ADOCK 05000445
S PDR

86-1311