



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

DUKE POWER COMPANY

DOCKET NO. 50-369

McGUIRE NUCLEAR STATION, UNIT 1

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 99
License No. NPF-9

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment to the McGuire Nuclear Station, Unit 1 (the facility) Facility Operating License No. NPF-9 filed by the Duke Power Company (the licensee) dated November 3, 1988, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's rules and regulations as set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, as amended, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations set forth in 10 CFR Chapter I;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.

2. Accordingly, the license is hereby amended by page changes to the Technical Specifications as indicated in the attachments to this license amendment, and Paragraph 2.C.(2) of Facility Operating License No. NPF-9 is hereby amended to read as follows:

(2) Technical Specifications .

The Technical Specifications contained in Appendix A, as revised through Amendment No. 99 , are hereby incorporated into the license. The licensee shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.

3. This license amendment is effective as of its date of issuance.

FOR THE NUCLEAR REGULATORY COMMISSION



David B. Matthews, Director
Project Directorate II-3
Division of Reactor Projects-I/II
Office of Nuclear Reactor Regulation

Attachment:
Technical Specification
Changes

Date of Issuance: July 10, 1989

2. Accordingly, the license is hereby amended by page changes to the Technical Specifications as indicated in the attachments to this license amendment, and Paragraph 2.C.(2) of Facility Operating License No. NPF-9 is hereby amended to read as follows:

(2) Technical Specifications

The Technical Specifications contained in Appendix A, as revised through Amendment No. 99, are hereby incorporated into the license. The licensee shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.

3. This license amendment is effective as of its date of issuance.

FOR THE NUCLEAR REGULATORY COMMISSION

Original Signed By:
David B. Matthews

David B. Matthews, Director
Project Directorate II-3
Division of Reactor Projects-I/II
Office of Nuclear Reactor Regulation

Attachment:
Technical Specification
Changes

Date of Issuance: July 10, 1989

OFFICIAL RECORD COPY

LA:PD11-3
MRood
6/14/89

PM:PD11-3
DHood
6/14/89

NRR:SPLB
McCracken
6/14/89
J. Wermiel

CGC
6/14/89
J. M.

DM
N:PD11-3
DMatthews
6/29/89



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

DUKE POWER COMPANY

DOCKET NO. 50-370

McGUIRE NUCLEAR STATION, UNIT 2

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 81
License No. NPF-17

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment to the McGuire Nuclear Station, Unit 2 (the facility) Facility Operating License No. NPF-17 filed by the Duke Power Company (the licensee) dated November 3, 1988, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's rules and regulations as set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, as amended, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations set forth in 10 CFR Chapter I;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.


2. Accordingly, the license is hereby amended by page changes to the Technical Specifications as indicated in the attachments to this license amendment, and Paragraph 2.C.(2) of Facility Operating License No. NPF-17 is hereby amended to read as follows:

(2) Technical Specifications .

The Technical Specifications contained in Appendix A, as revised through Amendment No. 81 , are hereby incorporated into the license. The licensee shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.

3. This license amendment is effective as of its date of issuance.

FOR THE NUCLEAR REGULATORY COMMISSION



David B. Matthews, Director
Project Directorate II-3
Division of Reactor Projects-I/II
Office of Nuclear Reactor Regulation

Attachment:
Technical Specification
Changes

Date of Issuance: July 10, 1989

2. Accordingly, the license is hereby amended by page changes to the Technical Specifications as indicated in the attachments to this license amendment, and Paragraph 2.C.(2) of Facility Operating License No. NPF-17 is hereby amended to read as follows:

(2) Technical Specifications

The Technical Specifications contained in Appendix A, as revised through Amendment No. 81, are hereby incorporated into the license. The licensee shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.

3. This license amendment is effective as of its date of issuance.

FOR THE NUCLEAR REGULATORY COMMISSION

Original Signed By:

David B. Matthews

David B. Matthews, Director
Project Directorate II-3
Division of Reactor Projects-I/II
Office of Nuclear Reactor Regulation

Attachment:
Technical Specification
Changes

Date of Issuance: July 10, 1989

OFFICIAL RECORD COPY

LA:PD11-3
MRood
6/12/89

DSH
PM:PD11-3
DHood:
6/14/89

NRR:SPLB
E. McCracken
6/14/89
J. Wermiel

OGC

DM
PD11-3
DMatthews
6/29/89

ATTACHMENT TO LICENSE AMENDMENT NO. 99

FACILITY OPERATING LICENSE NO. NPF-9

DOCKET NO. 50-369

AND

TO LICENSE AMENDMENT NO. 81

FACILITY OPERATING LICENSE NO. NPF-17

DOCKET NO. 50-370

Replace the following pages of the Appendix "A" Technical Specifications with the enclosed pages. The revised pages are identified by Amendment number and contain vertical lines indicating the areas of change.


Amended Page

3/4 7-11a

3/4 7-21

Figure 3/4 7-1

Nuclear Service Water System

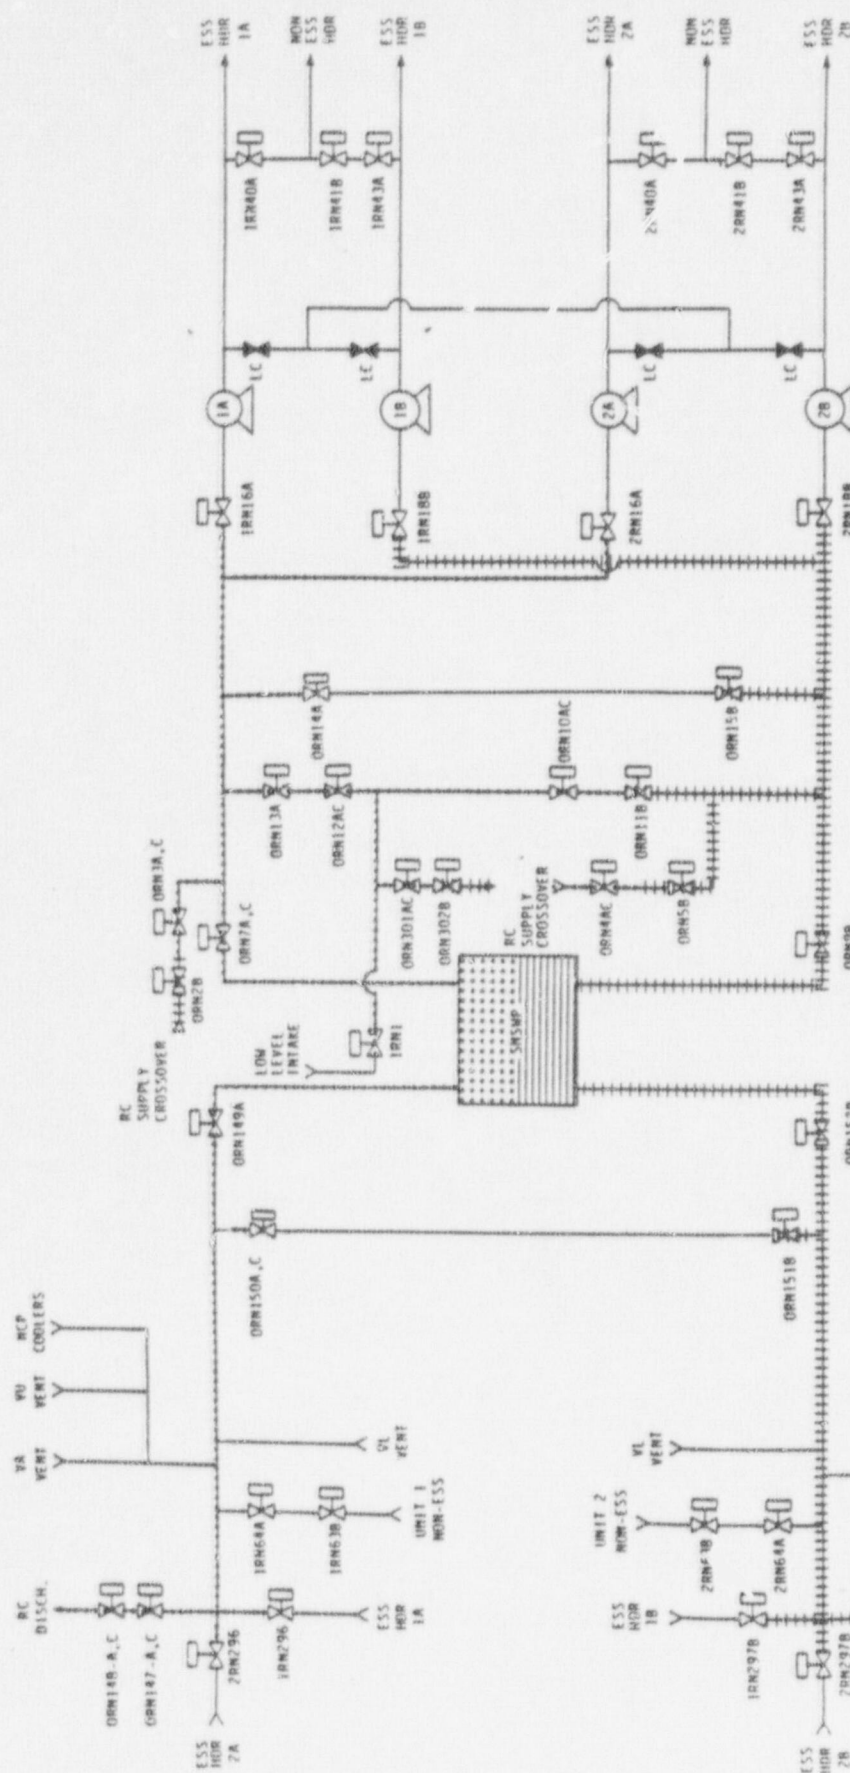

..... Train A Shared

||||||| Train B Shared

PLANT SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

e. Functional Tests (Continued)

- 3) An initial representative sample of fifty-five (55) snubbers shall be functionally tested. For each snubber which does not meet the functional test acceptance criteria, another sample of at least one-half the size of the initial sample shall be tested until the total number tested is equal to the initial sample size multiplied by the factor, $1 + C/2$, where "C" is the number of snubbers found which do not meet the functional test acceptance criteria. This can be plotted using an "Accept" line which follows the equation $N = 55(1 + C/2)$. Each snubber should be plotted as soon as it is tested. If the point plotted falls on or below the "Accept" line, testing may be discontinued. If the point plotted falls above the "Accept" line, testing must continue unless all snubbers have been tested.

The representative samples for the functional test sample plans shall be randomly selected from the snubbers required by Specification 3.7.8 and reviewed before beginning the testing. The review shall ensure as far as practical that they are representative of the various configurations, operating environments, range of sizes, and capacities. Snubbers placed in the same locations as snubbers which failed the previous functional test shall be retested at the time of the next functional test but shall not be included in the sample plan. If during the functional testing, additional sampling is required due to failure of only one type of snubber, the functional testing results shall be reviewed at that time to determine if additional samples should be limited to the type of snubber which has failed the functional testing.

f. Functional Test Acceptance Criteria

The snubber functional test shall verify that:

- 1) Activation (restraining action) is achieved within the specified range in both tension and compression, except that inertia dependent, acceleration limiting mechanical snubbers may be tested to verify only that activation takes place in both directions of travel;
- 2) Snubber bleed, or release rate where required, is present in both tension and compression, within the specified range;
- 3) Where required, the force required to initiate or maintain motion of the snubber is within the specified range in both direction of travel; and
- 4) For snubbers specifically required not to displace under continuous load, the ability of the snubber to withstand load without displacement.

Testing methods may be used to measure parameters indirectly or parameters other than those specified if those results can be correlated to the specified parameters through established methods.