

ENCLOSURE 1

NOTICE OF VIOLATION

Duke Power Company  
Catawba Nuclear Station

Docket No.: 50-413  
License No.: NPF-35

During the Nuclear Regulatory Commission (NRC) inspection conducted on April 10 - May 5, 1989, a violation of NRC requirements was identified. In accordance with the "General Statement of Policy and Procedure for NRC Enforcement Actions, " 10 CFR Part 2, Appendix C (1989), the violation is listed below:

Technical Specification 6.8.1.a requires that written procedures be established, implemented, and maintained as recommended in Appendix A of Regulatory Guide 1.33, Revision 2, February 1978. Appendix A of Regulatory Guide 1.33 recommends procedures for operation of the Component Cooling Water System and for contamination control.

1. Procedure OP/1/A/6400/05, Component Cooling Water System, change 45, requires valve 1-KC-9 to be locked in position.

Contrary to the above, on April 13, 1989, Unit 1 was operating at approximately 100 % power; valve 1-KC-9 was not locked in position.

2. Station Directive 3.8.3 (T.S.), Contamination Prevention, Control, and Decontamination Responsibilities, Revision 24, requires that when exiting a contaminated area a whole body frisk shall be performed at the first available frisker to prevent the spread of contamination.

Contrary to the above, on April 12 and May 2, 1989, Unit 1 auxiliary operators failed to frisk at the first available frisker after exiting contaminated areas in the auxiliary building.

This is a Severity Level IV Violation (Supplement I)

Pursuant to the provisions of 10 CFR 2.201, Duke Power Company is hereby required to submit a written statement or explanation to the Nuclear Regulatory Commission, ATTN: Document Control Desk, Washington, DC 20555, with a copy to the Regional Administrator, Region II, Catawba Nuclear Station and a copy to the NRC Resident Inspector, within 30 days of the date of the letter transmitting this Notice. This reply should be clearly marked as a "Reply to a Notice of Violation" and should include [for each violation]: (1) admission or denial of the violation, (2) the reason for the violation if admitted, (3) the corrective steps which have been taken and the results achieved, (4) the corrective steps which will be taken to avoid further violations, and (5) the date when full compliance will be achieved. Where good cause is shown, consideration will be given to extending the response time. If an adequate reply is not received

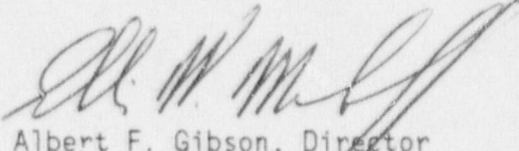
Duke Power Company  
Catawba Nuclear Station

2

Docket No.: 50-413  
License No.: NPF-35

within the time specified in this Notice, an order may be issued to show cause why the license should not be modified, suspended or revoked or why such other action as may be proper should not be taken.

FOR THE NUCLEAR REGULATORY COMMISSION

  
For Albert F. Gibson, Director  
Division of Reactor Safety

Dated at Atlanta, Georgia  
this 10<sup>th</sup> day of July 1989