


11

11

8.5"

11"

17"

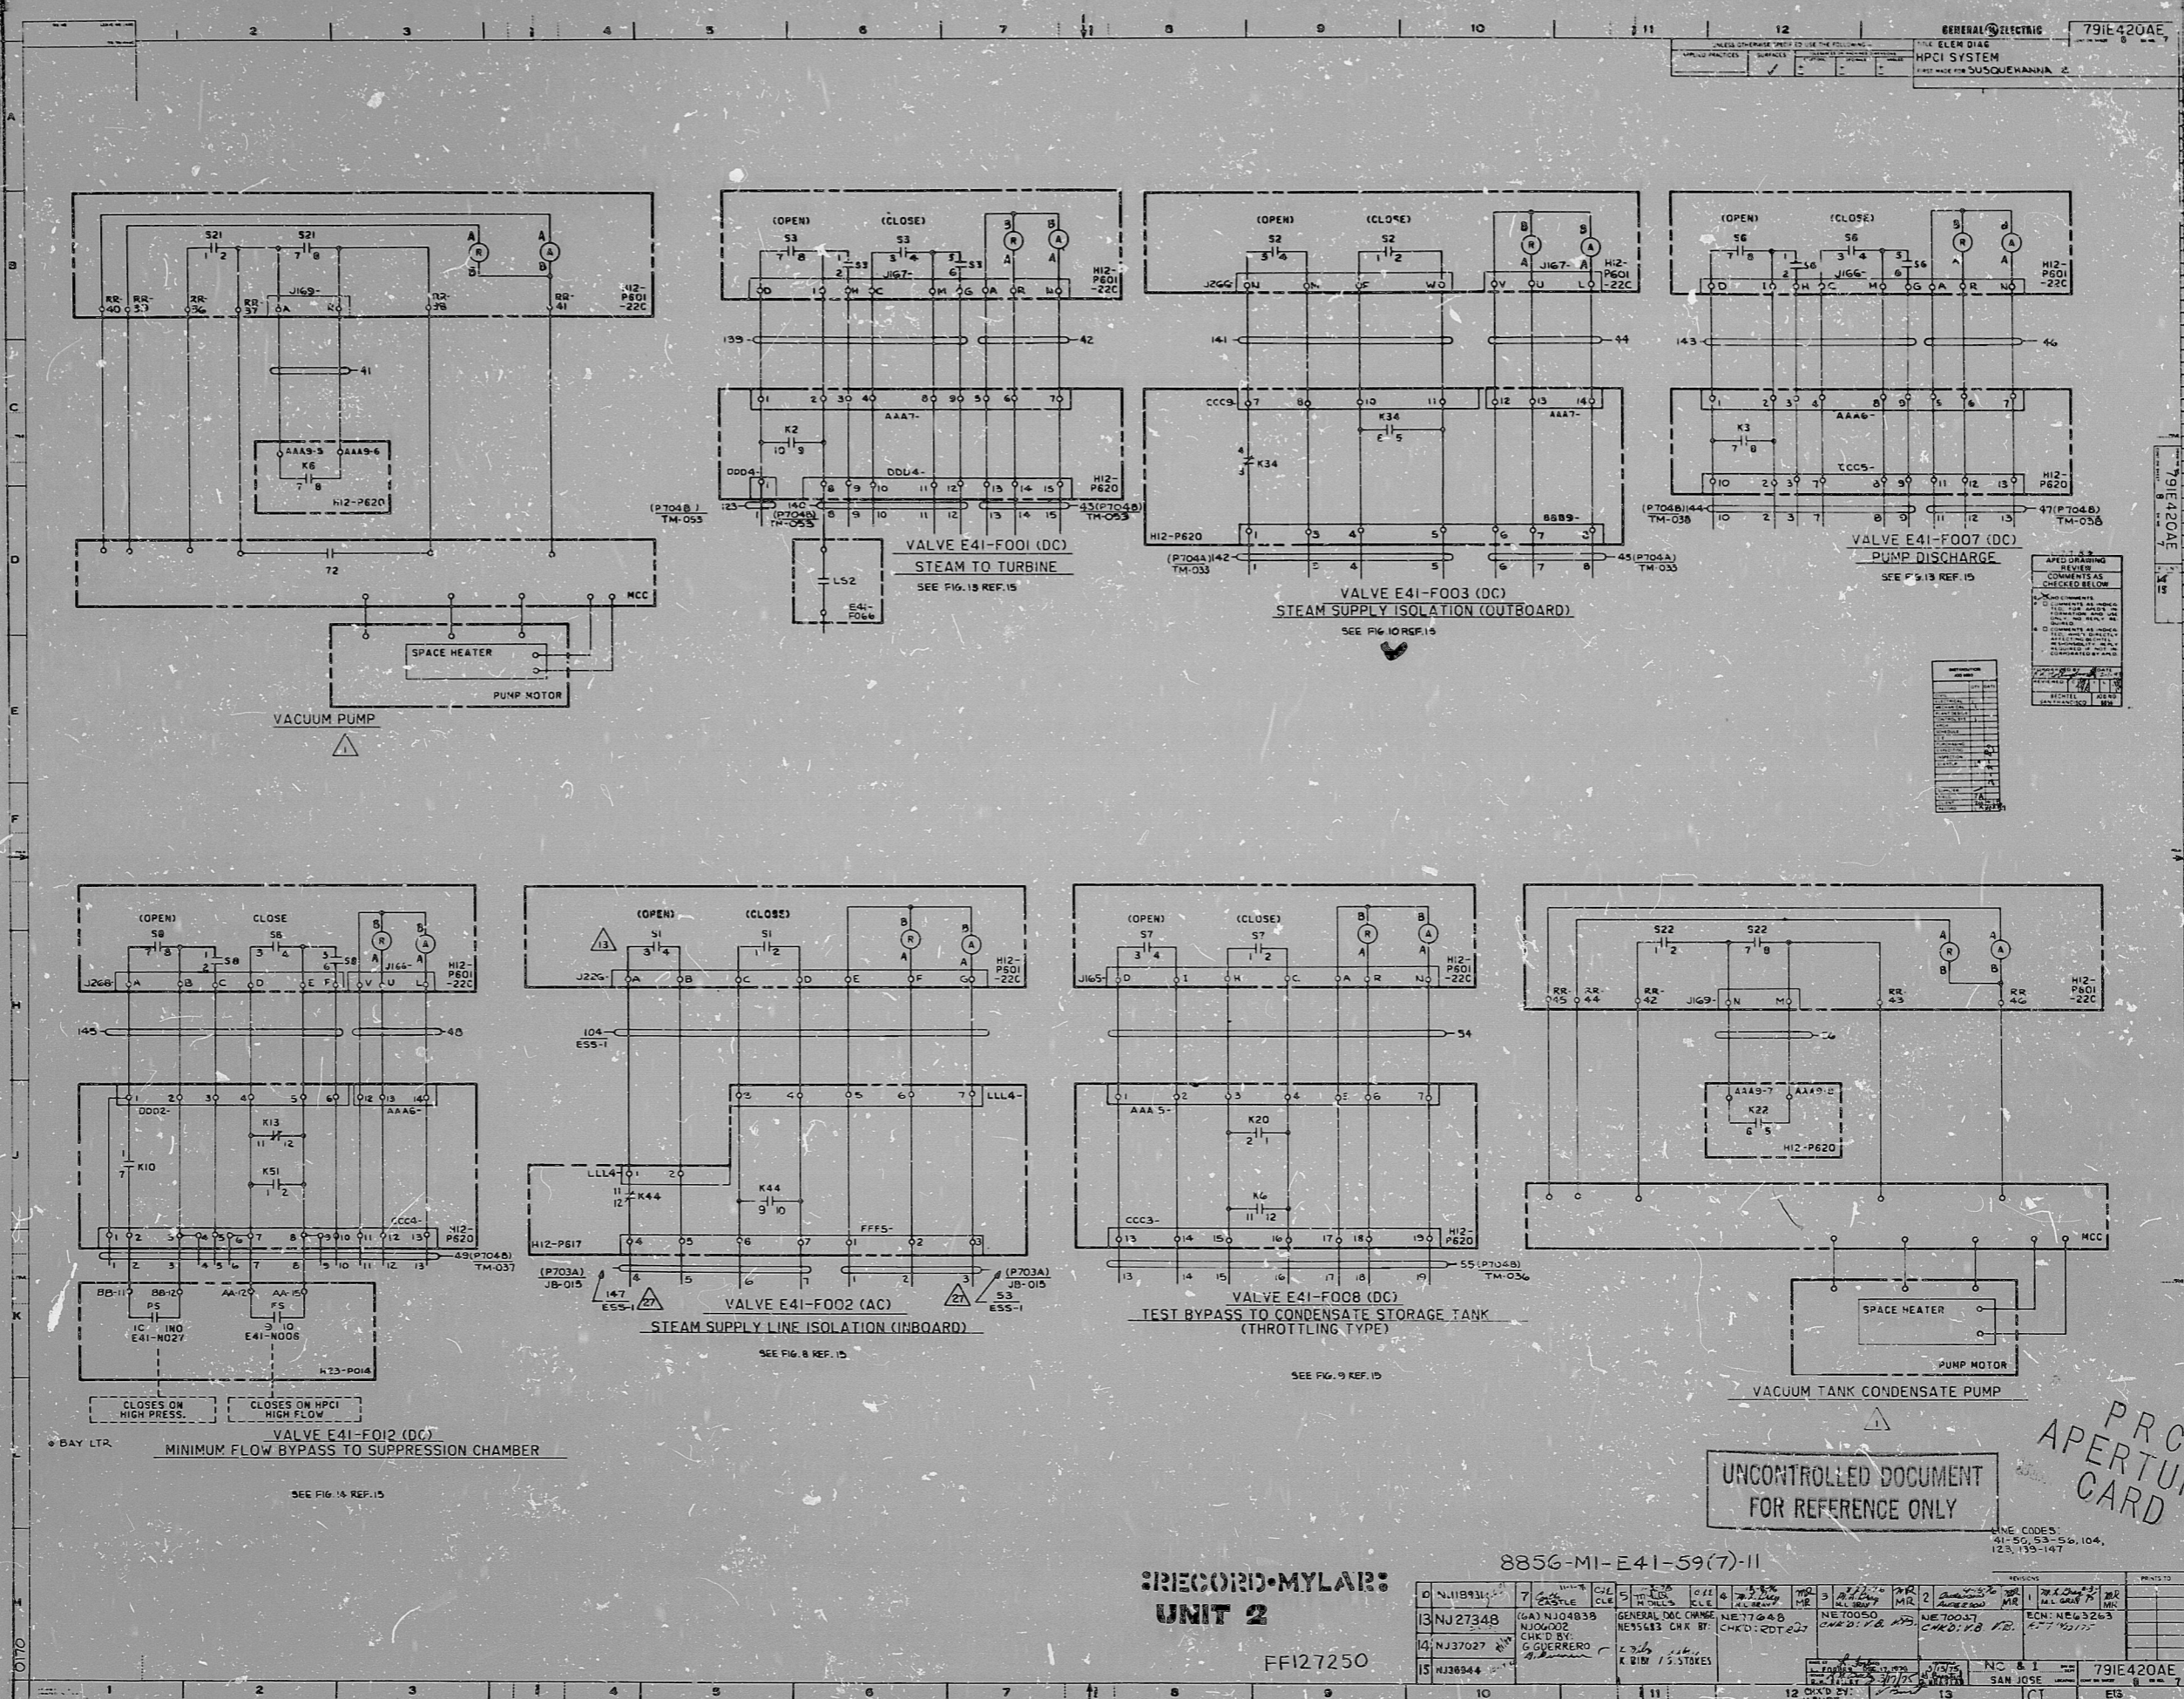

GENERAL ELECTRIC 791E420AE  
 FILE ELEM DIAG  
 HPCI SYSTEM  
 REV. 10/80 BY DUSQUEHANNA, E.

APPROVED FOR  
 REVIEW  
 COMMENTS AS  
 CHECKED BELOW

NO.	DATE	BY	REVISION
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			
21			
22			
23			
24			
25			
26			
27			
28			
29			
30			

UNCONTROLLED DOCUMENT  
 FOR REFERENCE ONLY

PRO APERTURE  
 CARD

RECORD-MYLAR  
 UNIT 2

8856-MI-E41-59(7)-II

FFI27250

NO.	DATE	BY	REVISION
0			
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			
21			
22			
23			
24			
25			
26			
27			
28			
29			
30			

30 X

DAHNY 1-19-83

RIDS

8305250050

