

22

22

22

22

22

22

22

22

22

22

22

22

22

22

22

22

22

22

22

22

22

22

22

22

22

22

22

22

22


22

22


22

22


22

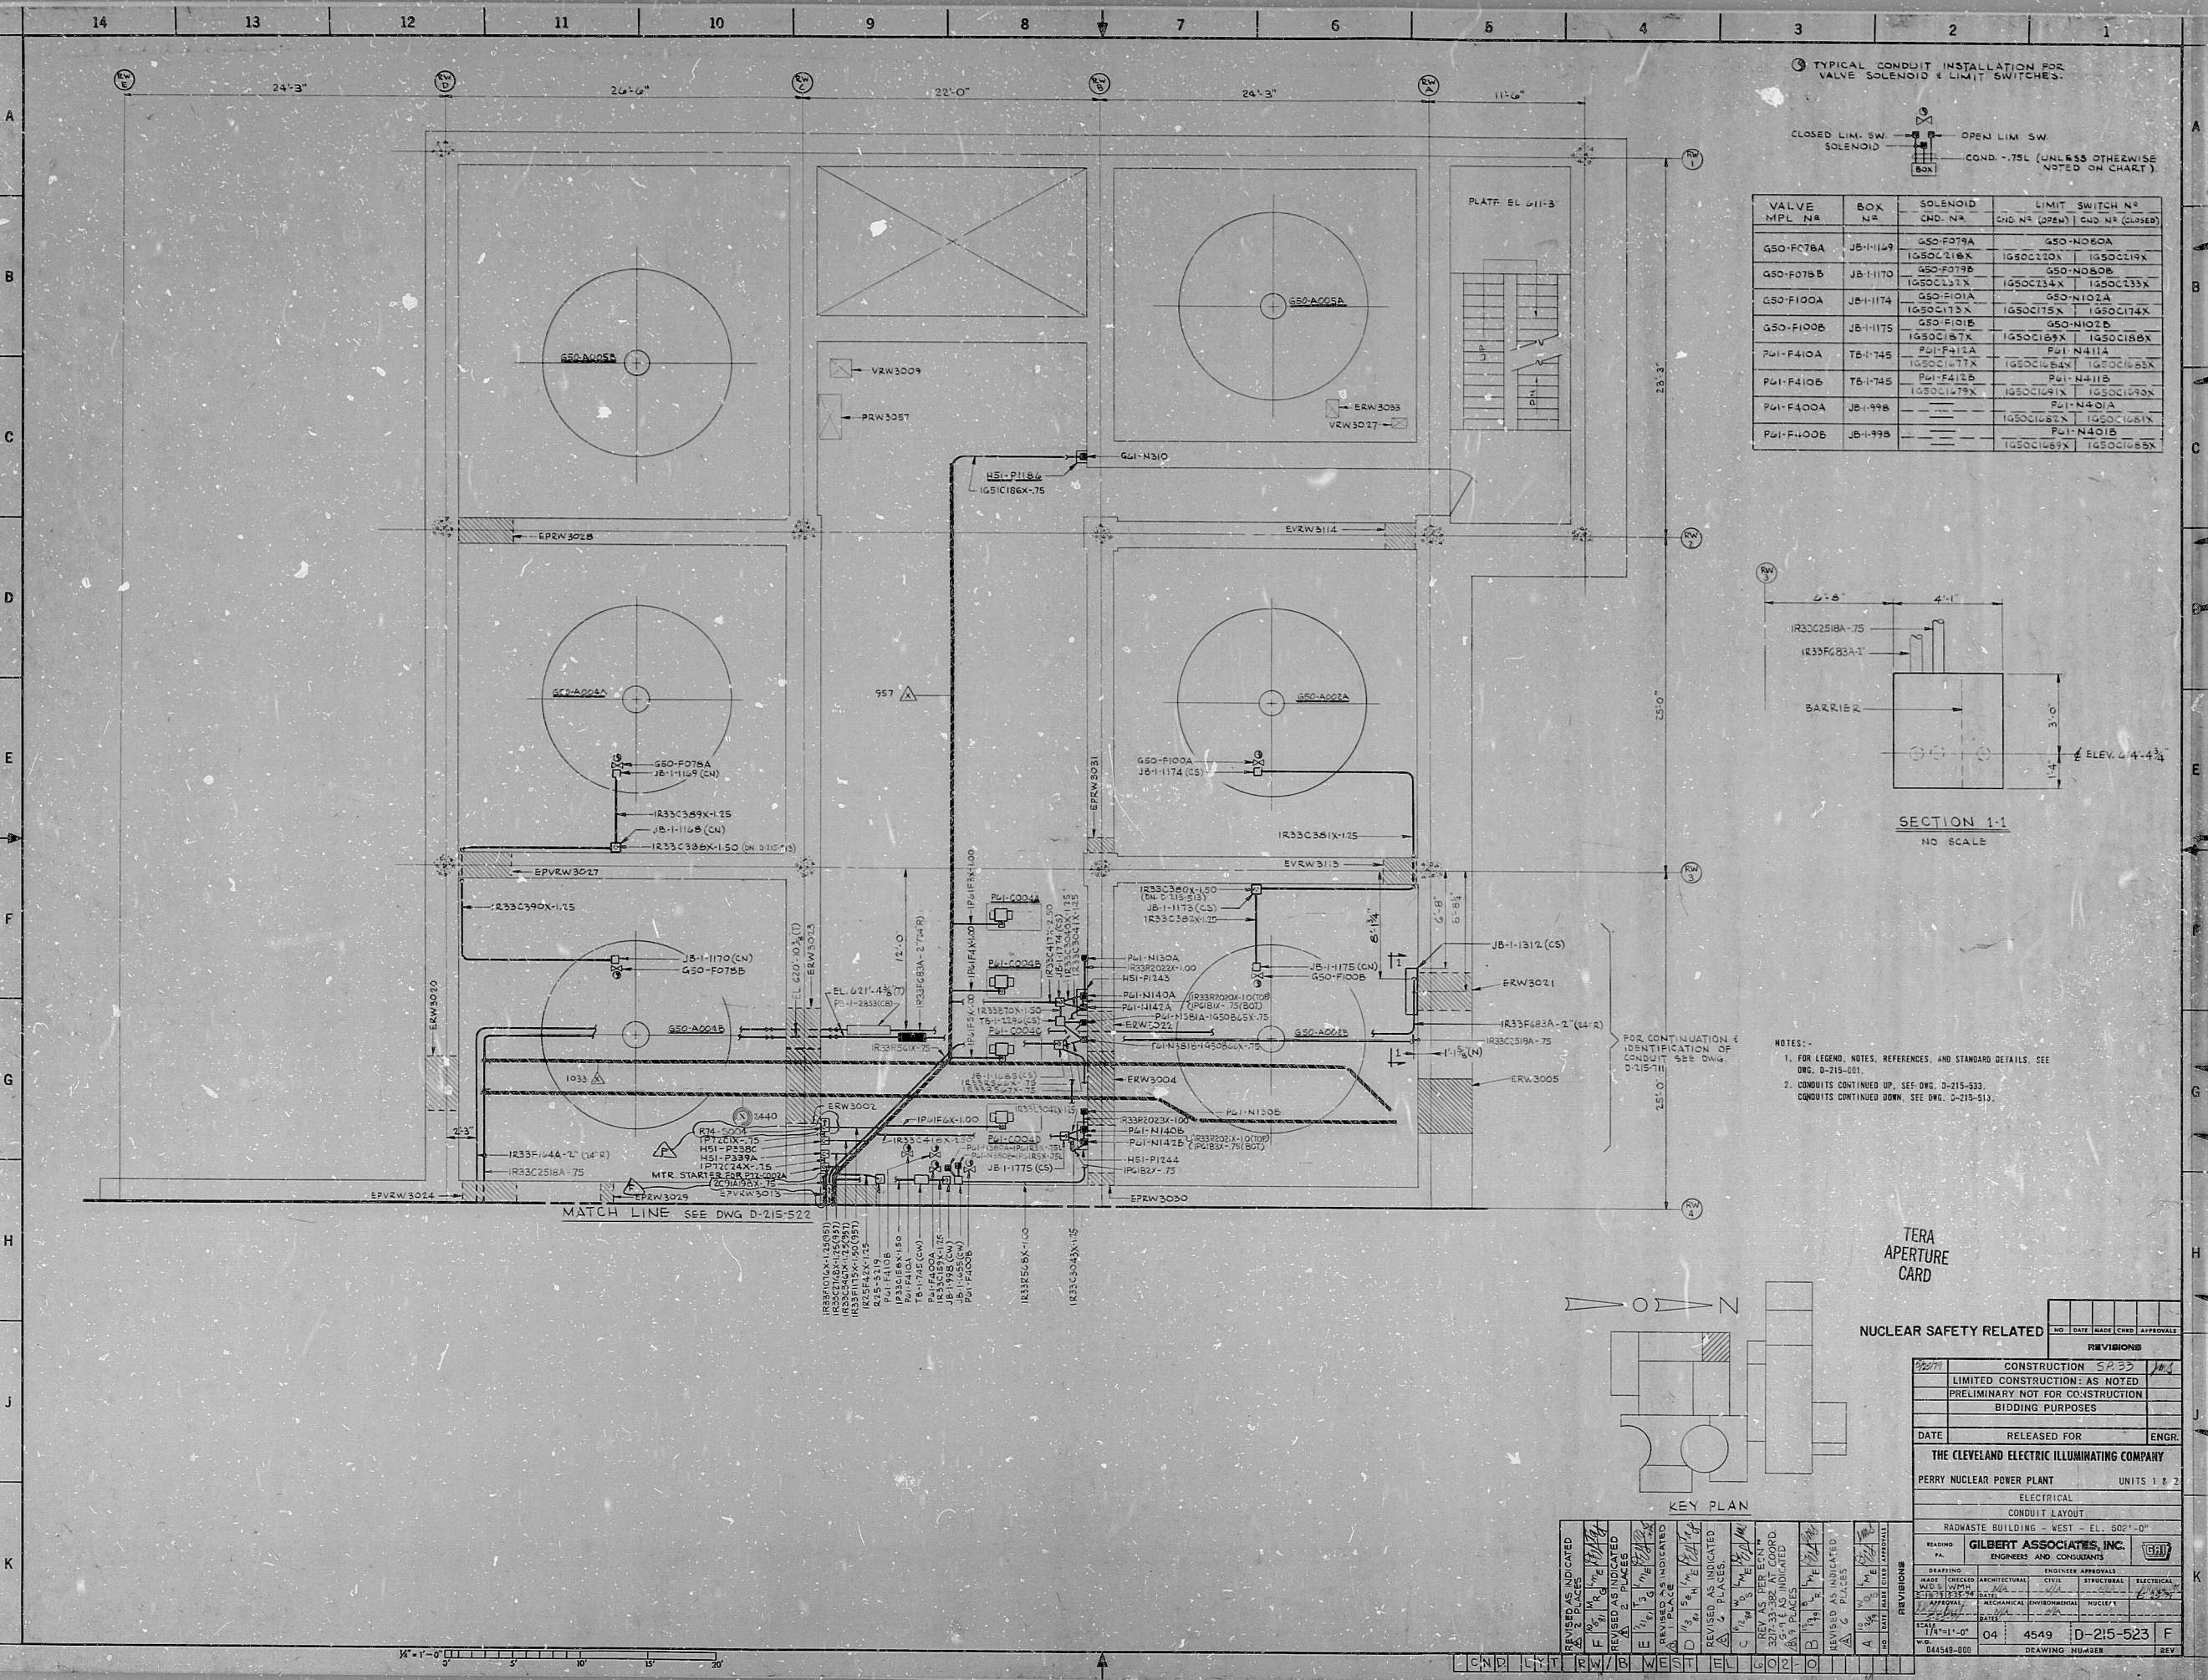

3 TYPICAL CONDUIT INSTALLATION FOR VALVE SOLENOID & LIMIT SWITCHES.



VALVE MPL N°	BOX N°	SOLENOID CHD. N°	LIMIT SWITCH N°
GSO-F079A	JB-11149	GSO-F079A	GSO-N060A
GSO-F079B	JB-11170	GSO-F079B	GSO-N060B
GSO-F100A	JB-11174	GSO-F100A	GSO-N102A
GSO-F100B	JB-11175	GSO-F100B	GSO-N102B
Pul-F410A	TB-1745	Pul-F410A	Pul-N411A
Pul-F410B	TB-1745	Pul-F410B	Pul-N411B
Pul-F410C	JB-1998	Pul-F410C	Pul-N411C
Pul-F410D	JB-1998	Pul-F410D	Pul-N411D

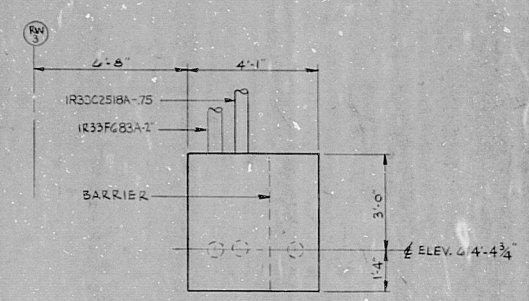

SECTION 1-1 NO SCALE

- NOTES:
- FOR LEGEND, NOTES, REFERENCES, AND STANDARD DETAILS, SEE DWG. D-215-511.
 - CONDUITS CONTINUED UP, SEE DWG. D-215-523.
 - CONDUITS CONTINUED DOWN, SEE DWG. D-215-512.

TERA APERTURE CARD

NUCLEAR SAFETY RELATED

DATE	RELEASED FOR	ENGR.
04/25/71	CONSTRUCTION 5A23	10/1
04/25/71	LIMITED CONSTRUCTION: AS NOTED	
04/25/71	PRELIMINARY NOT FOR CONSTRUCTION	
04/25/71	BIDDING PURPOSES	

RADWASTE BUILDING - WEST - EL. 502'-0"

GILBERT ASSOCIATES, INC.

ENGINEERS AND CONSULTANTS

DRAWING

DATE

ENGINEER APPROVALS

DESIGNED

ARCHITECTURAL

CIVIL

STRUCTURAL

ELECTRICAL

MADE CHECKED

DATE

DATE

DATE

DATE

APPROVED

APPROVED

APPROVED

APPROVED

APPROVED

SCALE

SCALE

SCALE

SCALE

SCALE

1/4" = 1'-0"

1/4" = 1'-0"

1/4" = 1'-0"

1/4" = 1'-0"

1/4" = 1'-0"

W.D.

W.D.

W.D.

W.D.

W.D.

044549-000

044549-000

044549-000

044549-000

044549-000

DRAWING

DRAWING

DRAWING

DRAWING

REV


REV

REV

REV

REV

KEY PLAN



34

34

RIDS

8112040136

