

This drawing and the design it covers is the property of the Utilitas which are participating in the SNUPPS Project. It is loaned to the Borrower's express agreement and is not to be reproduced, distributed, or used in any way without the prior written consent given by the SNUPPS Utilitas to the Borrower.


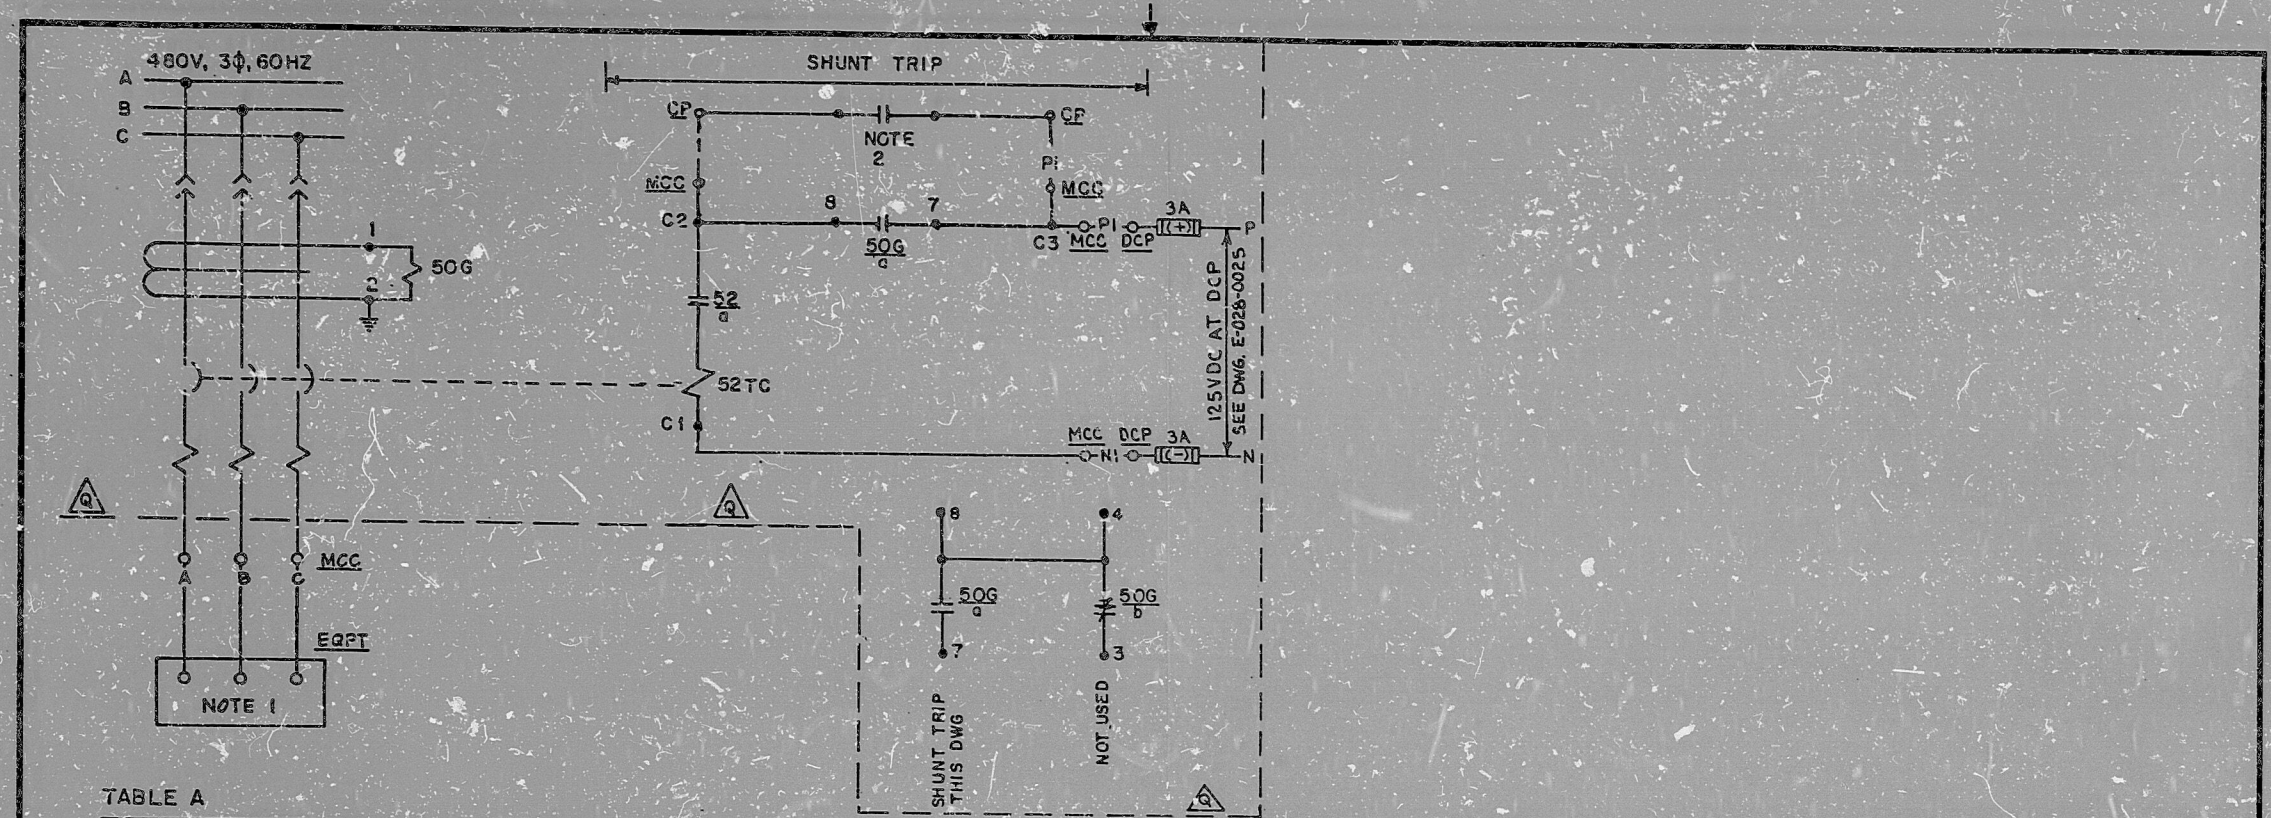


TABLE A


SCHEME NO.	MCC LOCATION	CP LOCATION	RELAY NO. & TEAM NOS.	DC DIST. PNL. DCP
1QBK02A	NG01AHF1	NF039C	K1166-8,9	RP289
1QBK02B	NG01AHF2	NF039C	K1166-10,11	RP289
4QBK02C	NG02AAF1	NF039C	K4166-8,9	RP290
4QBK02D	NG02AAF2	NF039C	K4166-10,11	RP290
1QBK02E	NG01BJF1	NF039C	K1167-4,5	RP289
1QBK02F	NG01BJF2	NF039C	K1167-2,3	RP289

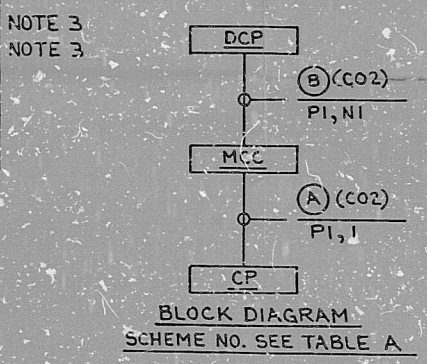

BLOCK DIAGRAM
SCHEME NO. SEE TABLE A

TABLE B

SCHEME NO.	MCC LOCATION	EQPT LOCATION	BLDG SERVED
6QB602A	NG02AAF2	XQB60	TURBINE
5QB602B	NG01AHF2	XQB65	CONT. COMM. CORR., D-G
6QB602C	NG02AAF1	XQB70	TURBINE
5QB602D	NG01AHF1	XQB75	CONT. COMM. CORR. D-G
5QB602E	NG01BJF1	XQB80	AUXILIARY
5QB602F	NG01BJF2	XQB90	AUXILIARY

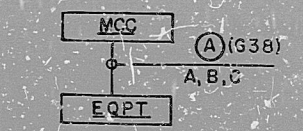

BLOCK DIAGRAM
SCHEME NO. - SEE TABLE B

TI
APERTURE
CARD

- FOR CONTROLS ASSOCIATED WITH THIS BKR SEE DWG. E-03QB03.
- CONTACT CLOSING ON SAFETY INJECTION SIGNAL. SEE VENDOR DWG. BECHTEL V.P. NO. J-104-01-7. FOR RELAY NO. AND TERM. NOS. SEE TABLE A.
- LIGHTING PANEL TRANSFORMER RATING IS 15 KVA.

NOTES:

1/27/83	RCVD V.P. NO. IN NOTE 1 TO INC. SFR 2-08-001A	JED	WJS	WJS	WJS	WJS	WJS
4/14/83	ADDED NOTE 3	JED	WJS	WJS	WJS	WJS	WJS
4/21/83	REVISED TABLE A & ASSOC. SCHEME & BLK. DIAG. NOTE 2	JED	WJS	WJS	WJS	WJS	WJS
7/21/83	ISSUED FOR CONSTRUCTION	JED	WJS	WJS	WJS	WJS	WJS

REVISIONS	BY	CHKD	DESIGN	ENGR	PROJ	ENGR
SCALE	DESIGNED EJD	DRAWN WJS	CHIEF			
BECHTEL GAITHERSBURG, MARYLAND						
SNUPPS						
SCHEMATIC DIAGRAM STANDBY LIGHTING SYSTEM POWER FEEDERS						
UTILITY DRAWING NO.			REV			
JOB NO.			REV			
10466			E-03QB02 (G) 3			
DRAWING APPLICABLE TO UNITS						

REVIEW LEVEL 3

I certify that the image contained on this frame was made in the normal and regular course of business, on the date stated below and that it is an accurate reproduction of the document(s) submitted to Micrographics.
DATE 7-27-83 OPERATOR [Signature] SUPERVISOR [Signature]

10Y

17 x 22 "C" SIZE

10056

8410040560

PDR RIDS

