

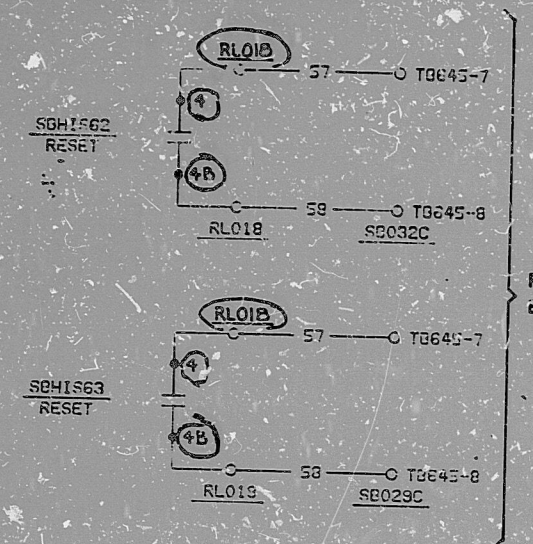


This drawing and the design it covers is the property of the Utilities which are participating in the SNUPPS Project. It is loaned to the borrower's express agreement that it will not be reproduced, copied, loaned, exhibited, or used except in the limited way and private use permitted by written consent given by the SNUPPS Utilities to the borrower.

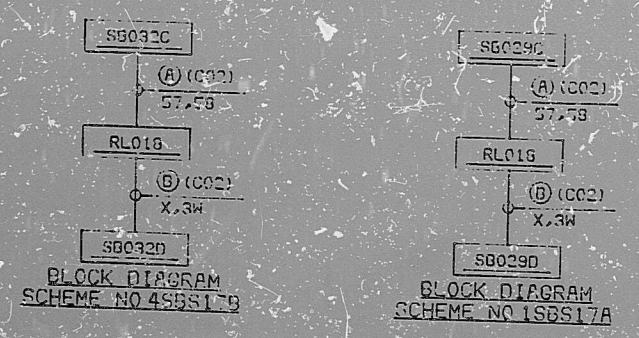

REFER WESTINGHOUSE DWG.
BECHTEL V.P. NO. M-767-177

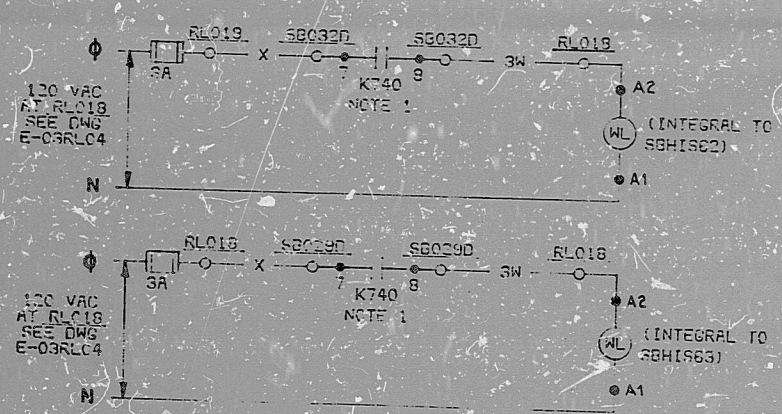

BLOCK DIAGRAM
SCHEME NO 4SBS17B

BLOCK DIAGRAM
SCHEME NO 1SBS17A

RESET	CONTACT	POSITION
	2-1-28	NC/N RESET
	4-1-28	X
	4-2-28	X

WATER-HAMMER
E30 TYPE DYIO
WATER-HAMMER
CONTACT BLOCK

HAND INDICATING SWITCH
HIS-NO. SBH1663B3

**TI
APERTURE
CARD**

- CONTACT CLOSURES ON SAFETY INJECTION AND REMAINS CLOSED UNTIL MANUALLY RESET FROM M.S.B. REFER WESTINGHOUSE DWG. BECHTEL V.P. M-767-199.

NOTES:

REVISIONS	BY	CHKD	DESIGN	ENGR	ENGR
1					

BECHTEL GAITHERSBURG, MARYLAND SNUPPS SCHEMATIC DIAGRAM SAFETY INJECTION (RWST) RESET SWITCH / SWITCHOVER STATUS INDICATOR	
UTILITY DRAWING NO.	REV.
JOB NO.	BECHTEL DRAWING NO.
10466	E-03SB17(Q) 2
DRAWING APPLICABLE TO UNITS	

REVIEW LEVEL 2

I certify that the image contained on this frame was made in the normal and regular course of business, on the date stated below and that it is an accurate reproduction of the document(s) submitted to Micrographics.
DATE 7-7-82 OPERATOR *Scott Gray* SUPERVISOR *...*

16 X

8410050043

PDR RIDS

