


This drawing and the design it covers is the property of the Utilities which are participating in the SNUPPS project. It is loaned to the contractor for use in the limited way and private use permitted by written consent given by the SNUPPS Utilities to the borrower.

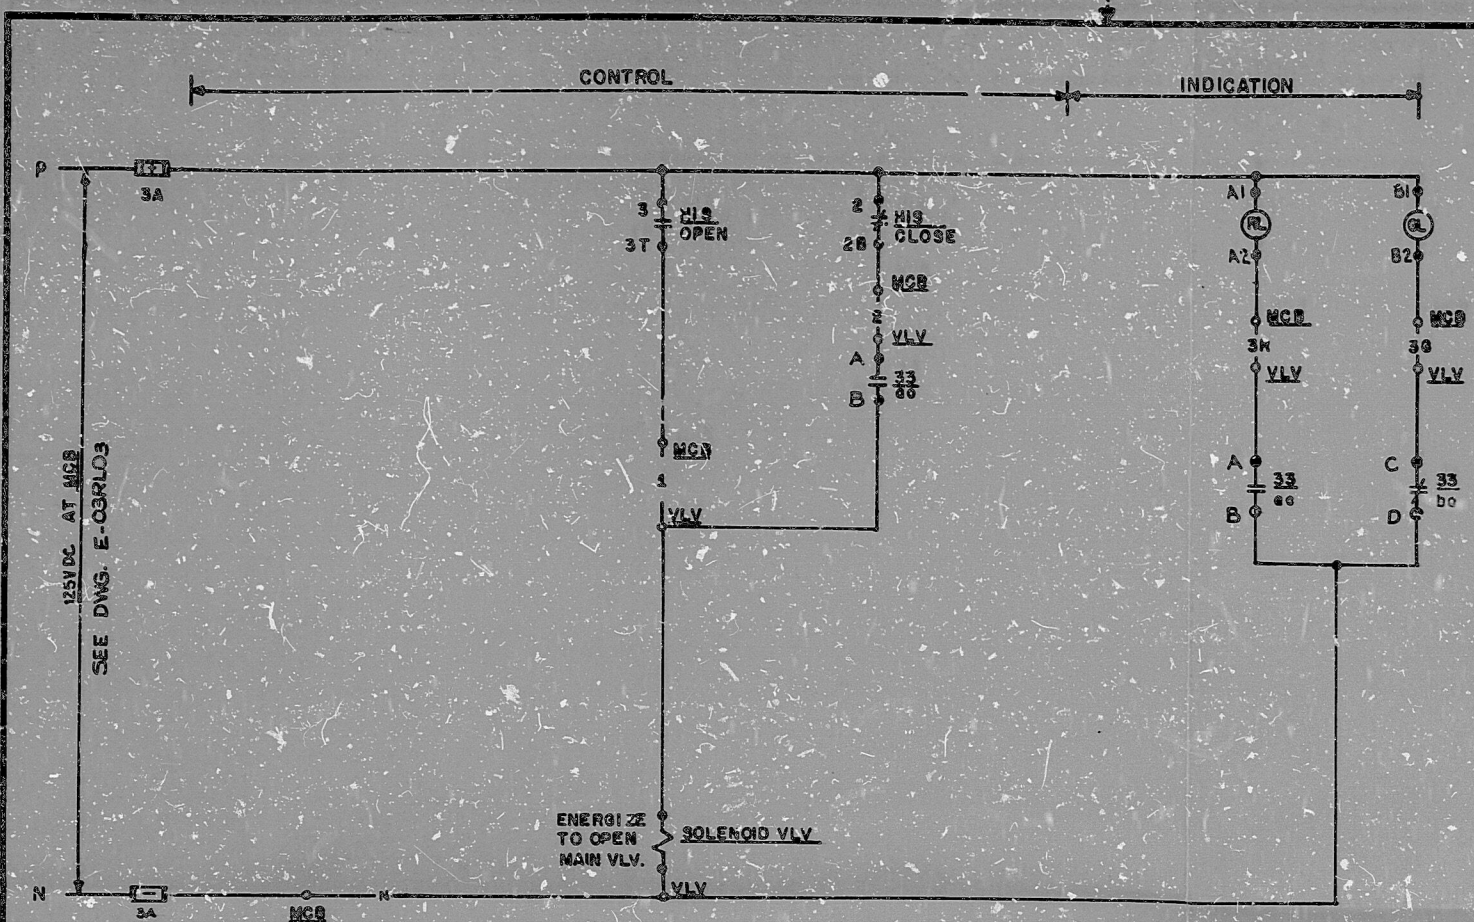

OPEN		POSITION	
BL	RL	NORM	CLOSE/OPEN
		1 2-1-41T	X N
		3 0-1-43T	X
		2 0-1-42B	X X
		4 0-1-44B	X X

CUTLER-HAMMER
 TYPE E30 J79
 WITH TWO KLA-3
 CONTACT LOCKS

HAND INDICATING SWITCH
 HIS-SEE TABLE
 MOMENTARY CONTACT

DEVICE 33 - POSITION SWITCHES				
CLOSED POS	CONTACT	VALVE POSITION		FUNCTION
		CLOSED	OPEN	
1	ag			RED LIGHT
2	bg			SPARE
3	cg			SPARE
4	dg			SPARE
OPEN	ag			SEAL IN CRT
	bg			GREEN LT.
	cg			SPARE
	dg			SPARE

SOLID BAR INDICATES CONTACT CLOSED
 NAMCO TYPE EATD-11100


REFERENCE DWGS:
 1. M-02FC02 (Q)
 2. J-02FC18 (Q)

TI
 APERTURE
 CARD

I. MAIN VALVE IS SHOWN IN FULL CLOSED
 POSITION. VALVE FAILS CLOSED.

NOTES:

HIS NO	FCH13310
HIS LOCATION-MCB	RLO05
SOLENOID VLV	FCFY310
VALVE NO. - VLV	FCFY310
SCHEME NO	4FCK21A



BLOCK DIAGRAM
 SCHEME NO. SEE TABLE

SUPERSEDES DWG. E-03FC21(Q)
 REVIEW LEVEL 3

NO.	DATE	BY	CHKD	DESIGN	APP'D	REV

SCALE: DESIGNED H.S. DRAWN M.M.C. CHECKED S.H.S.

BECHTEL
 GAITHERSBURG, MARYLAND

SNUPPS
 SCHEMATIC DIAGRAM
 AFWPT STEAMLINE WATER TRAP DRAIN VALVE

UTILITY DRAWING NO.	REV

JOB NO.	BECHTEL DRAWING NO.	REV
10468	E-23FC21 (Q)	0

DRAWING APPLICABLE TO UNITS:

I certify that the image contained on this frame was made in the normal and regular course of business, on the date stated below and that it is an accurate reproduction of the document(s) submitted to Micrographics.
 DATE: 1/30/57 OPERATOR: Mark Howard

8410050459

PDR AIDS

