


This drawing and the design it covers is the property of the Utilities which are participating in the SNUPPS Project. It is loaned to the borrower's use only and is not to be reproduced, copied, loaned, exhibited, or used except in the limited way and private use permitted by written consent given by the SNUPPS Utilities to the borrower.

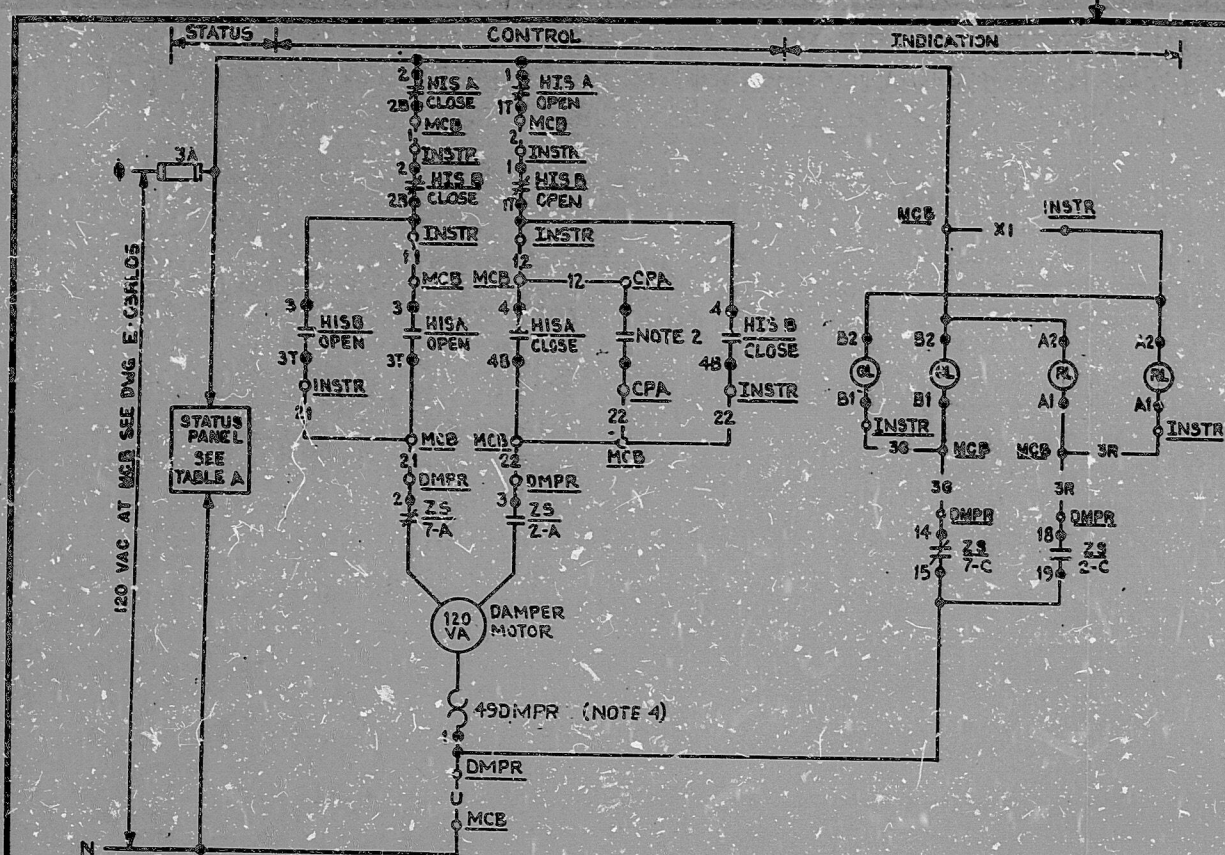

OPEN	CONTACT	POSITION
SL RL	NORM	CLOSE OPEN
CLOSE	1-1-01T	X X
	3-1-03T	X X
	2-1-02b	X X
	4-1-05b	X X

CUTLER-HAMMER TYPE E30 JYS WITH TWO RLAS CONTACT BLOCKS  
HAND INDICATING SWITCH HIS A & B - SEE TABLE A MOMENTARY CONTACT

ROTOR	TYPE OF SW	LIMIT SWITCH CONTACT DEVELOPMENT				FUNCTION
		DAMPER POSITION				
Z5	TRAVEL	CONT.	FULL OPEN OPER LIMIT	LIMIT CLOSE A	FULL LIMIT CLOSE	
		CLOSE	2-A			
2-B						NOT USED
2-C						RED LIGHT
2-D						NOTE 3
AUX	4-A					COMPUTER
	4-B					SPARE
	4-C					SPARE
	4-D					SPARE
OPEN	7-A					OPEN CKT
	7-B					NOT USED
	7-C					GREEN LIGHT
	7-D					SPARE
AUX	9-A					SPARE
	9-B					SPARE
	9-C					SPARE
	9-D					SPARE

SOLID BAR INDICATES CONTACT CLOSED

- REF. DWGS:  
 1. J-02GG04  
 2. M-02GG02  
 3. M-627A-0012

4. THERMAL DEVICE RESETS AUTOMATICALLY.  
 3. TO STATUS PANEL - SEE DWG. E-035A18  
 2. CONTACT CLOSURES ON FUEL BLDG. VENT. ISOLATION SIGNAL. SEE V.P. NO. J-104-0034 & J-104-0042.  
 1. DAMPER SHOWN IN FULL CLOSED POSITION.

NOTES:

11/80	REV'D. NOTE 2						
11/80	REV'D. TABLE A & B WHICH SHOWS THE DAMPER POSITION						
11/80	ADDED REV'D REF. DWG. NO.						
11/80	ISSUED FOR CONSTRUCTION						


TI APERTURE CARD

TABLE B

REFER COMP. DWG. BECHTEL V.P. NO.	J-106-0115	J-106-0115
COMP. POINT	66Z30	66Z37
COMP. LOCATION - PC	RJ160A	RJ159A
DAMPER NO. - DMPR	66R236	66R237
CONF. SCHEME NO.	466R08A	166R08A

TABLE A

ESPAS RELAY & CONTACT NO.	1037	1024
STATUS PNL. REF. DWG.	E-035A20	E-035A19
CP. LOCATION - CPA	8A036B	8A036A
HIS B LOCATION - INSTR	4GH1536B	4GH1537B
HIS B NUMBER	66HIS 36B	66HIS 37B
HIS A LOCATION - MCB	RLO20	RLO20
HIS A NUMBER	66HIS 36A	66HIS 37A
DAMPER NO. - DMPR	66R236	66R237
SCHEME NO.	466Y08B	166Y08A

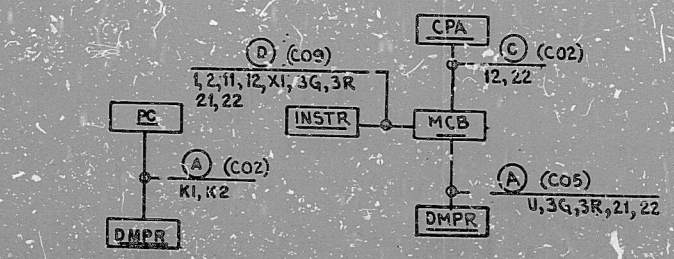

PLANT COMPUTER BLOCK DIAGRAM  
 SCHEME NO. SEE TABLE B

BLOCK DIAGRAM  
 SCHEME NO. - SEE TABLE A

REVIEW LEVEL 3

BECHTEL  
 GAITHERSBURG, MARYLAND

SNUPPS

SCHMATIC DIAGRAM  
 FUEL BLDG. OUTSIDE AIR SUPPLY  
 ISOLATION DAMPERS

UTILITY DRAWING NO.	REV.
10468	E-03GG08 (Q) 4

DATE 1-10-80 OPERATOR J.P. Slusher SUPERVISOR J.P. Slusher

I certify that the image contained on this frame was made in the normal and regular course of business, on the date stated below and that it is an accurate reproduction of the document(s) submitted to Micrographics.

DATE 1-10-80 OPERATOR J.P. Slusher SUPERVISOR J.P. Slusher



8410050542

**PDR RIDS**

