


This drawing and the design it covers is the property of the Utilities which are participating in the SNUPPS Project. It is loaned to the borrower's express agreement that it will not be reproduced, copied, loaned, exhibited, or used except in the limited way and private use permitted by written consent given by the SNUPPS Utilities to the borrower.

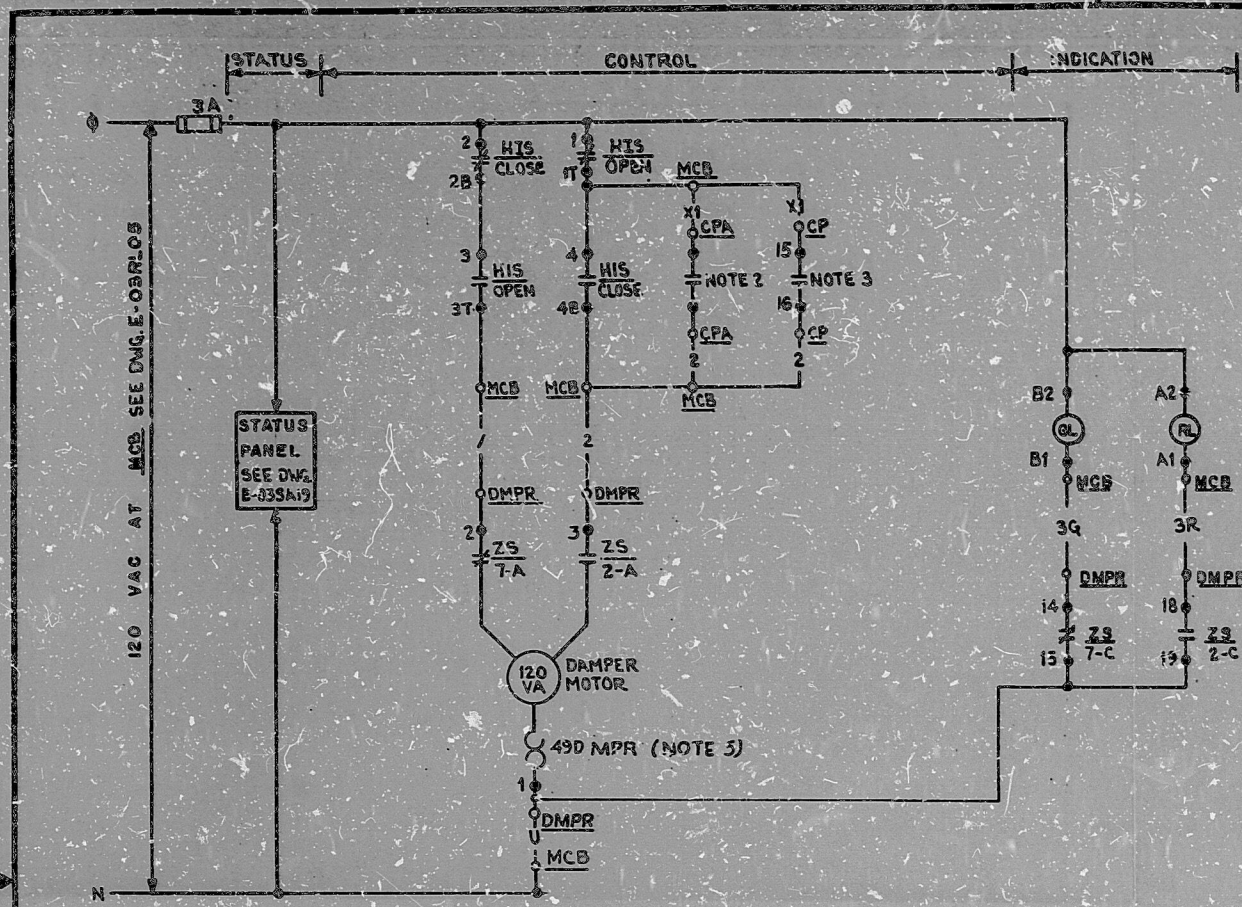

OPEN	CONTACT	POSITION
GL RL		NORM CLOSE OPEN
CLCSE	10-1-011	X X
	30-1-031	X
	20-1-020	X X
	40-1-040	X

CUTLER-HAMMER TYPE E30 JY9 WITH TWO KLA3 CONTACT BLOCKS

HAND INDICATING SWITCH HIS-SEE TABLE-A MOMENTARY CONTACT

ROTOR	TYPE OF SW	LIMIT SWITCH CONTACT DEVELOPMENT					FUNCTION
		DAMPER POSITION					
		FULL OPEN	LIMIT OPEN	LIMIT CLOSE	FULL LIMIT CLOSE		
CLOSE	TRAVEL						
	AUX.						
	TRAVEL						
	AUX.						
OPEN	TRAVEL						
	AUX.						
	TRAVEL						
	AUX.						

SOLID BAR INDICATES CONTACT CLOSED

REF DWGS:  
J-026609  
M-026601  
M-627A-0012

- DAMPER SHOWN IN FULL CLOSED POSITION.
- CONTACT CLOSING ON FUEL BLDG VENT ISO. SIGNAL. SEE V.P. DWG. NO. J-104-0034.
- CONTACT CLOSING ON SAFETY INJECTION SIGNAL FROM RELAY NO. K615. SEE WESTINGHOUSE DWG. BECHTEL V.P. NO. M-767-179.
- TO STATUS PANEL - SEE DWG. E-035A17.
- THERMAL DEVICE RESETS AUTOMATICALLY.

NOTES:


REVISION	DATE	BY	CHKD	DRWN	ENGR	PROJ ENGR
1						
2						
3						
4						
5						

TABLE B

REFER COMP DWG. BECHTEL V.P. NO.	J-106-0115
COMP POINT	GGZ42
COMP LOCATION-PC	RJ159A
DAMPER NO.-DMPS	6GHZ42
COMP. SCHEME NO.	10GR11A

TABLE A

ESFAS RELAY AND CONTACT NOS.	K1, K2
CPA LOCATION-CPA	SA0367
CP LOCATION-CP	SB029C
HIS LOCATION-MCB	K1,020
HIS NUMBER	6GH1942
DAMPER NO.-DMPR	GGHZ42
SCHEME NO.	1GGY11A

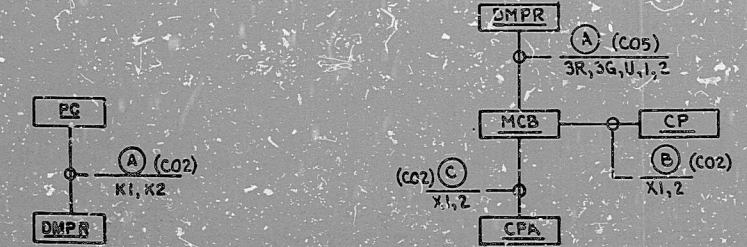

PLANT COMPUTER BLOCK DIAGRAM  
SCHEME - SEE TABLE B

BLOCK DIAGRAM  
SCHEME NO. - SEE TABLE A

REVIEW LEVEL 3

TI APERTURE CARD

BECHTEL  
GAITHERSBURG, MARYLAND

SNUPPS

SCHEMATIC DIAGRAM  
SPENT FUEL POOL. DISCHARGE TO  
AUXILIARY BLDG. DAMPER

UTILITY TRAINING NO.	REV
JOB NO.	BECHTEL DRAWING NO.
10486	E-036611 (Q)
	REV
	4

DRAWING APPLICABLE TO UNITS: 1 2 3 4 5 6 7 8

17x22 "C" SIZE

I certify that the image contained on this frame was made in the normal and regular course of business, on the data stated below and that it is an accurate reproduction of the document(s) submitted to M...  
DATE 1-10-88 OPERATOR J.L. Stearns SUPERVISOR J.L. Stearns



8410050569

PDR RIDS

