

H-73-0

SIZE D 22 x 36


REFERENCES

1	#810 - ADMIN. FAC. CHILLED WATER SYSTEM	M-73-0
2	DITS - ADMIN. FAC. HVAC	D3.54
3	LOGIC DIAGRAM - ADMIN. FAC.	H-74-0
4	LOGIC DIAGRAM - STD SYMBOLS	I-00-0


ABBREVIATIONS

STP-SET POINT
CHW-CHILLED WATER

REMOTE CONTROL PANEL C199

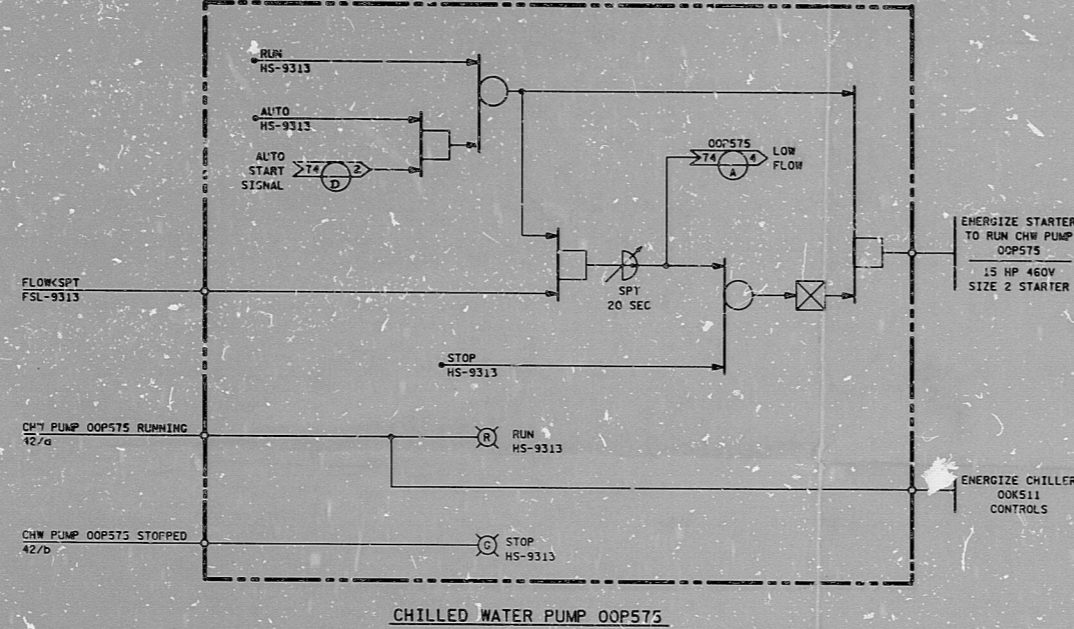

CHILLED WATER PUMP OOP575

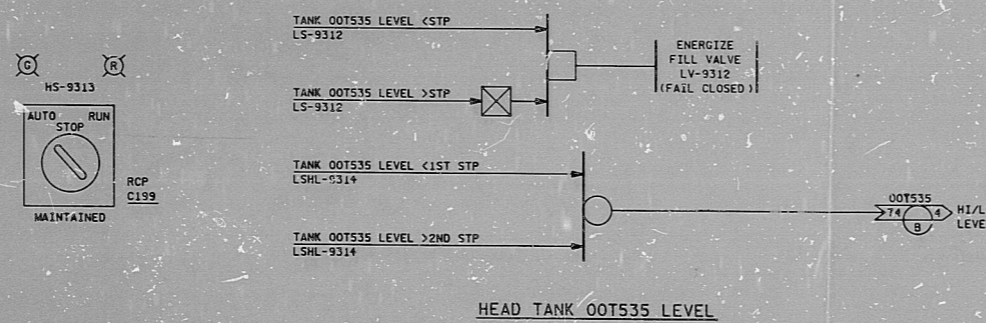

HEAD TANK OOT535 LEVEL

DATE	BY	REVISION
BECHTEL SAN FRANCISCO		
PUBLIC SERVICE ELECTRIC AND GAS COMPANY HOPE CREEK GENERATING STATION		
LCSIC DIAGRAM ADMINISTRATION FACILITY CHILLED WATER SYSTEM		
JOB No.	DRAWING No.	REV.
10855	H-73-0	JM 1 OF 1

P.R.C
APERTURE
CARD

S/U-GC

24 X

1. Verify that the microfilm label contained on this microfilm was
2. the correct and proper grade of microfilm. This is a true, full, correct
3. copy with reproduction and indications for order in lay of original cases.
4. See it against the film booth grade of equipment.

JACOBS

RIDS

8307250566

