

INFORMATION
THIS DOCUMENT IS
SUBJECT TO REVISION
WITHOUT NOTIFICATION
TO THE USER OF THIS
COPY

ELEMENTARY DIAGRAM

TERA
APERTURE
CARD

REFERENCE DRAWINGS

- 0-E-0105 - ELECTRICAL WIRING STANDARDS & SYMBOLS
- 1-Z-3673 - R.C. PRESSURIZER RELIEF TANK SHT2 CONTNT ISOL. VLVS. LOGIC DIAGRAM

FV-3651-O		
CONTACT	VALVE POSITION	USE
	CLOSE	OPEN
30		CONT.
50		GRN LT
70		SP
80		SP
	0%	100%

LEGEND

- TC - TERMINATION CABINET
- IRR-004 - SOLID STATE PROTECTION CABINET TRAIN 'B'
- IRR-033 - ESF MONITORING CABINET TRAIN 'B'
- CO-FY3651 - PRZR RELIEF TANK CONTAINMENT ISOL. SOL. VLV

NOTES

- VALVE FAILS CLOSED
- CONTACT OPENS ON CONTAINMENT ISOLATION PHASE A

CS-MB (5540)					
BLOCK	CONTACT	POSITION	AUTO	OPEN	USE
A	NC (1)	CLOSE	X	X	CONT
	NO (2)		X		SP
B	NC (3)	X	X		SP
	NO (4)		X	X	CONT

SPRING RETURN TO AUTO FROM OPEN MAINTAINED CONTACTS IN CLOSE X-DENOTES CONTACT CLOSED GE. CAT. N2CR2940US203G

FV-3651-C		
CONTACT	VALVE POSITION	USE
	CLOSE	OPEN
3C		RED LT
5C		SP
7C		CONT
8C		SP
	0%	100%

NUCLEAR SAFETY RELATED
CLASS I/E

PKG:023 SUFF:100 ACT:581


REV	DATE	DESCRIPTION	BY	CHK	ENG	PROJ	PROJ	NO	DATE	DESCRIPTION	BY	CHK	ENG	PROJ	PROJ	NO	DATE
1	11/11/81	REV'D LIM SWITCH FOR USE	UB	TT	DS												
2	11/11/81	ISSUED FOR REVIEW COMMENT	UB	TT	DS												

Brown & Root, Inc.
ENGINEERS-CONSTRUCTORS
HOUSTON, TEXAS

SOUTH TEXAS PROJECT

DRAWING TITLE	CONTRACT NO	SCALE
ELECTRICAL	CR-0241	NONE
CONTROL WIRING DIAGRAM		
PRESZR RELIEF TK CONTMT	DRAWING NO 4-R-1A	
ISOLATION VALVE FV-3651	1-E-6477-B	

BROWN & ROOT INC.
MICROFILM SERVICES

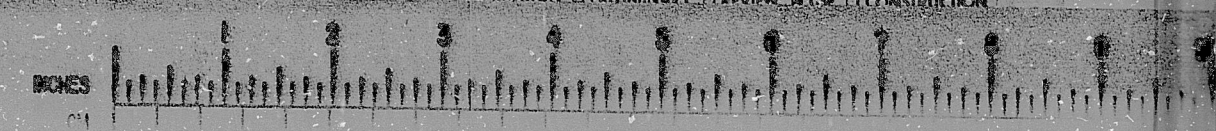

RIDS

8112100468

