

CS-MB (1597) R.C. BLDG HVAC RCFC 11A

CONTACTS HANDLE END	POSITION			USE
	START	AUTO	STOP	
1 IC 2 2C 1			X	CONT
2			X	CONT
3 3C 4 4C 3		X		SP
4		X		SP
5 5C 6 6C 5	X			CONT
6	X			CONT
7 7C 8 8C 7	X			SP
8	X	X	X	CONT

SPRING RETURN TO AUTO
X-DENOTES CONTACTS CLOSED
GE TYPE 58M (SPECIAL)

CS-ZLP (ZLP-100) R.C. BLDG HVAC RCFC 11A

CONTACTS HANDLE END	POSITION			USE
	START	AUTO	STOP	
1 IC 2 2C 1			X	CONT
2			X	CONT
3 3C 4 4C 3		X		SP
4		X		SP
5 5C 6 6C 5	X			CONT
6	X			CONT
7 7C 8 8C 7	X			SP
8	X	X	X	CONT

SPRING RETURN TO AUTO
X-DENOTES CONTACTS CLOSED
GE TYPE 58M (SPECIAL)

CS-ZLP (ZLP-100) R.C. BLDG HVAC RCFC 11A

CONTACTS HANDLE END	POSITION			USE
	LOCAL	REMOTE	USE	
1 IC 2 2C 1		X	CONT	
2	X		CONT	
3 3C 4 4C 3		X	CONT	
4	X		CONT	
5 5C 6 6C 5		X	CONT	
6	X		CONT	
7 7C 8 8C 7		X	CONT	
8	X		CONT	
9 9C 10 10C 9		X	CONT	
10	X		CONT	
11 11C 12 12C 11		X	CONT	
12	X		CONT	
13 13C 14 14C 13		X	CONT	
14	X		SP	
15 15C 16 16C 15		X	CONT	
16	X		CONT	

MAINTAINED CONTACT
X-DENOTES CONTACTS CLOSED
GE 58M (SPECIAL)

INFORMATION
THIS DOCUMENT IS SUBJECT TO REVISION WITHOUT NOTIFICATION TO THE USER OF THIS COPY

- REFERENCE DRAWINGS**
- 0-E-0105 - ELECTRICAL WIRING STANDARDS & SYMBOLS
 - 1-Z-3490 - RC. BLDG. HVAC RCFC.
 - 1-E-7230 - CONTROL WIRING DIAGRAM RC. BLDG. HVAC. RCFC 11A

LEGEND

- 27-LOSS OF CONTROL PHR. RELAY
- 480V-LOAD CENTER-GIA-COMPT. 2D
- OTS - OVER CURRENT TRIP SW.
- SEQ - ESF LOAD SEQUENCER ACTUATION SIGNAL MECH EQUIP NO. ZVIAIVFNOO1

TERA APERTURE CARD

NUCLEAR SAFETY RELATED CLASS 1E

PKG: 019 SUFF: 100 ACT: 581


DRAWING TITLE ELECTRICAL	CONTRACT NO. SCALE CR-0241 NONE
ELEMENTARY DIAGRAM RC. BLDG. HVAC RCFC 11A	DRAWING NO. 4-V-14 1-E-5230-B

NO.	DATE	DESCRIPTION	BY	CHK	PROJ. ENGR.	PROJ. MGR.	NO.	DATE	DESCRIPTION	BY	CHK	PROJ. ENGR.	PROJ. MGR.
1	10/19/79	FOR REVIEW & COMMENT	T. J. BROWN										

Brown & Root Inc.
ENGINEERS-CONSTRUCTORS
HOUSTON, TEXAS

SOUTH TEXAS PROJECT

BROWN & ROOT INC. MICROFILM SERVICES

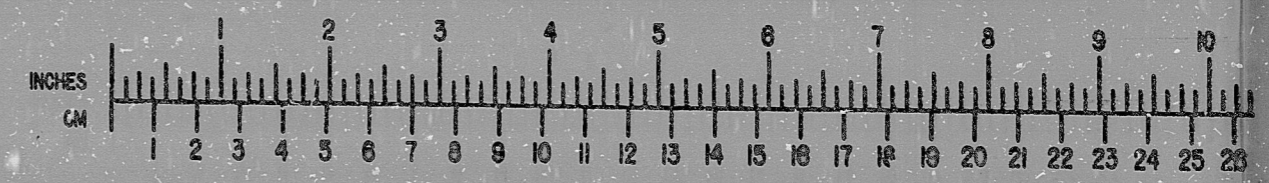

FRIDAY, OCT. 19 1979

RIDS

8112100505

