

17"

17"

11"

11"

8.5"

8.5"

8.5"


8.5"

11"

11"

17"

17"

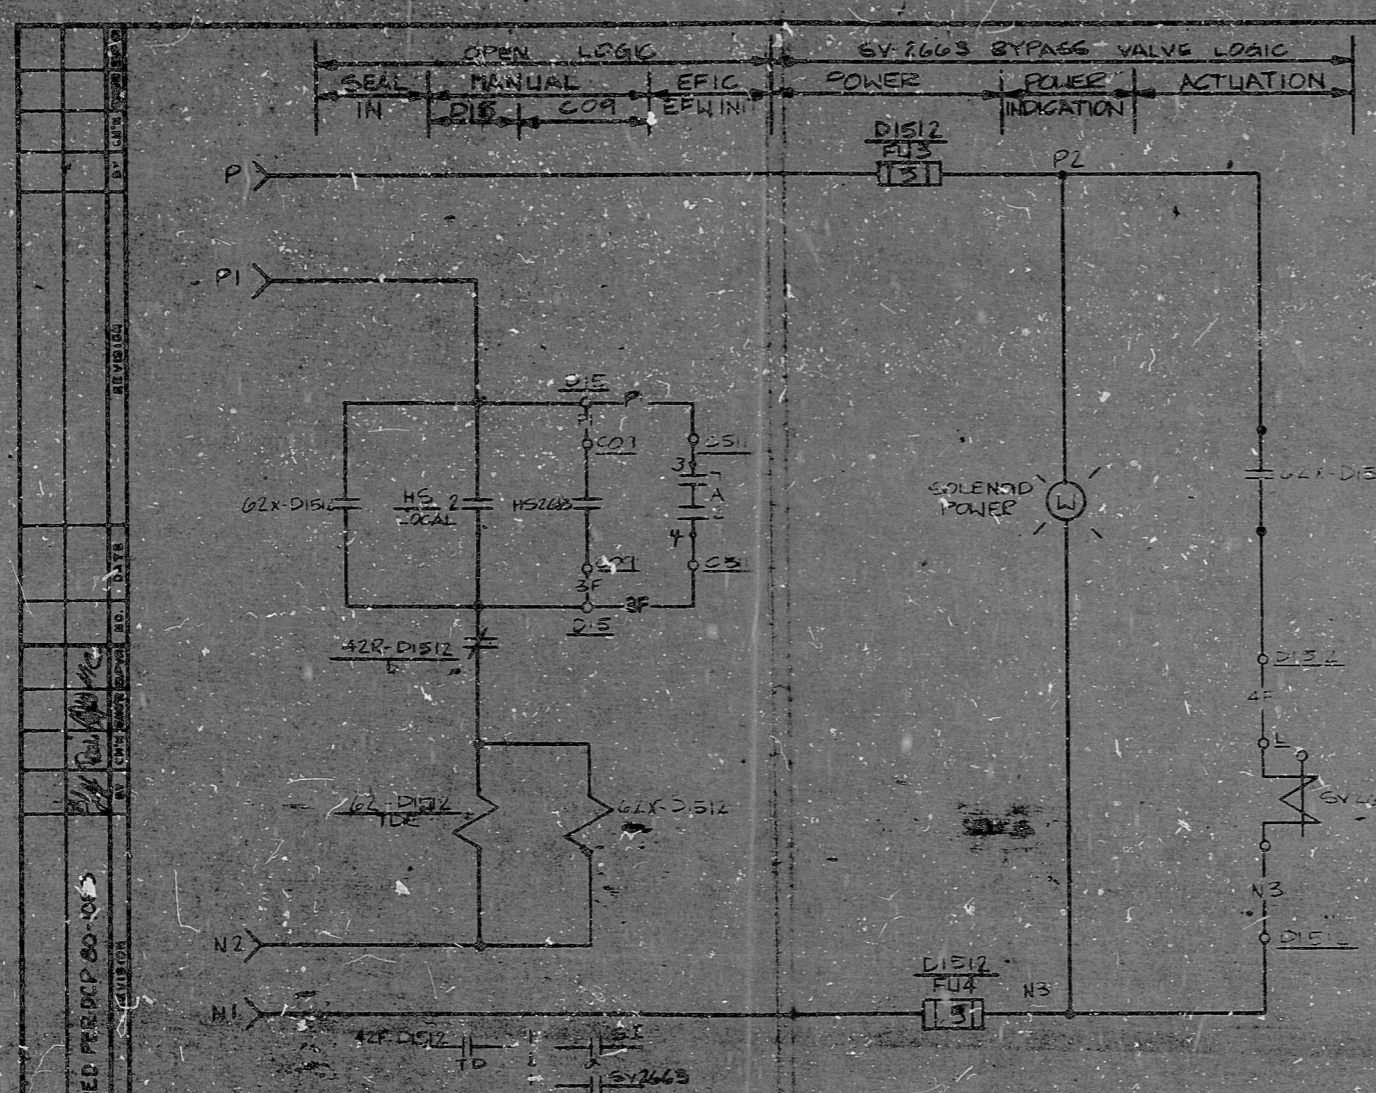

FOR INFORMATION ONLY  
 THIS DOCUMENT IS NOT CONTROLLED BEFORE USE  
 VERIFY INFORMATION WITH A CONTROLLED DOCUMENT

PRO APERTURE CARD

NOTE (CONT.)  
 RELAYS 62-DIS12, 62X-DIS12, 42R-DIS12 TO BE A STAT MODEL 102R001 TIME DELAY ON ENERGIZATION. TIME DELAY SETTING FOR PROPER TURBINE BYPASS VALVE OPERATION TO BE DETERMINED BY FIELD TESTING.

REF:  
 EPIC TRIP MODULE E-80

FOR INFORMATION REVIEW ONLY

ARKANSAS POWER AND LIGHT COMPANY  
 ARKANSAS NUCLEAR ONE  
 PAGE 737 UNIT 1 REV. 0

SCHEMATIC DIAGRAM  
 EMERGENCY FEEDWATER  
 TURBINE MOV'S

SCHEM. D-313 RED

ADAPTER TRIP CONTINUED

DESCRIPTION	RELAYS	ALIX CONTACTS	CHANNEL
EPW TURBINE K3 STM. AD. BYPASS VLV	SV263 62-DIS12 62X-DIS12	42R-DIS12/L	RED
	SV266 62-DIS12 62X-DIS12	42R-DIS12/L	GRN

AP E-295 SH. 4 N  
 7307269985

RIDS

8307260583

