


NO. 10090-OH-06-3

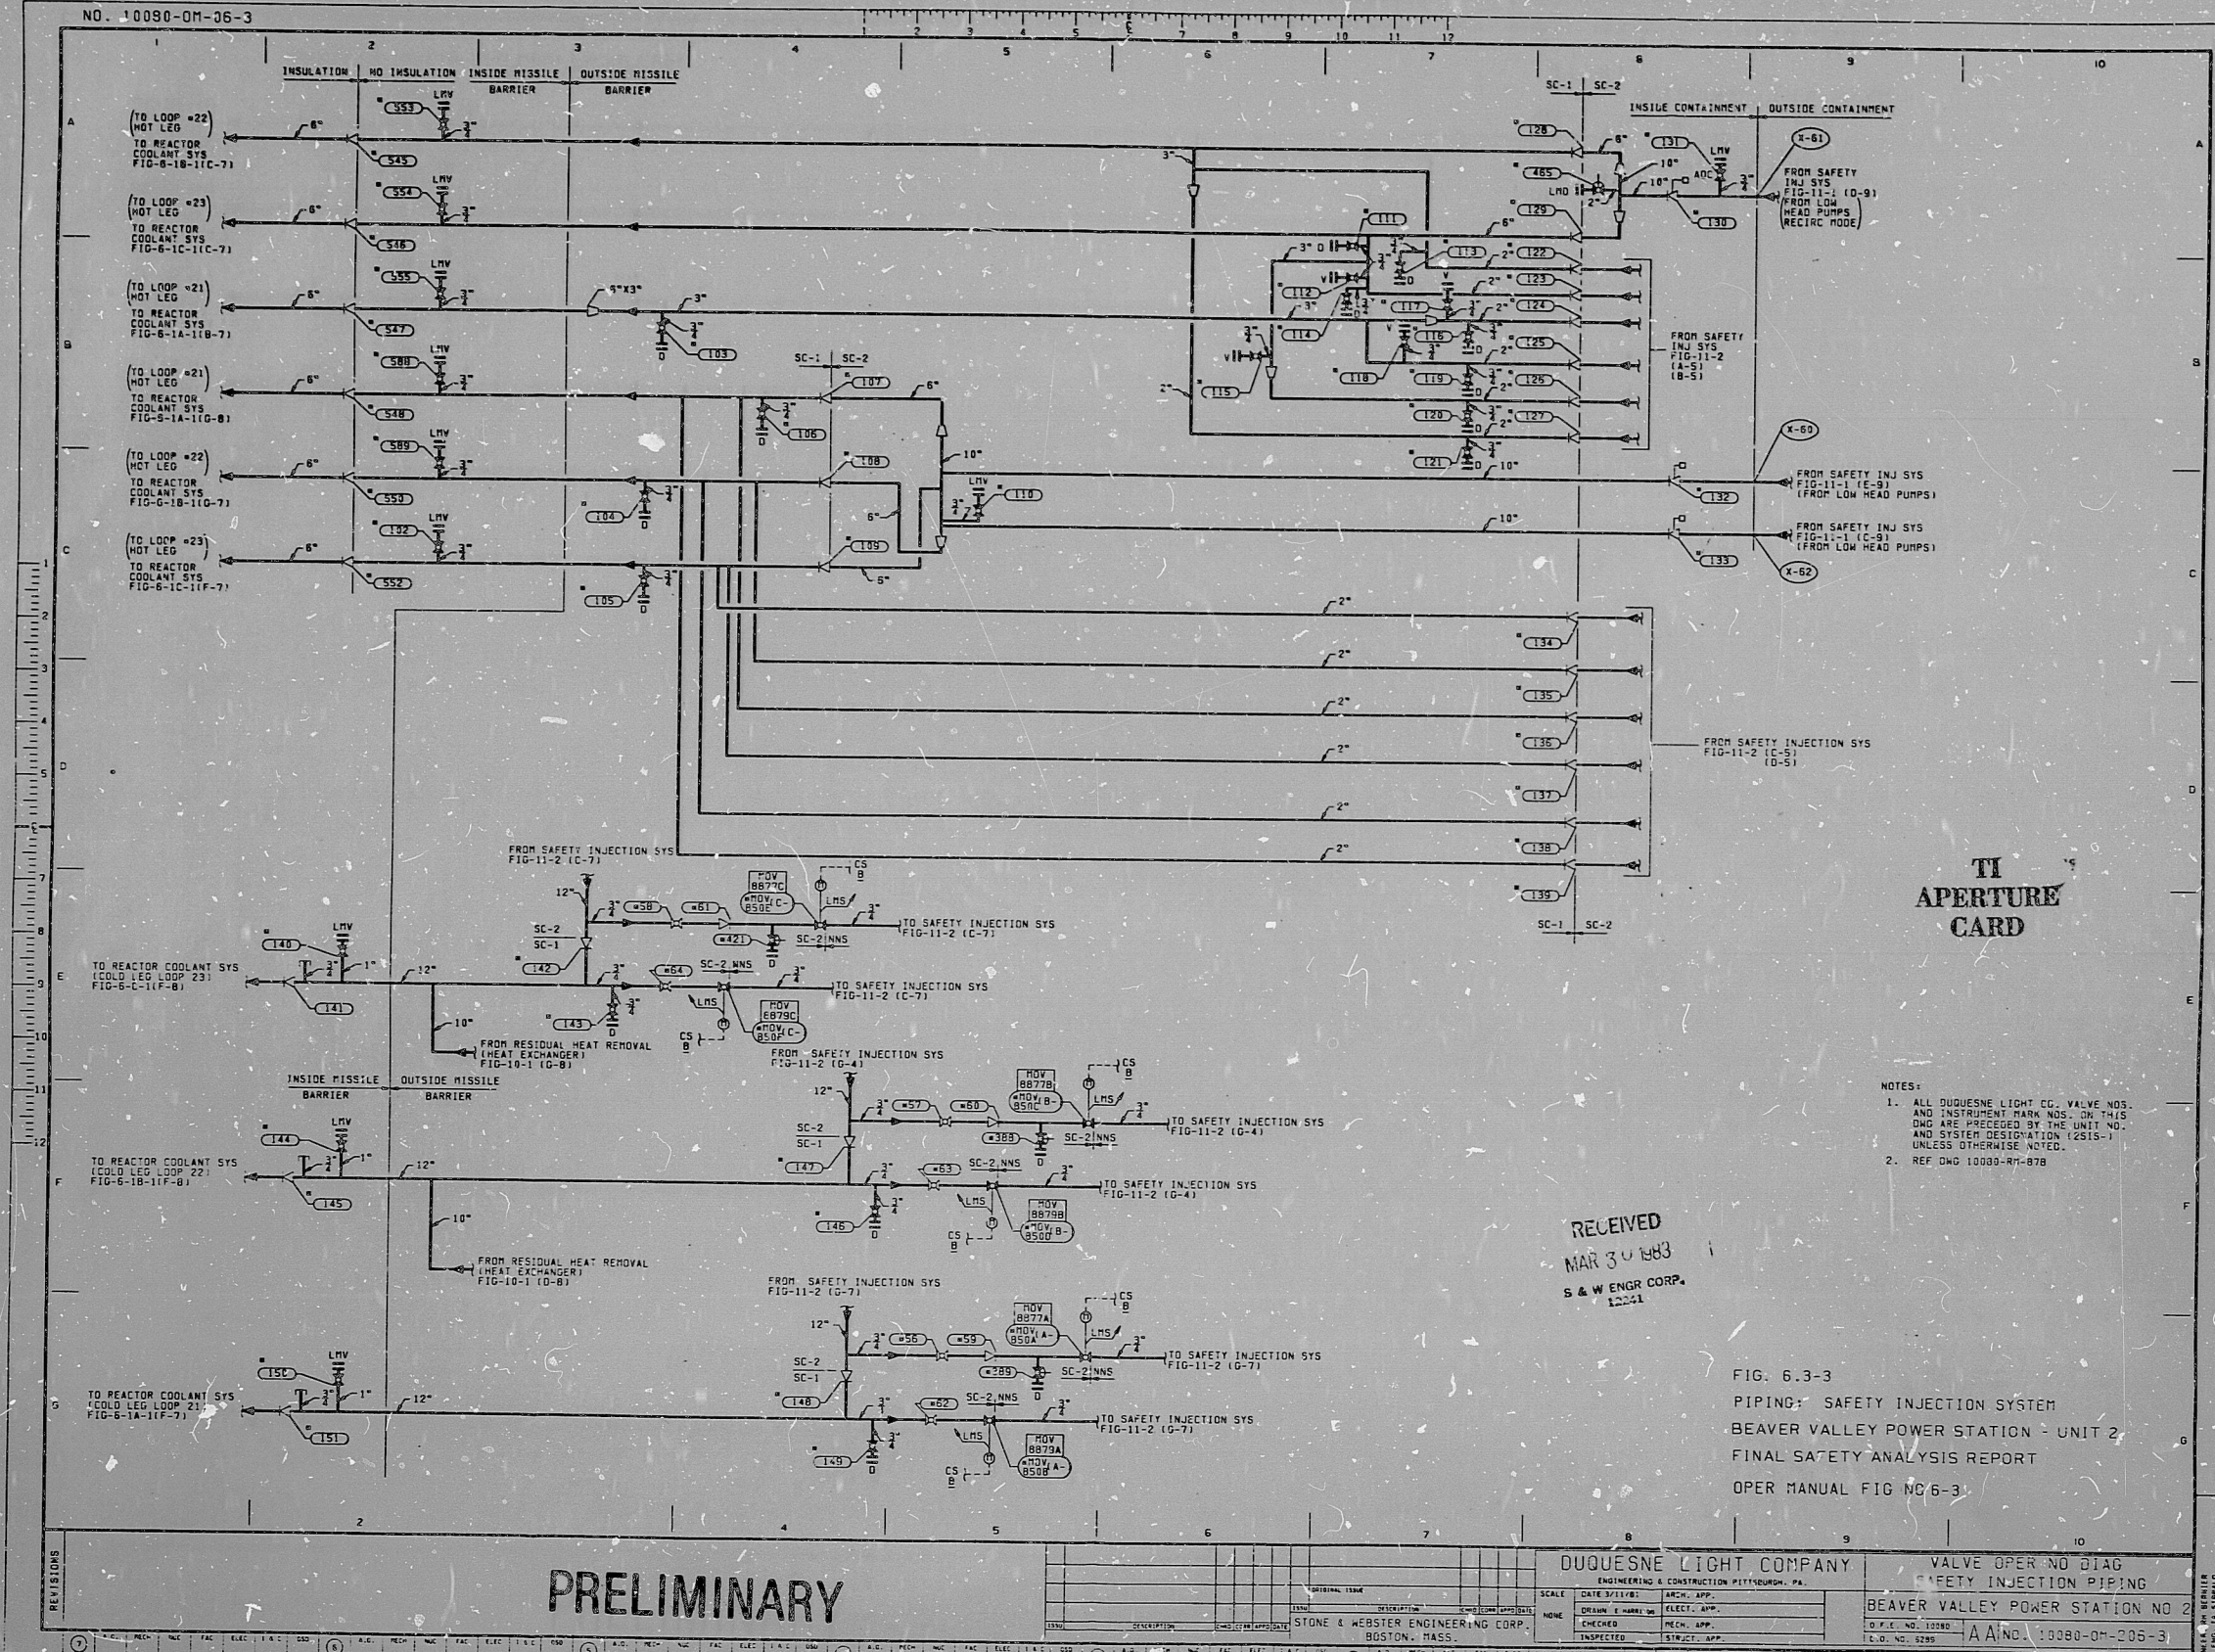

**TI
APERTURE
CARD**

- NOTES:
1. ALL DUQUESNE LIGHT CO. VALVE NOS. AND INSTRUMENT MARK NOS. ON THIS DWG ARE PRECEDED BY THE UNIT NO. AND SYSTEM DESIGNATION (2515-1) UNLESS OTHERWISE NOTED.
 2. REF. Dwg 10090-RH-078

RECEIVED
MAR 30 1983
S & W ENGR CORP.
12241

FIG. 6.3-3
PIPING: SAFETY INJECTION SYSTEM
BEAVER VALLEY POWER STATION - UNIT 2
FINAL SAFETY ANALYSIS REPORT
OPER MANUAL FIG NO. 6-3

PRELIMINARY

REVISIONS

NO.	DATE	BY	CHKD.	DESCRIPTION

DUQUESNE LIGHT COMPANY ENGINEERING & CONSTRUCTION PITTSBURGH, PA.		VALVE OPER NO DIAG SAFETY INJECTION PIPING
SCALE: AS SHOWN	DATE: 3/11/82	PROJECT: BEAVER VALLEY POWER STATION NO 2
DRAWN: J. W. BROWN	CHECKED: J. W. BROWN	D.P.L. NO. 10090
DESIGNED: J. W. BROWN	INSPECTED: J. W. BROWN	L.O. NO. 6295
STONE & WEBSTER ENGINEERING CORP. BOSTON, MASS.		A INDA 10090-OH-206-3

IS & W DWR. NO. 10090-OH-06-3-18

841190464

PDR RIDS

8411190464

