
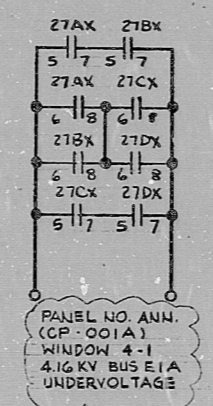
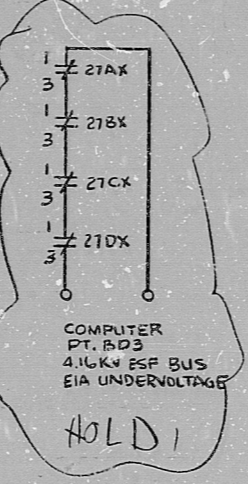


GROUND FAULT ALARM ANN (CP001A) WINDOW NO. 5-1 4.16KV BUS EIA GROUND FAULT

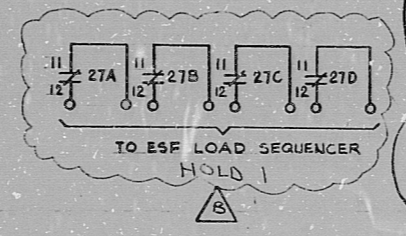

TERA APERTURE CARD

ELECT. EQUIP. NO. 3E1S1ESG0E1A 4.16KV SWGR. EIA

INFORMATION  
THIS DOCUMENT IS  
SUBJECT TO REVISION  
WITHOUT NOTIFICATION  
TO THE USER OF THIS  
COPY

REFERENCE DRAWINGS  
0-E-0105 ELECT. WIRING STDS & SYMBOLS  
1-E-6052 CWD SUPPLY BKR. BEIA  
52769-D-277 GOULD MISC. CIRCUITS  
B&R FILE #E151X042-6U

LEGEND  
SON-XFMR NEUTRAL OVERCURRENT RELAY  
SONX-XFMR NEUTRAL OVERCURRENT ALARM AUX. RELAY  
27A,B,C,D- UNDERVOLTAGE RELAY  
27XA,B,C,D-UNDERVOLTAGE AUX. RELAY


NUCLEAR SAFETY RELATED  
CLASS IE

REV. PER. ENG. COMMENTS		B.T.	DATE	DESCRIPTION		BY	CHK	PROJ	PROJ	SOUTH TEXAS PROJECT		PK	PKG: 032	SUFF: 102	ACT: 581	DRAWING TITLE	CONTRACT NO.	SCALE
ISSUED FOR USE		AH	4/81							ELECTRICAL						CR-0241	NONE	
DATE	DESCRIPTION	BY	CHK	ENG	MGR	SUP	CL	EN	NO	DATE	DESCRIPTION	BY	CHK	ENG	MGR	DRAWING NO. 4-E-15		
4.16 KV SUPPLY BKR BEIA																1-E-4052-BSH3		



BROWN & ROOT INC.  
MICROFILM SERVICES

MONDAY, FEB. 2 1981

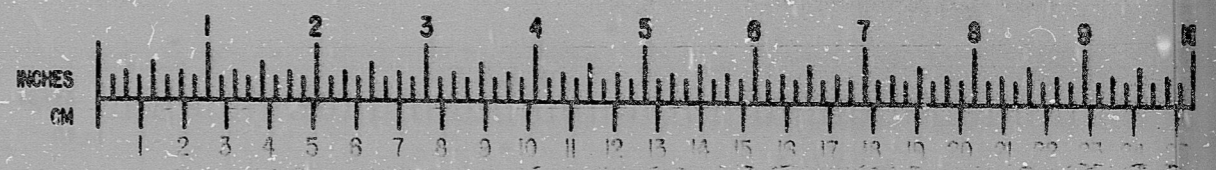

MICROFILMED 309 6

RIDS

812180359

