


INSERVICE INSPECTION

REVISIONS BLOCK

GRID	REV. NO.	DESCRIPTION	CHKD. DATE	CHKD. BY	APPROV. DATE
	0	REL FOR CONST	6-10-82	HAW TFL	2-18-89
	1	ADDED CLASS B SPECIAL TO WJ384 FW1	6-10-82	A. PPF	6-10-82
	2	ADD QA CONDITION I	1-30-83	EPR RDT	3-24-83

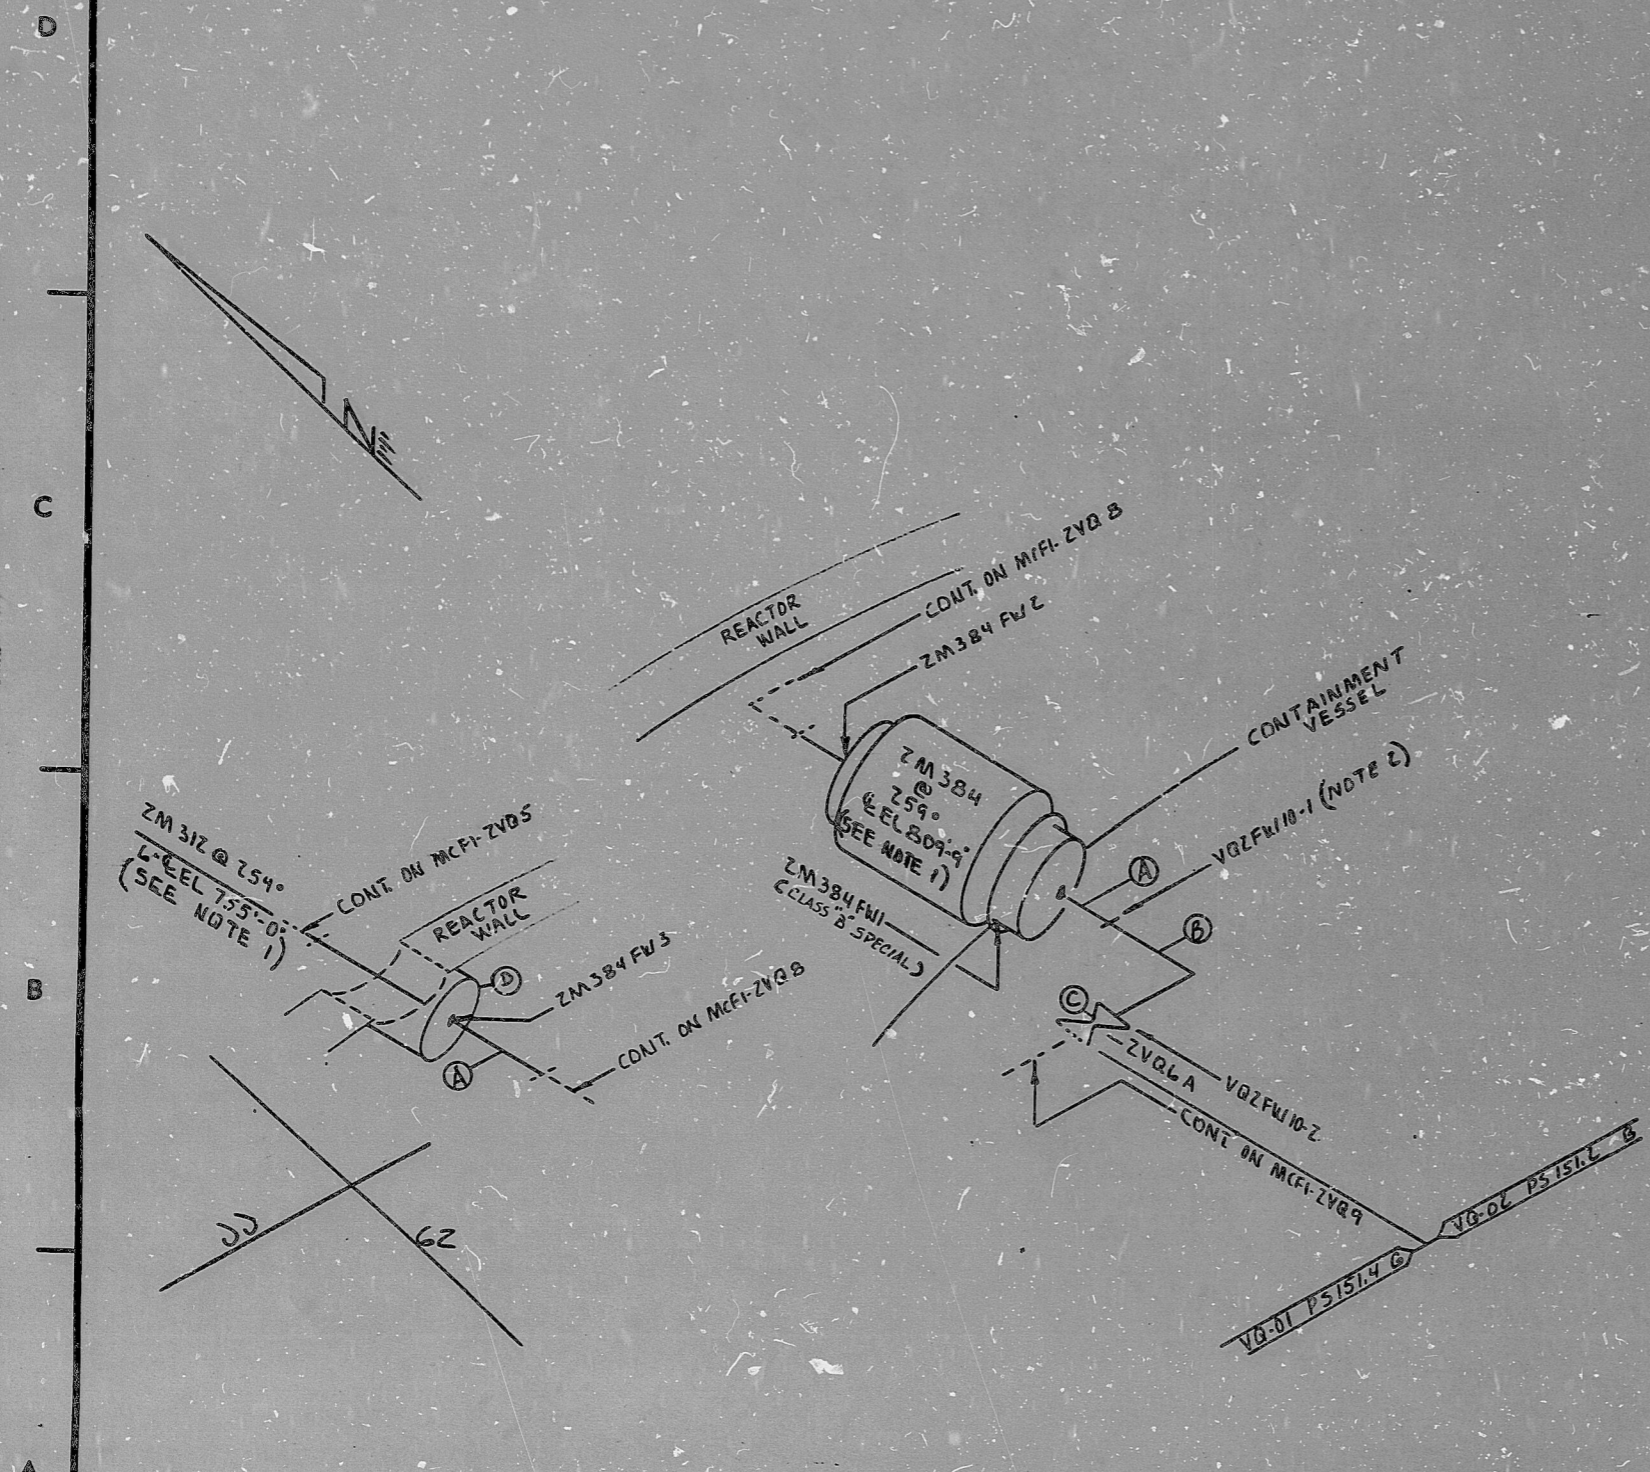

FOR INFORMATION ONLY

FOR INFORMATION ONLY

SI APERTURE CARD

ITEM	SIZE	DES.	SPEC./GRADE	SPEC./GRADE	SCH./RATE	REMARKS
27"	P.CAP	SA234 WPB			.500 WALL	C.S. SMS/EPW
4"	ZVQ 6A	IN SB-219			40	SMS/EPW
6"	PIPE	SA312 TP304	SA312 TP304		10	SMS/EPW

BILL OF MATERIAL QA CONDITION I

DUKE POWER COMPANY
McGUIRE NUCLEAR STATION

LAST WELD NO. 2 LAST FL. NO. N/A

NUCLEAR SAFETY RELATED YES NO

PIPE SPEC: 151.2 SYS. SYMBO: VR SEC. NO: 02 DRAWING NO: MC-2422-17.20-00 EL: 755'

APPLICABLE CODE: ASME SECTION III CLASS: B ISO. NO: MCFI-ZVQ10 REV: 2

BUILDING: R-27 ZONE: R-27

NOTES

- PENETRATION 384 PENETRATES THE CONTAINMENT @ SLEEVE 384 AND REAC. BLDG. WALL @ 312. (NOTE 17 MC-1677-1.2) -
- TAPER I.A.W. MDG-ES-11 FROM SCH. 40 TO SCH. 10 -

8904030178

PDR RIDS

