


INSERVICE INSPECTION

REVISIONS BLOCK

GRID	REV. NO.	DESCRIPTION	ORIG. DATE	CHKD. DATE	APPROV. DATE
	0	RELEASE FOR CONSTRUCTION	6-30-78	7-8-78	7-11-78
	1	CHANGED ISO NO. TO 2WLS8, CHANGED SEC. NO. TO 26, CHANGE PIPE SPEC. TO 151.2	7-11-78	7-11-78	7-11-78
	2	ADDED 2WLS8 FL-1	7-11-78	7-11-78	7-11-78
	3	ADDED QA Condition I	3-27-82	6-1-82	6-1-82

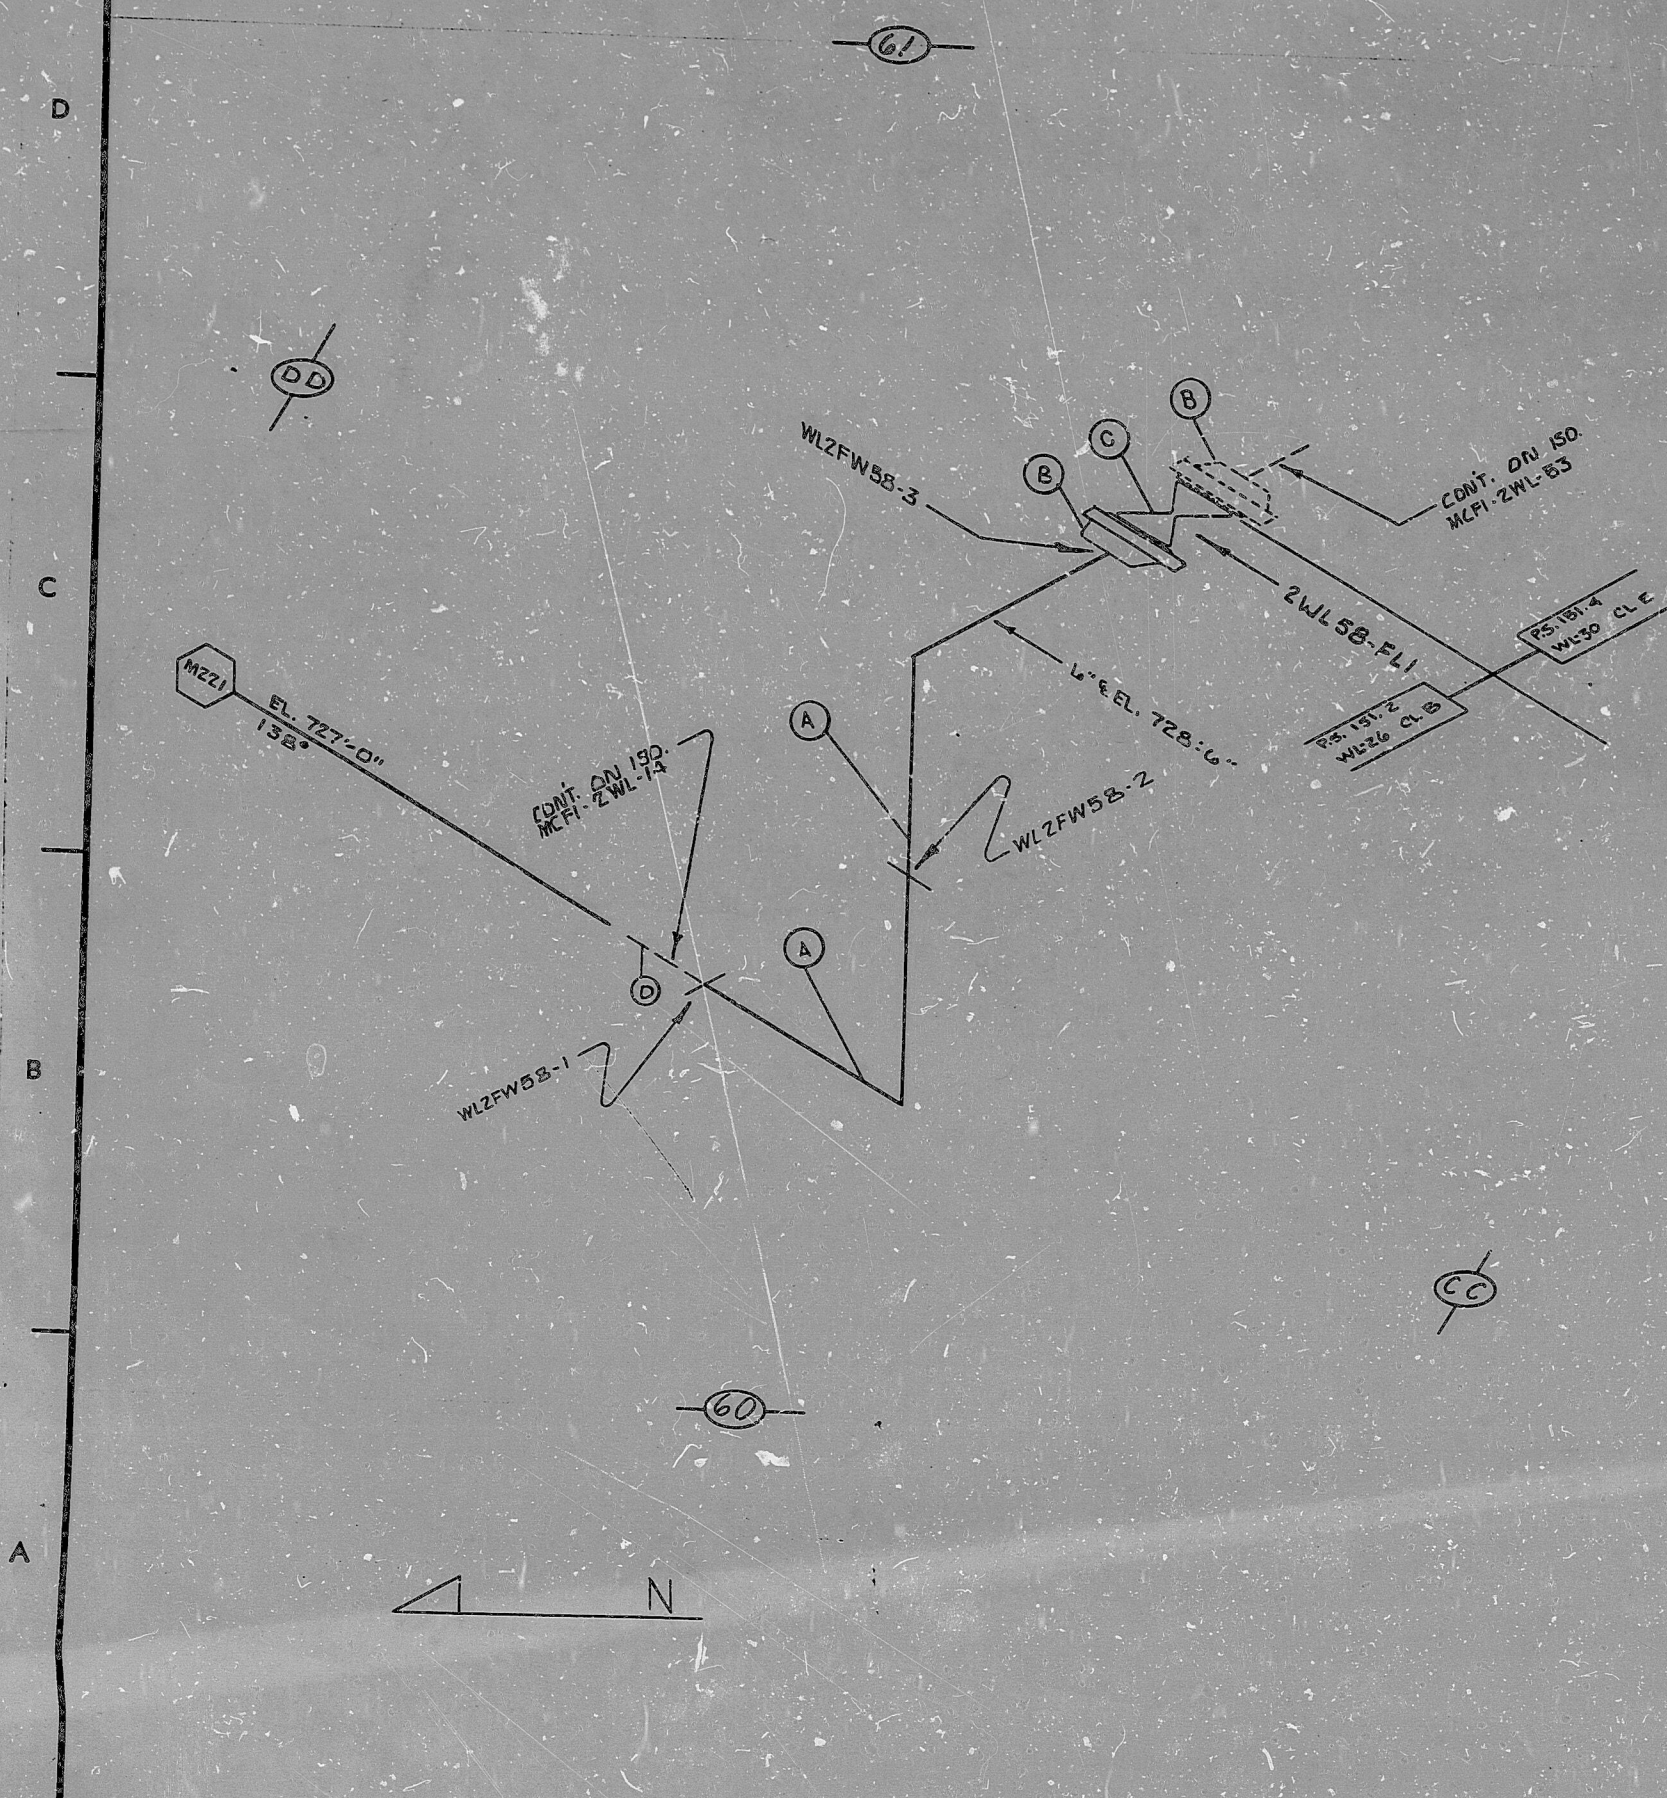

FOR INFORMATION ONLY

SI APERTURE CARD

ITEM	SIZE	DES.	SPEC./GRADE	SPEC./GRADE	SCH./RATE	REMARKS
D	6"	PIPE	SA-312 TP304	SA-376 TP304	SCH. 10	SMLS OR EFW
C	2WL 322 B	2WL 322 B			SCH. 10	SMLS OR EFW
B	6"	WN. FLG.	SA-182 F304		150 #	SCH. 10
A	6"	90° ELL	SA-403 WP304		SCH. 10	SMLS OR EFW

OR

BILL OF MATERIAL QA Condition I

LAST WELD NO. WLZFW58-3	DUKE POWER COMPANY McGUIRE NUCLEAR STATION	LAST FL. NO. NA
----------------------------	---	--------------------

NUCLEAR SAFETY RELATED

PIPE SPEC: PS. 151.2	SYS. SYMBOL: NL	SEC. NO.: 26	DRAWING NO.: MC-2423-1241-06	BUILDING: AUXILIARY	ZONE: A-2
APPLICABLE CODE: ASME	SEC. III	CLASS: B	ISO. NO.: MCFI-2WL-58	EL: 716'-0"	REV: 3

8904030189

PDR RIDS

