


STBY GAS TRTMT DECAY HT REMOVAL FAN IGTS*FN2A
CKT NO IGTS A03 LOCN. IEH5*MCC2C (RED)

- 1- RED LIGHT THIS DWG
- 2- GREEN LIGHT THIS DWG
- 3- HEATER CKT ESK-7GT500
- 4- SEAL IN THIS DWG NOT USED
- 5- ENERGIZE IGTS* A03A, 1, 1, 1 ESK-7GT501
- 6- AUTO START THIS DWG
- 7- SPARE
- 8- SEAL IN G2 THIS DWG

| CS | DETAIL | ESK | SPARES | USED ON |
|----|----------|-----|--------|---------|
| 1- | IGTS A03 | AN | 3F | |
| 1- | IGTS B03 | AN | 3F | |

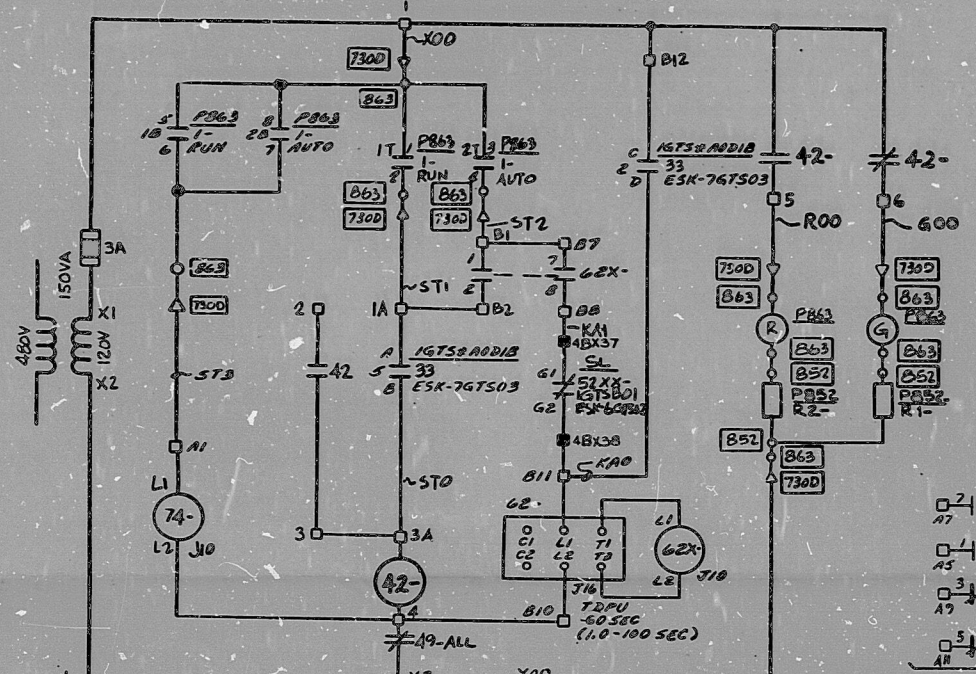

STBY GAS TRTMT DECAY HT REMOVAL FAN IGTS*FN2B
CKT NO IGTS B03 LOCN. IEH5*MCC2D (BLUE)

- 1- RED LIGHT THIS DWG
- 2- GREEN LIGHT THIS DWG
- 3- HEATER CKT TAT500
- 4- SEAL IN THIS DWG NOT USED
- 5- ENERGIZE IGTS* A03B, 2; B ESK-7GT501
- 6- AUTO START THIS DWG
- 7- SPARE
- 8- SEAL IN G2 THIS DWG

DOCUMENT USER
CONSULT E&DCR/N&D
LISTING FOR CHANGES

| NO | DATE | BY | REVISION | DESCRIPTION |
|----|---------|-----|----------|-------------|
| 1 | 2-14-64 | ... | ... | ... |
| 2 | 3-26-64 | ... | ... | ... |
| 3 | 5-24-71 | ... | ... | ... |
| 4 | 3-22-73 | ... | ... | ... |
| 5 | 3-10-77 | ... | ... | ... |
| 6 | 3-27-75 | ... | ... | ... |

NOTES:
1. ALL EQUIPMENT LOCATED AT MCC
UNLESS OTHERWISE NOTED
2. APPLICABLE LOGIC ESK-77.15

TI
APERTURE
CARD

NUCLEAR SAFETY RELATED
QA CAT I

ELEM. DIAG - 480V CONT. CKT.
STBY GAS TRTMT DECAY HT REM FANS A & B
RIVER BEND STATION - UNIT 1
GULF STATES UTILITIES COMPANY
STONER & WEBSTER ENGINEERING CORPORATION
12210-ESK-6GTS04
NON-STANDARD

FOR INFORMATION ONLY

8412170510

PDR RIDS

