


41
66
68
8.5"
11"
17"

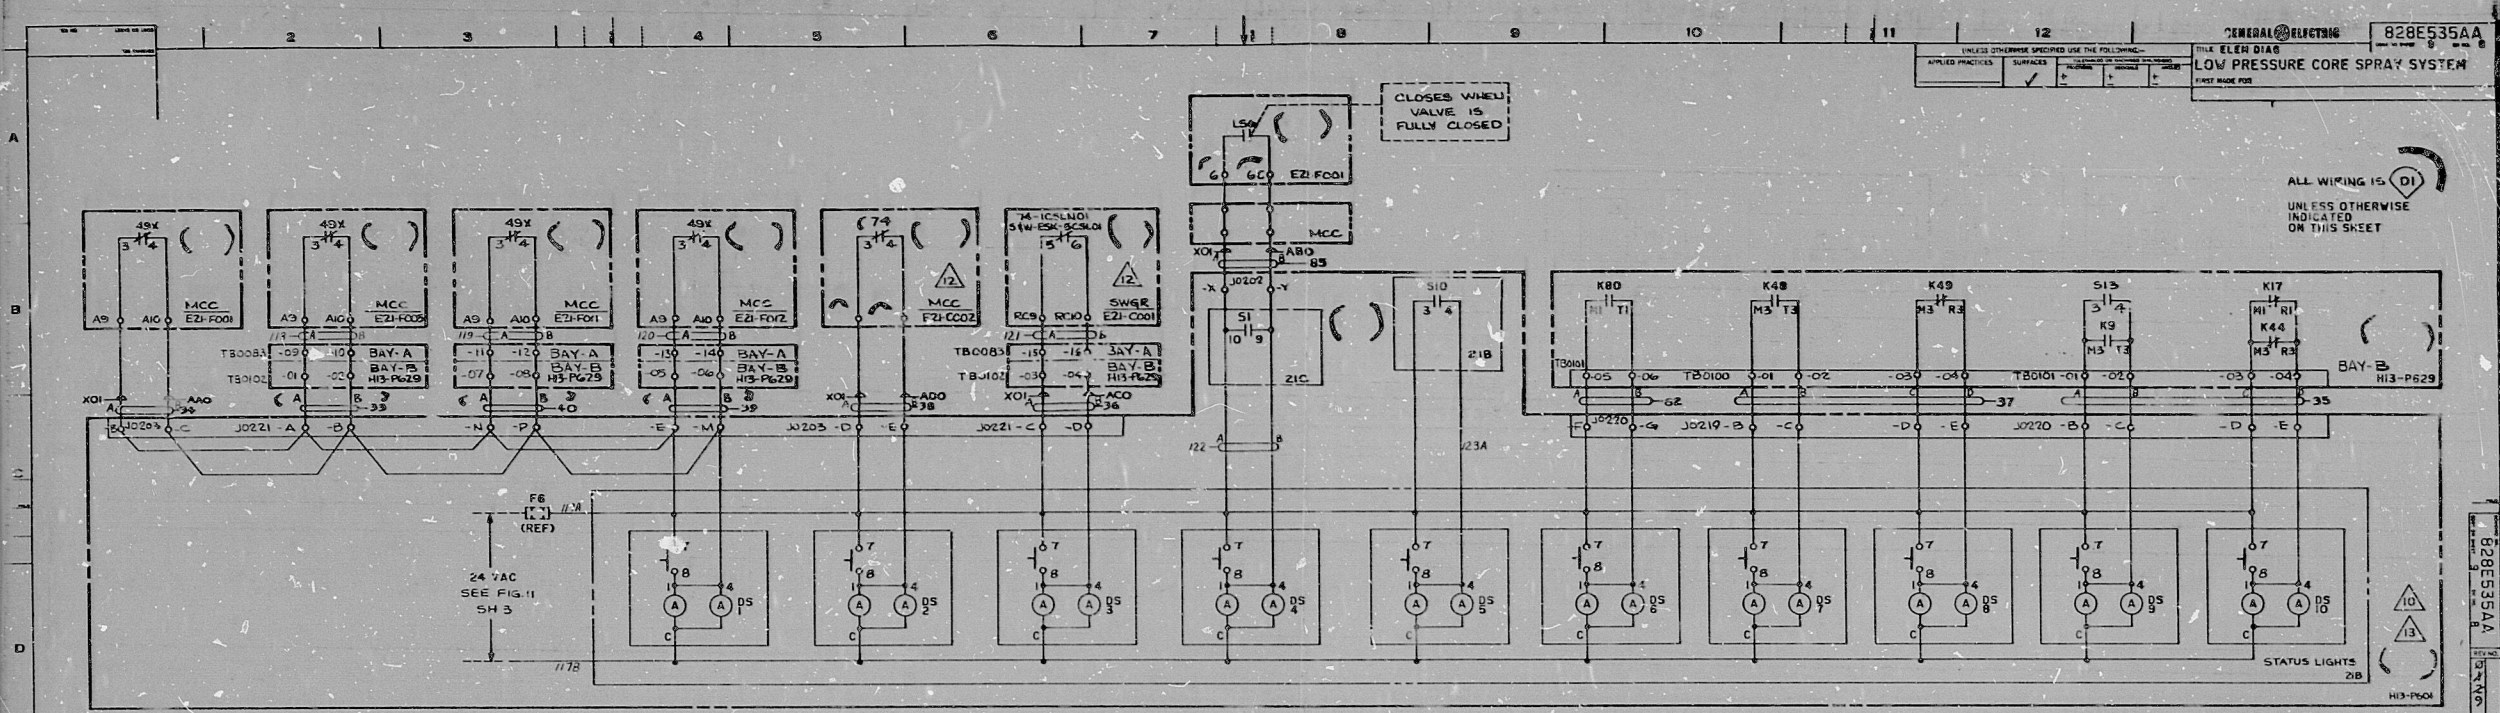

GENERAL ELECTRIC 828E535AA
TITLE: ELEC DIA
LOW PRESSURE CORE SPRAY SYSTEM
FIRST ISSUE

ALL WIRING IS (DI)
UNLESS OTHERWISE INDICATED ON THIS SHEET

LOSS OF POWER OR OVERLOAD OF ANY LPCS VALVE | DISCH LINE FILL PUMP E2H-C002 NOT IN OPERATING POSITION LOSS OF POWER LOCKED OUT BY OVERLOAD | PUMP E2H-C001 NOT IN OPERATING POSITION LOSS OF POWER LOCKED OUT BY OVERLOAD | LPCS SUCTION VALVE CONT SWITCH IN "CLOSE" POS OR VALVE FULLY CLOSED | LPCS SYSTEM MANUAL INOP | LPCS LINE BREAK | LPCS OR ECCS DIV 1 TRIP UNIT IN CALIBRATION OR GROSS FAILURE | LPCS OR ECCS DIV 1 TRIP UNIT OUT OF FILE OR POWER LOSS | LPCS/RHR A IN TEST STATUS | LOGIC POWER FAILURE

S&W CIRCUIT NO. ICSLNIO

TI
APERTURE
CARD

CABLE NO.	LINE CODE
E2IA0041	33, 36, 39, 40
0048	34, 38
0040	35, 42
0039	37
0047	35
0015	118, 119, 120, 121

LINE CODES: 33-40, 42, 43, 117-123

REV	NO	DATE	BY	CHKD	DESCRIPTION
1	1				ISSUED
2	1				REVISED

828E535AA
SAN JOSE
GENERAL ELECTRIC

41
66
68
8.5"
11"
17"

8412190034

PDR RIDS

