


11
9.8
8.5
11
17

11
9.8
8.5
11
17

REVISED (REDRAWN) INC. DCR MFC DEL. CAB. A, B, C, D, E, F
 ADD. CAP. G, H, I, J, REV. S.U. DESIG. & ADAPTER TABLE
 5-30-80 ISSUED FOR CONSTRUCTION

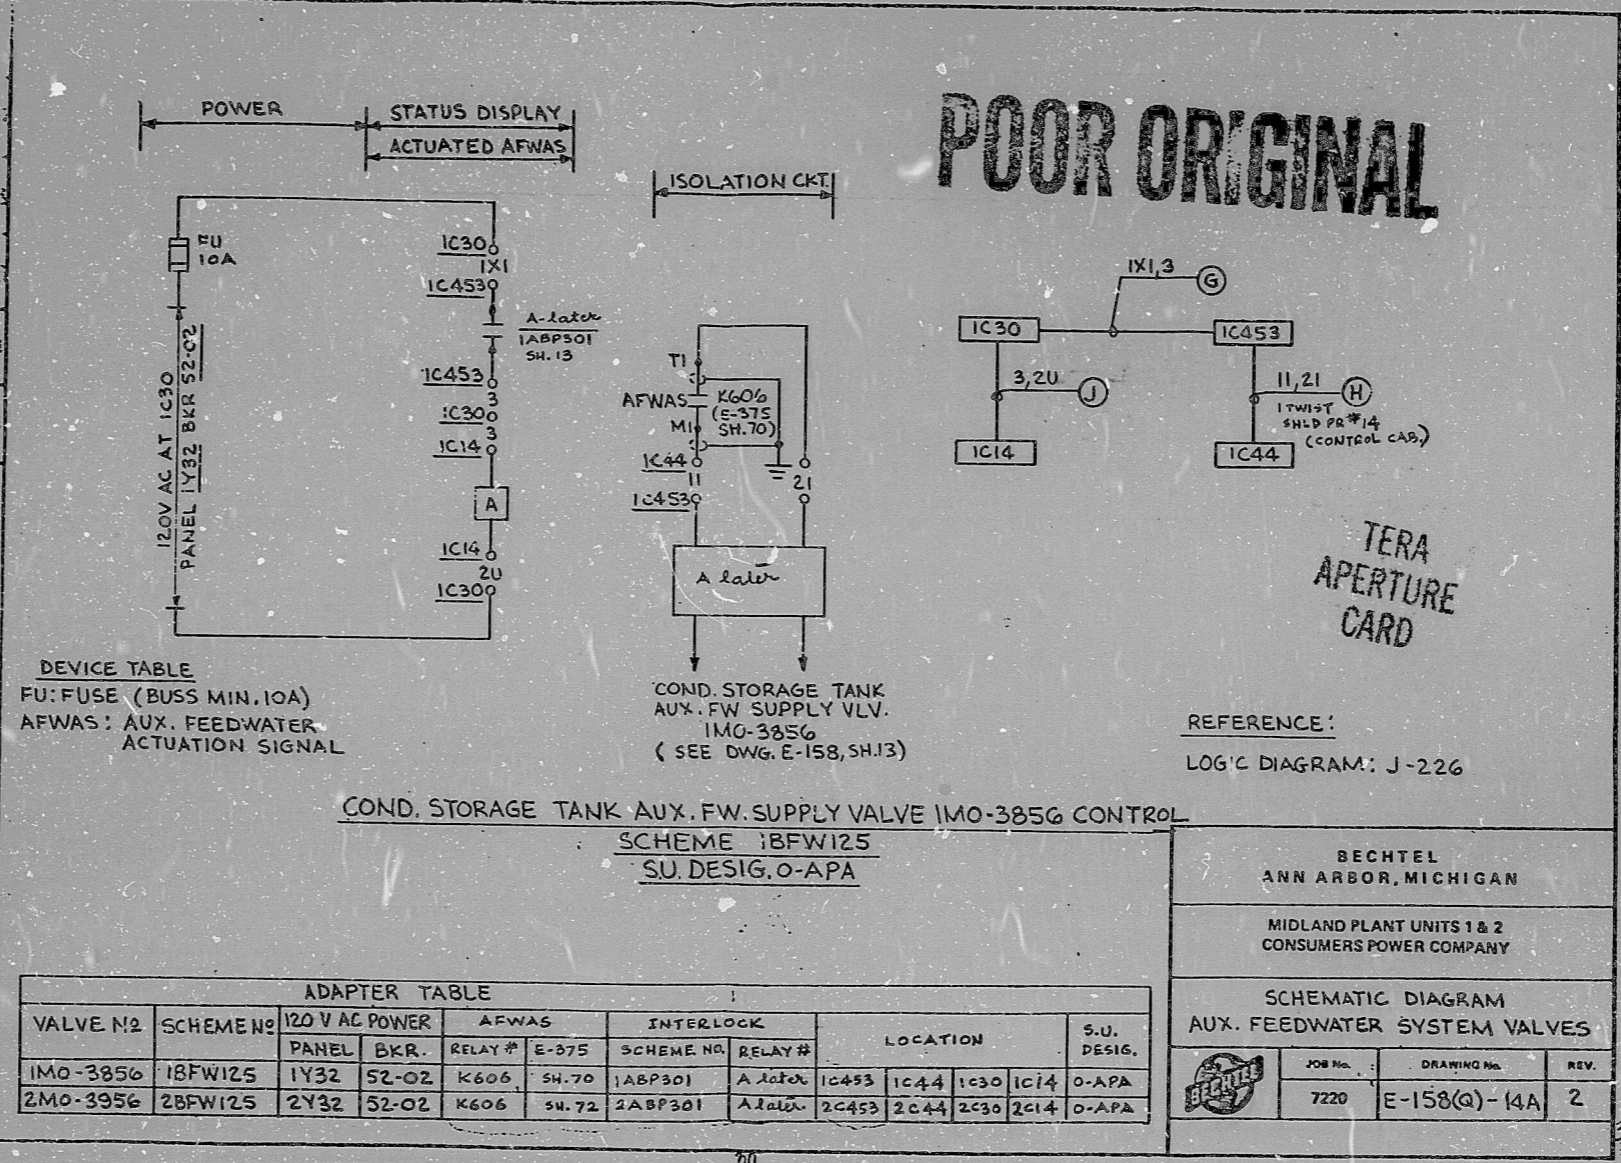

ADAPTER TABLE

VALVE NO.	SCHEME NO.	120 V AC POWER		AFWAS		INTERLOCK		LOCATION				S.U. DESIG.
		PANEL	BKR.	RELAY #	E-375	SCHEME NO.	RELAY #	1C453	1C44	1C30	1C14	
IMO-3856	18FW125	1Y32	52-02	K606	SH.70	1ABP301	A later	1C453	1C44	1C30	1C14	O-APA
2MO-3956	28FW125	2Y32	52-02	K606	SH.72	2ABP301	A later	2C453	2C44	2C30	2C14	O-APA

BECHTEL
ANN ARBOR, MICHIGAN

MIDLAND PLANT UNITS 1 & 2
CONSUMERS POWER COMPANY

SCHEMATIC DIAGRAM
AUX. FEEDWATER SYSTEM VALVES

JOB No.	DRAWING No.	REV.
7220	E-158(a)-14A	2

16X

I certify that the image contained on this frame was made in the normal and regular course of business, on the date stated below and that it is an accurate reproduction of the document submitted to the contractor for filing, by Bechtel Power Corporation.

10-23-81 DATE
 P. Lapelle CAMERA OPERATOR
 J. Adams CONTRACTOR'S SUPERVISOR OR MANAGER

RIDS

8112230257

