


This drawing and the design it covers are the property of BECHTEL. They are hereby loaned and on the borrower's express agreement that they will not be reproduced, copied, loaned, exhibited, or used in any way in the limited way and private use permitted by any written consent given by the lender to the borrower.

REV	DATE	BY	CHKD	DESCRIPTION
2	5-28-61	REVISED	VP	REFERENCE, DEVICE TABLE
1	12-18-59	REVISED	MLC	VOLTS VOLTAGE E 'ZS' NUMBERS
0	6/8/58	ISSUED	FOR	CONSTRUCTION

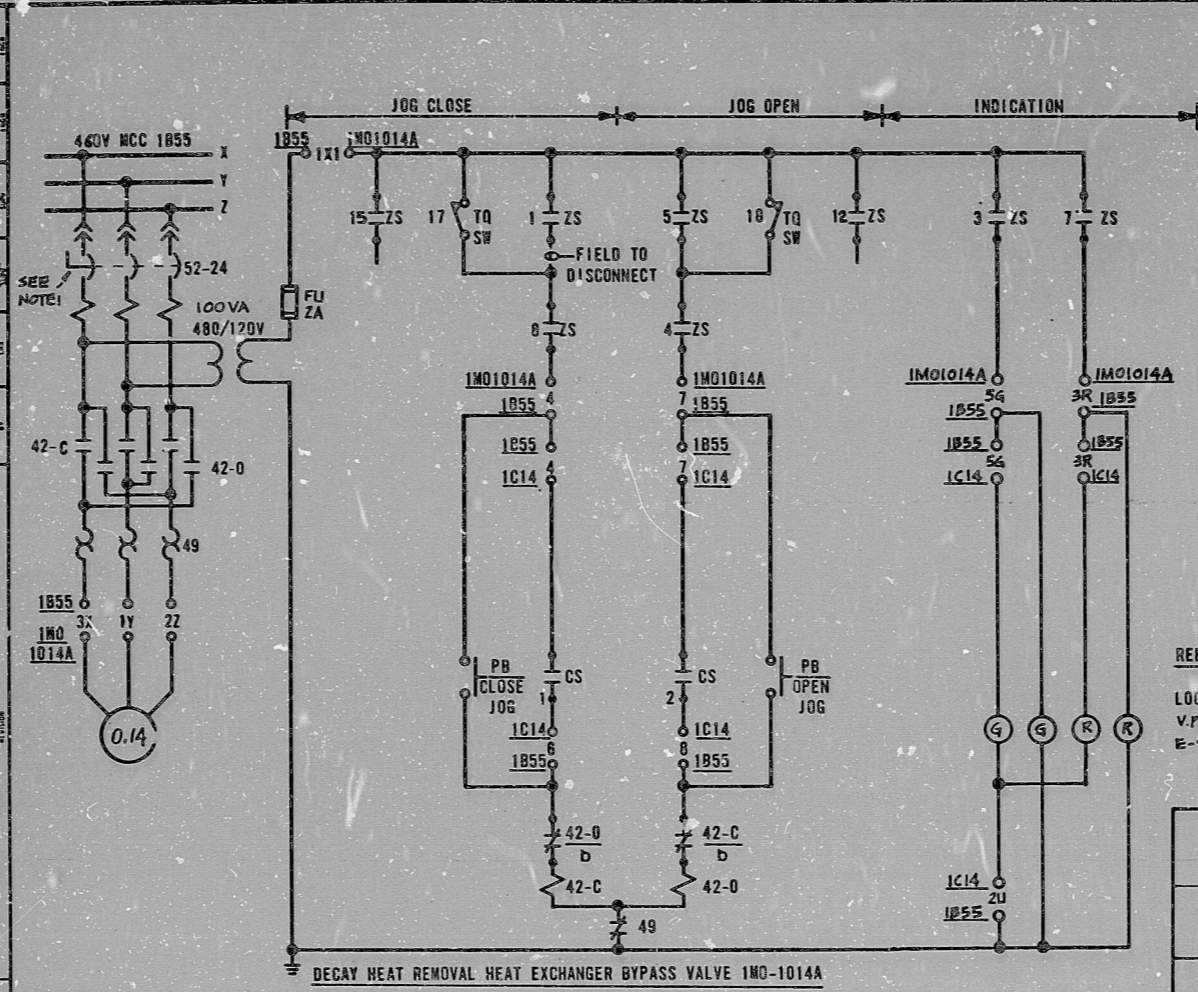

TERA APERTURE CARD

NOTE:
 I. FIELD TO PROVIDE LOCK TO MAINTAIN MCC BKCR IN OPEN POSITION DURING REACTOR POWER OPERATION.

REFERENCE
 LOGIC DIAGRAM J-019(D)
 V.P. 7220 J-258-61
 E-19 SH. 13 (TYPE 2C2)

BECHTEL ANN ARBOR, MICHIGAN		
MIDLAND PLANT UNITS 1 & 2 CONSUMERS POWER COMPANY		
SCHEMATIC DIAGRAM DECAY HEAT REMOVAL SYSTEM MOTOR OPERATED VALVES		
JOB No.	DRAWING No.	REV.
7220	E-250(D) SH 3	2

DEVICE TABLE:
 FLI: FUSE (AMP TRAP A6Y2-2)

SCHEME 1A85524
 S.U. DESIG. JBCA

I certify that the image contained on this frame was made in the normal and regular course of business, on the date stated below and that it is an accurate reproduction of the document submitted to reprographics.

6-9-61 R. Casville
 DATE CAMERA OPERATOR SUPERVISOR OF REPROGRAPHICS

16X

G-1549

RIDS

8112230643

