


This drawing and the design it covers are the property of BECHTEL. They are hereby loaned and on the borrower's express agreement that they will not be reproduced, copied, loaned, exhibited, or used except in the limited way and at the time permitted by any written consent given by the lender to the borrower.

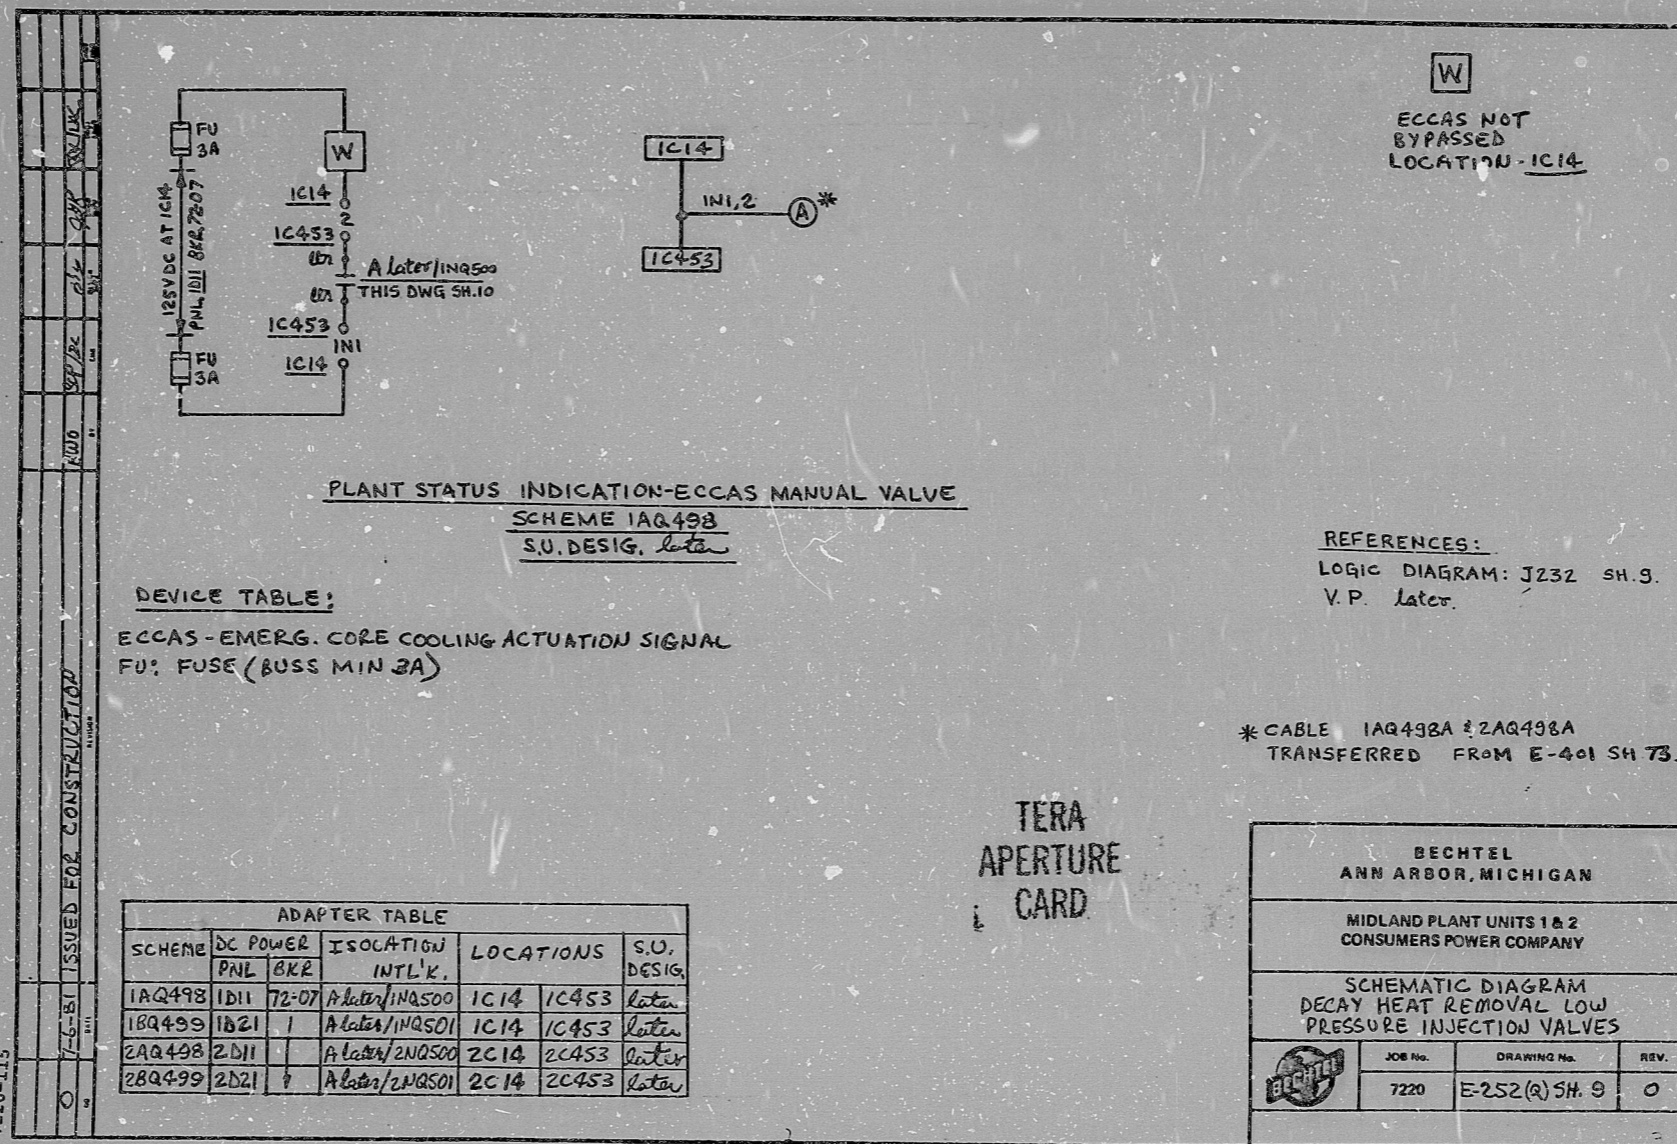

**PLANT STATUS INDICATION-ECCAS MANUAL VALVE**  
 SCHEME 1AQ498  
 S.U. DESIG. *later*

**DEVICE TABLE:**  
 ECCAS - EMERG. CORE COOLING ACTUATION SIGNAL  
 FU: FUSE (BUSS MIN 2A)

W  
 ECCAS NOT  
 BYPASSED  
 LOCATION - IC14

REFERENCES:  
 LOGIC DIAGRAM: J232 SH.9  
 V.P. *later*

\* CABLE 1AQ498A & 2AQ498A  
 TRANSFERRED FROM E-401 SH 73.

TERA  
 APERTURE  
 CARD

ADAPTER TABLE					
SCHEME	DC POWER PNL	ISOLATION BKR	ISOLATION INT'L K.	LOCATIONS	S.U. DESIG.
1AQ498	1D11	72-07	A <i>later</i> /INQ500	IC14 IC453	<i>later</i>
1BQ499	1B21	1	A <i>later</i> /INQ501	IC14 IC453	<i>later</i>
2AQ498	2D11	1	A <i>later</i> /2NQ500	2C14 2C453	<i>later</i>
2BQ499	2D21	1	A <i>later</i> /2NQ501	2C14 2C453	<i>later</i>

BECHTEL ANN ARBOR, MICHIGAN		
MIDLAND PLANT UNITS 1 & 2 CONSUMERS POWER COMPANY		
SCHEMATIC DIAGRAM DECAY HEAT REMOVAL LOW PRESSURE INJECTION VALVES		
	JOB No. 7220	DRAWING No. E-252 (R) SH. 9
		REV. 0

I certify that the image contained on this frame was made in the normal and regular course of business, on the date stated below and that it is an accurate reproduction of the document submitted to reprographics.

7/10/81 DATE  
 CAMERA OPERATOR  
 SUPERVISOR OF REPROGRAPHICS

16X

RIDS

8112230647

