


This drawing and the design it covers are the property of BECHTEL. They are hereby loaned and on the borrower's express agreement that they will not be reproduced, copied, loaned, exhibited, or used except in the limited way and under the conditions permitted by any written consent given by the lender to the borrower.

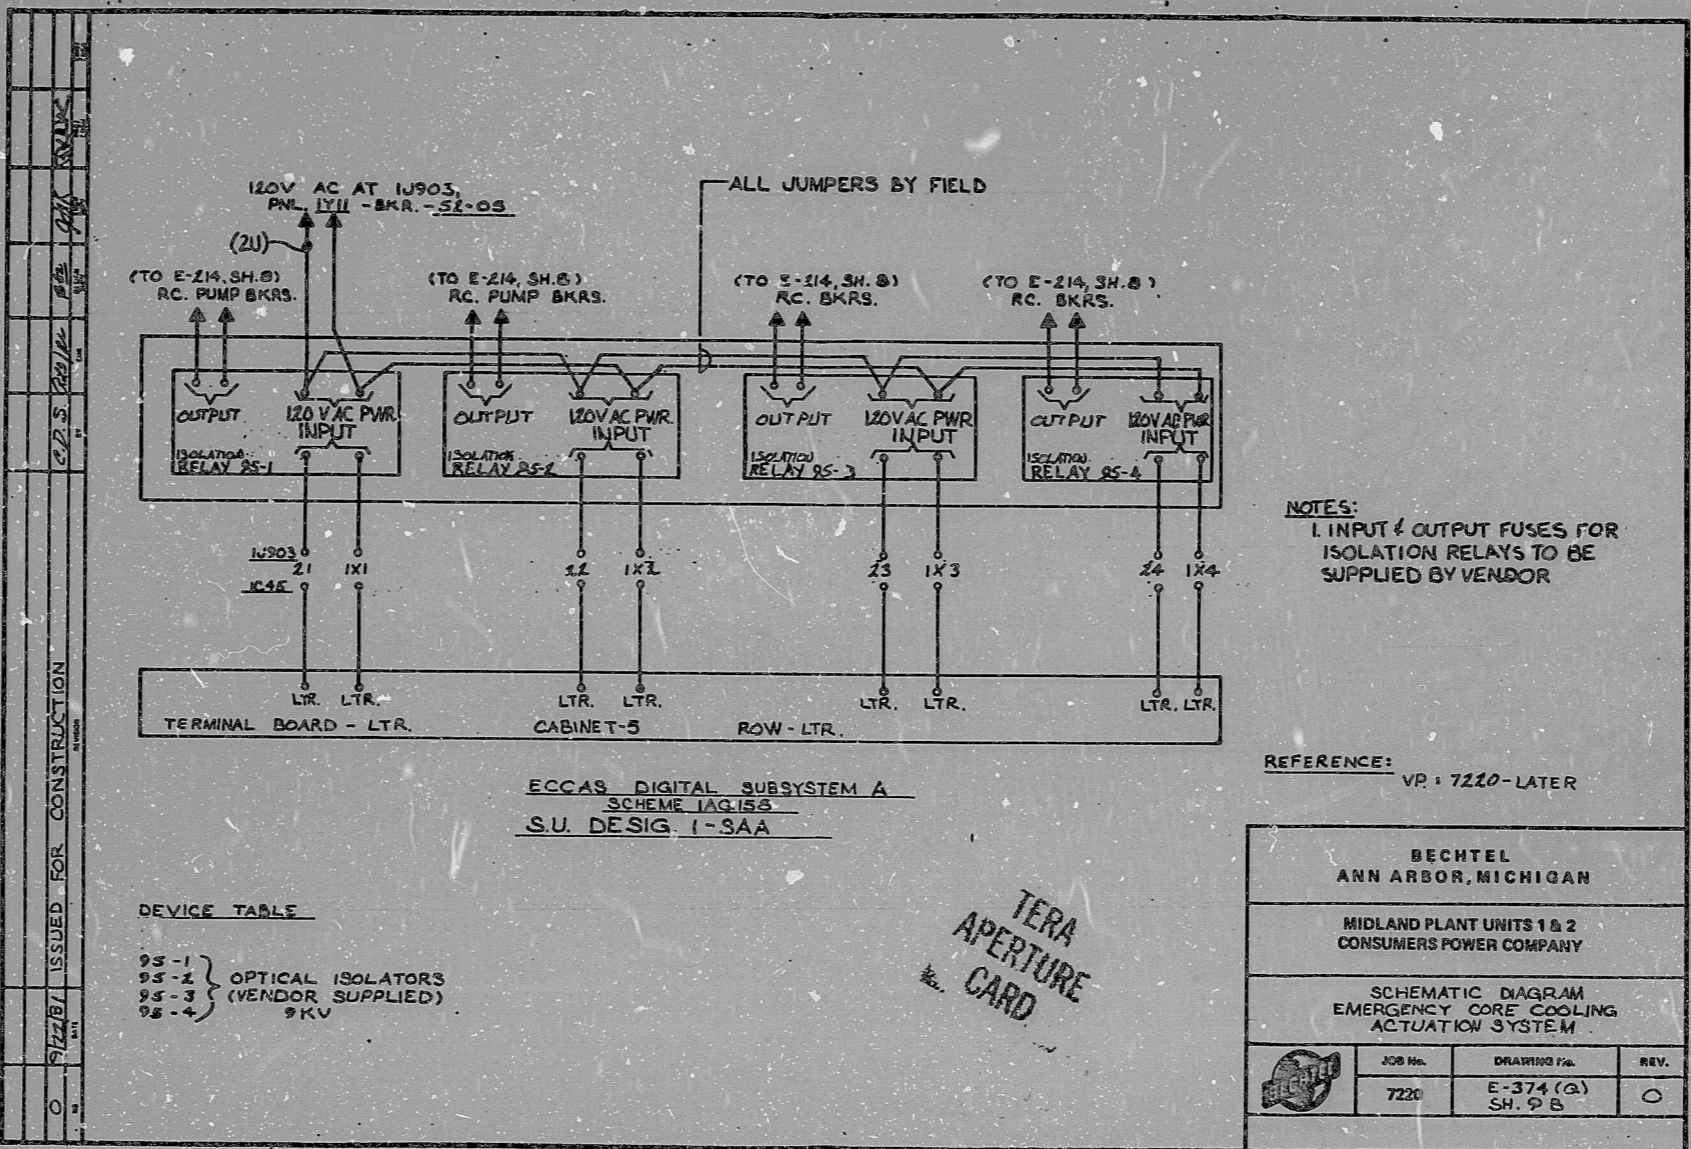

NOTES:
 1. INPUT & OUTPUT FUSES FOR ISOLATION RELAYS TO BE SUPPLIED BY VENDOR

REFERENCE: VP: 7220-LATER

DEVICE TABLE

95-1	OPTICAL ISOLATORS (VENDOR SUPPLIED) 9KV
95-2	
95-3	
95-4	

TERA APERTURE CARD

BECHTEL ANN ARBOR, MICHIGAN		
MIDLAND PLANT UNITS 1 & 2 CONSUMERS POWER COMPANY		
SCHEMATIC DIAGRAM EMERGENCY CORE COOLING ACTUATION SYSTEM		
	JOB No. 7220	DRAWING No. E-374 (A) SH. 9 B
		REV. 0

16X

I certify that the image contained on this frame was made in the normal and regular course of business, on the data stated below and that it is an accurate reproduction of the document submitted to the contractor for filing, by Bechtel Power Corporation.

10-28-81 *P. Casella* *J. Alvarado*
 DATE CAMERA OPERATOR CONTRACTOR'S SUPERVISOR OR MANAGER

RIDS

812289162

