


This drawing and the design it covers are the property of BECHTEL. They are hereby loaned and used on the borrower's expense agreement that they will not be reproduced, copied, loaned, exhibited, or used except in the limited way and purpose as permitted by any written consent given by the lender to the borrower.

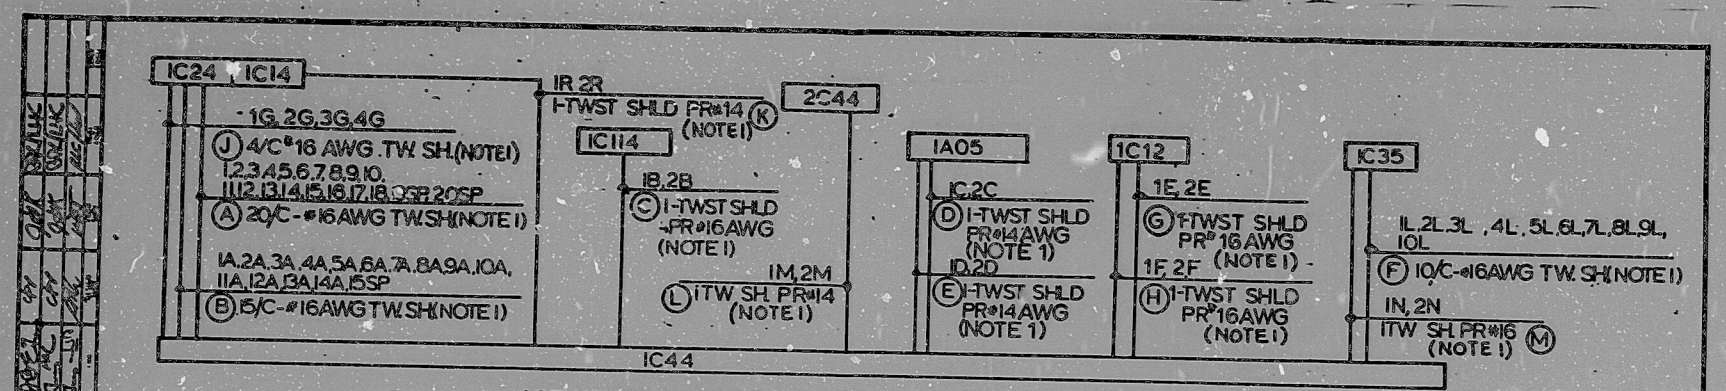

ACTUATION CABINET 'A' PB & INTERLOCKS
 SCHEME 1AQ403
 SU DESIG 1-SAB

NOTE:
 1 CABLES 'A' THRU 'M' SHOULD BE ROUTED IN CONTROL CABLE RACEWAY.

SCHEME	125VDC PWR		INTERLOCKS				ECCAS 'K' RLY		CHAN
	FNL	BKR	127X-1/1	152S/1/1	CS/1	CS/1	SCHEME	DWG	
1AQ403	ID11	72-04	IAA05001	IAA0502	IAA0511	IAA0512	IAQ156	E-374 SH17	A
1BQ403	ID21	72-03	1BA06001	1BA0602	1BA0610	1BA0611	1BQ159	E-374 SH28	B

REFERENCE
 I. V.P. 7220-J 207-29830

RAD HI	LOCATIONS							SU DESIG
	IC14	IC44	2C44	IC24	IC114	IA05	IC35	
IRIY-5369A	IC14	IC44	2C44	IC24	IC114	IA05	IC35	1SAB
IRIY-5369B	IC14	IC44	2C44	IC24	IC114	IA06	IC35	1SAB

TERA
 APERTURE
 CARD

BECHTEL
 ANN ARBOR, MICHIGAN

MIDLAND PLANT UNITS 1 & 2
 CONSUMERS POWER COMPANY

SCHEMATIC DIAGRAM
 BOP-ENGINEERED SAFETY FEATURES
 ACTUATION SYSTEM

JOB No.	DRAWING No.	REV.
7220	E 375(Q) SH 31	2

I certify that the image contained on this frame was made in the normal and regular course of business, on the date stated below and that it is an accurate reproduction of the document submitted to the contractor for filing, by Bechtel Power Corporation.

16X
 10-28-81 DATE *R. Capelle* CAMERA OPERATOR *J. Adams* CONTRACTOR'S SUPERVISOR OR MANAGER

RIPB

8112280184

