


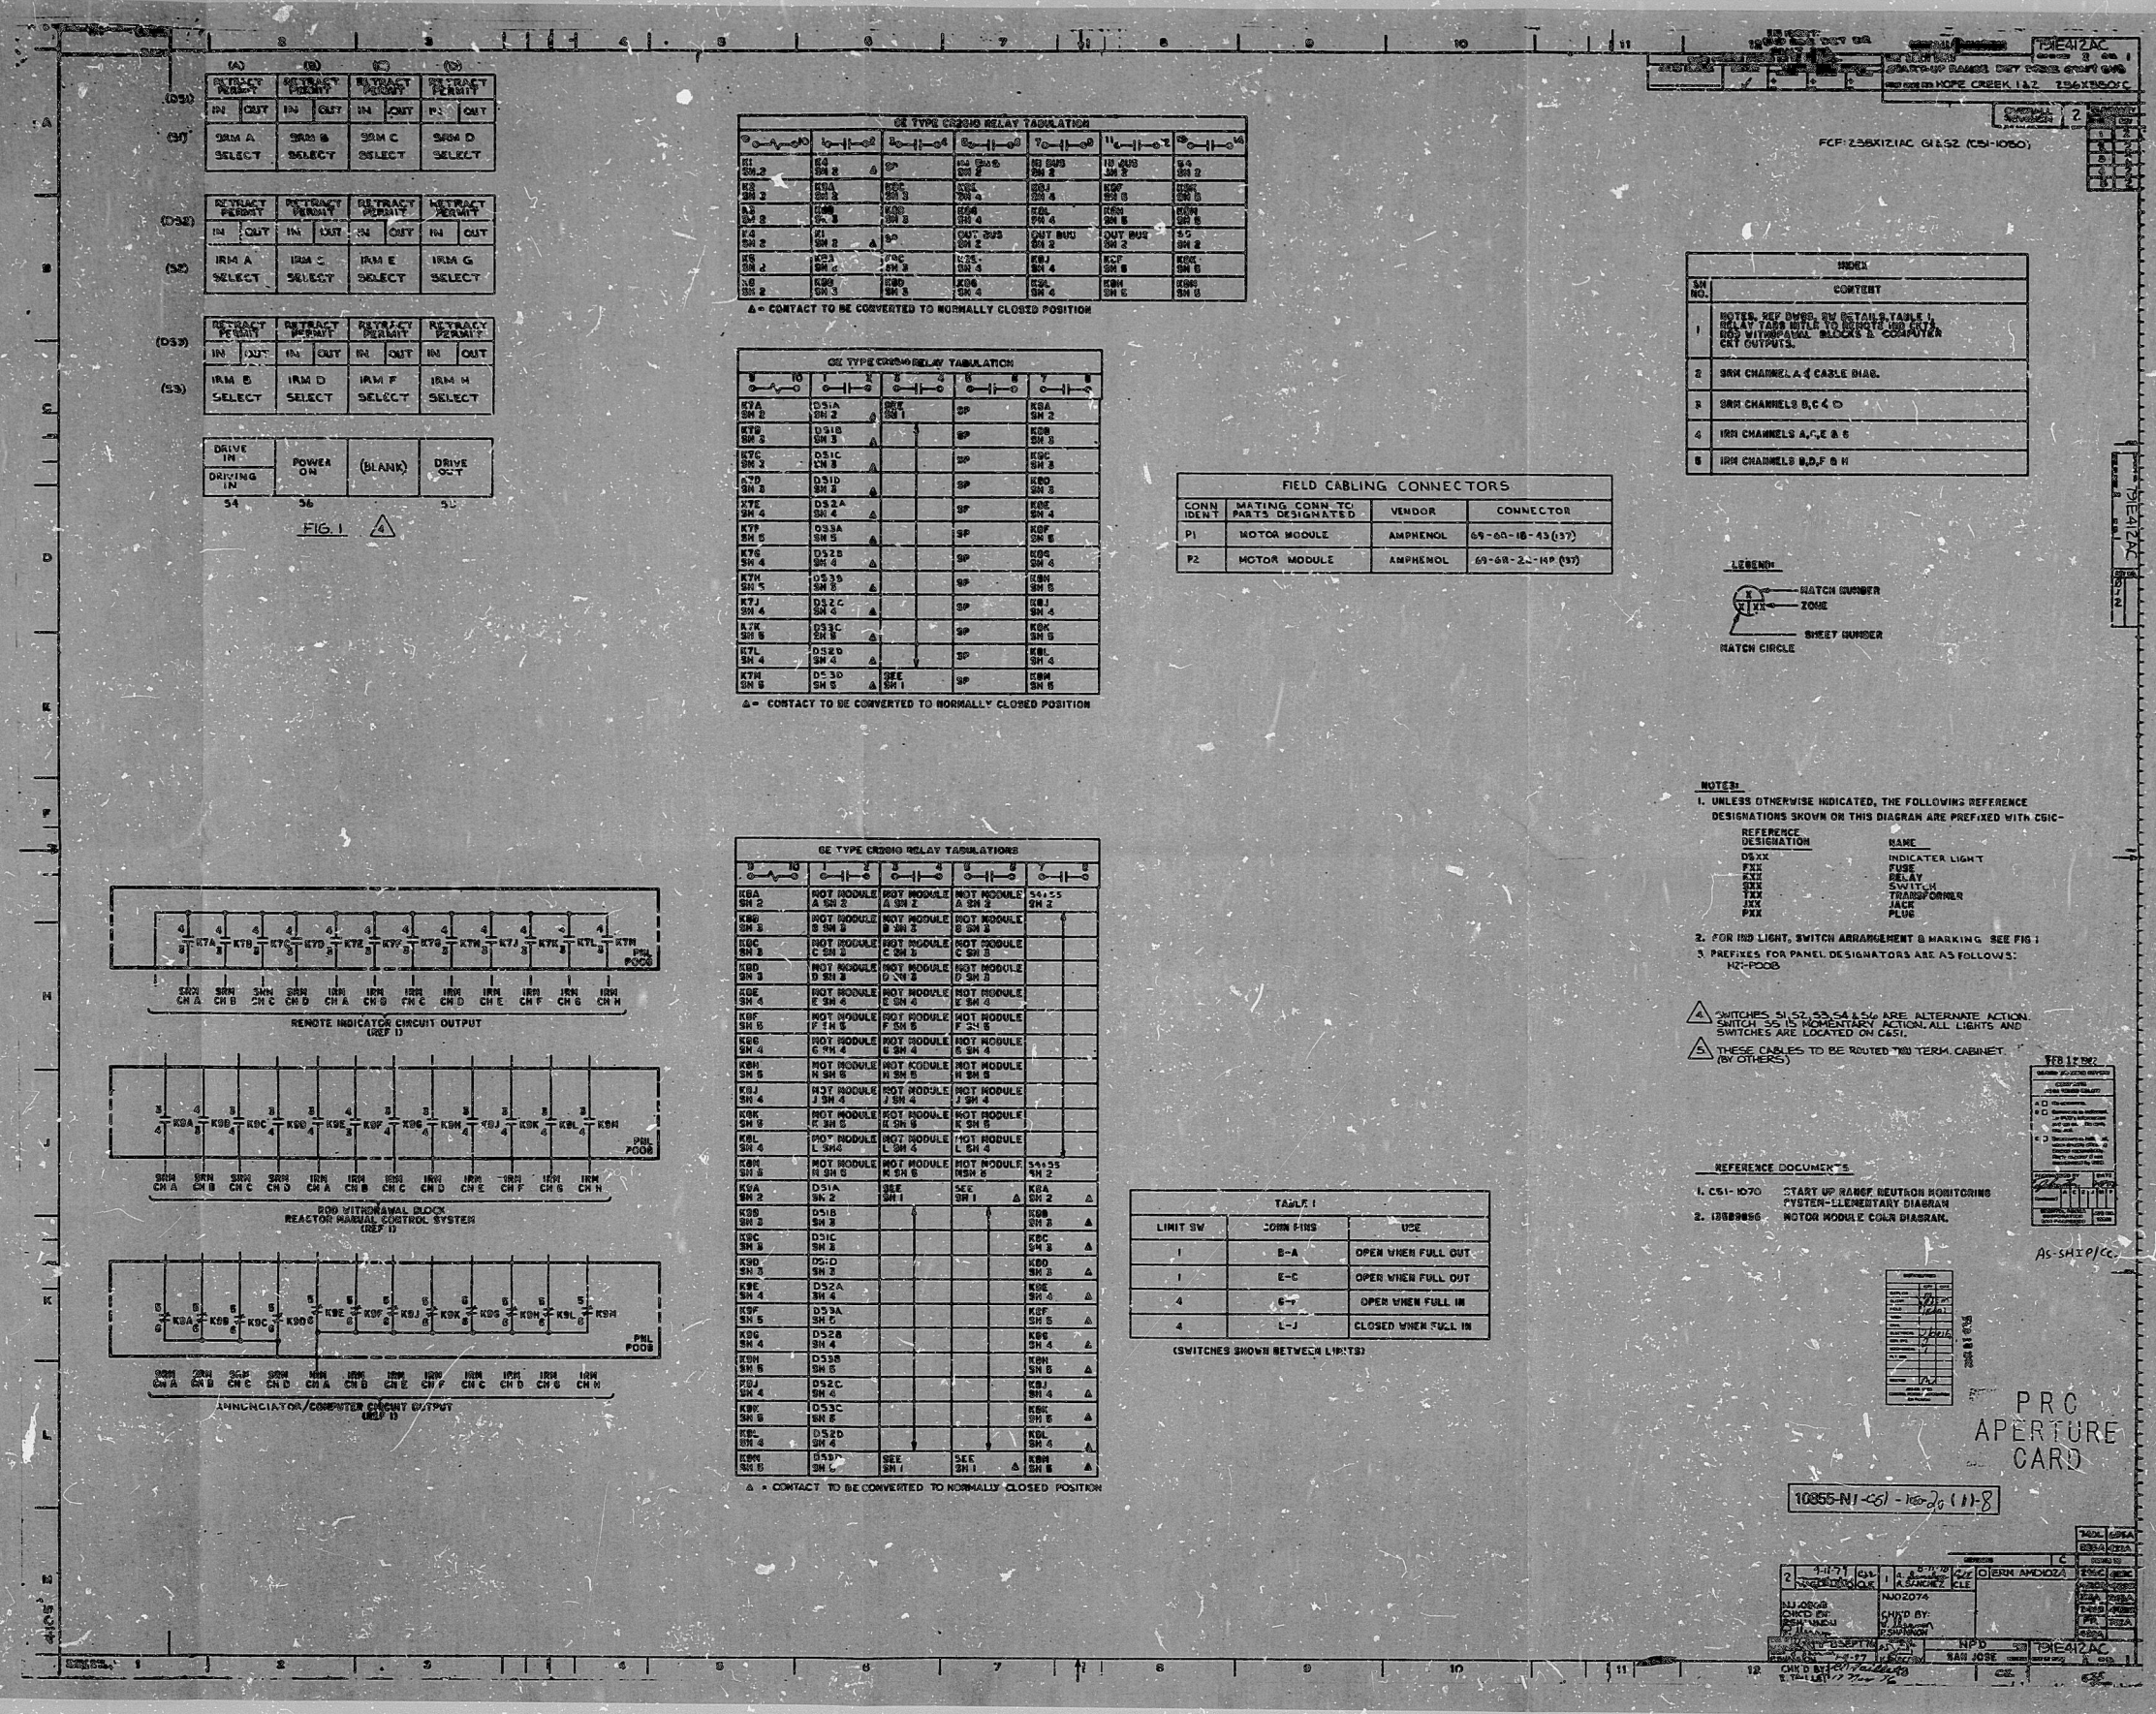

(A)		(B)		(C)		(D)	
RETRACT PERMIT	IN	RETRACT PERMIT	IN	RETRACT PERMIT	IN	RETRACT PERMIT	IN
SELECT	OUT	SELECT	OUT	SELECT	OUT	SELECT	OUT
IRM A		IRM B		IRM C		IRM D	
SELECT		SELECT		SELECT		SELECT	

GE TYPE CR200 RELAY TABULATION											
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12

GE TYPE CR200 RELAY TABULATION											
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12
RM 1	RM 2	RM 3	RM 4	RM 5	RM 6	RM 7	RM 8	RM 9	RM 10	RM 11	RM 12

FIELD CABLEING CONNECTORS			
CONN IDENT	MATING CONN TO PARTS DESIGNATED	VENDOR	CONNECTOR
P1	MOTOR MODULE	AMPHENOL	69-68-1B-43 (37)
P2	MOTOR MODULE	AMPHENOL	69-68-2A-14P (37)

INDEX	
NO.	CONTENT
1	NOTES, SEE DMS, CH 15, TABLE 1, RELAY TAPING TO REACTOR AND MOTOR CMT OUTPUTS.
2	IRM CHANNELS A, C, E & G
3	IRM CHANNELS B, C & D
4	IRM CHANNELS A, C, E & G
5	IRM CHANNELS B, C, F & H


LEGEND:
HATCH NUMBER
ZONE
SHEET NUMBER
HATCH CIRCLE

NOTES:
1. UNLESS OTHERWISE INDICATED, THE FOLLOWING REFERENCE DESIGNATIONS SHOWN ON THIS DIAGRAM ARE PREFIXED WITH CHIC-
REFERENCE DESIGNATION NAME
DSXX INDICATOR LIGHT
FXX FUSE
SXX SWITCH
TXX TRANSFORMER
PXX PLATE
2. FOR IND LIGHT, SWITCH ARRANGEMENT & MARKING, SEE FIG. 1
3. PREFIXES FOR PANEL DESIGNATORS ARE AS FOLLOWS:
H2-PODS

REFERENCE DOCUMENTS:
1. C61-1070 START UP RAMP, NEUTRON MONITORING SYSTEM-ELEMENTARY DIAGRAM
2. 10089866 MOTOR MODULE CABLE DIAGRAM

TABLE 1		
LIMIT SW	COIN FINS	USE
1	B-A	OPEN WHEN FULL OUT
1	E-C	OPEN WHEN FULL IN
4	L-J	CLOSED WHEN FULL IN

(SWITCHES SHOWN BETWEEN LIMITS)



PRC APERTURE CARD

10855-N1-451-10-20 (1)-8

REVISIONS	
NO.	DESCRIPTION
1	INITIAL DESIGN
2	REVISION
3	REVISION
4	REVISION
5	REVISION
6	REVISION
7	REVISION
8	REVISION
9	REVISION
10	REVISION
11	REVISION
12	REVISION
13	REVISION
14	REVISION
15	REVISION
16	REVISION
17	REVISION
18	REVISION
19	REVISION
20	REVISION
21	REVISION
22	REVISION
23	REVISION
24	REVISION
25	REVISION
26	REVISION
27	REVISION
28	REVISION
29	REVISION
30	REVISION
31	REVISION
32	REVISION
33	REVISION
34	REVISION
35	REVISION
36	REVISION
37	REVISION
38	REVISION
39	REVISION
40	REVISION
41	REVISION
42	REVISION
43	REVISION
44	REVISION
45	REVISION
46	REVISION
47	REVISION
48	REVISION
49	REVISION
50	REVISION
51	REVISION
52	REVISION
53	REVISION
54	REVISION
55	REVISION
56	REVISION
57	REVISION
58	REVISION
59	REVISION
60	REVISION
61	REVISION
62	REVISION
63	REVISION
64	REVISION
65	REVISION
66	REVISION
67	REVISION
68	REVISION
69	REVISION
70	REVISION
71	REVISION
72	REVISION
73	REVISION
74	REVISION
75	REVISION
76	REVISION
77	REVISION
78	REVISION
79	REVISION
80	REVISION
81	REVISION
82	REVISION
83	REVISION
84	REVISION
85	REVISION
86	REVISION
87	REVISION
88	REVISION
89	REVISION
90	REVISION
91	REVISION
92	REVISION
93	REVISION
94	REVISION
95	REVISION
96	REVISION
97	REVISION
98	REVISION
99	REVISION
100	REVISION

RIDS

8308010196

