


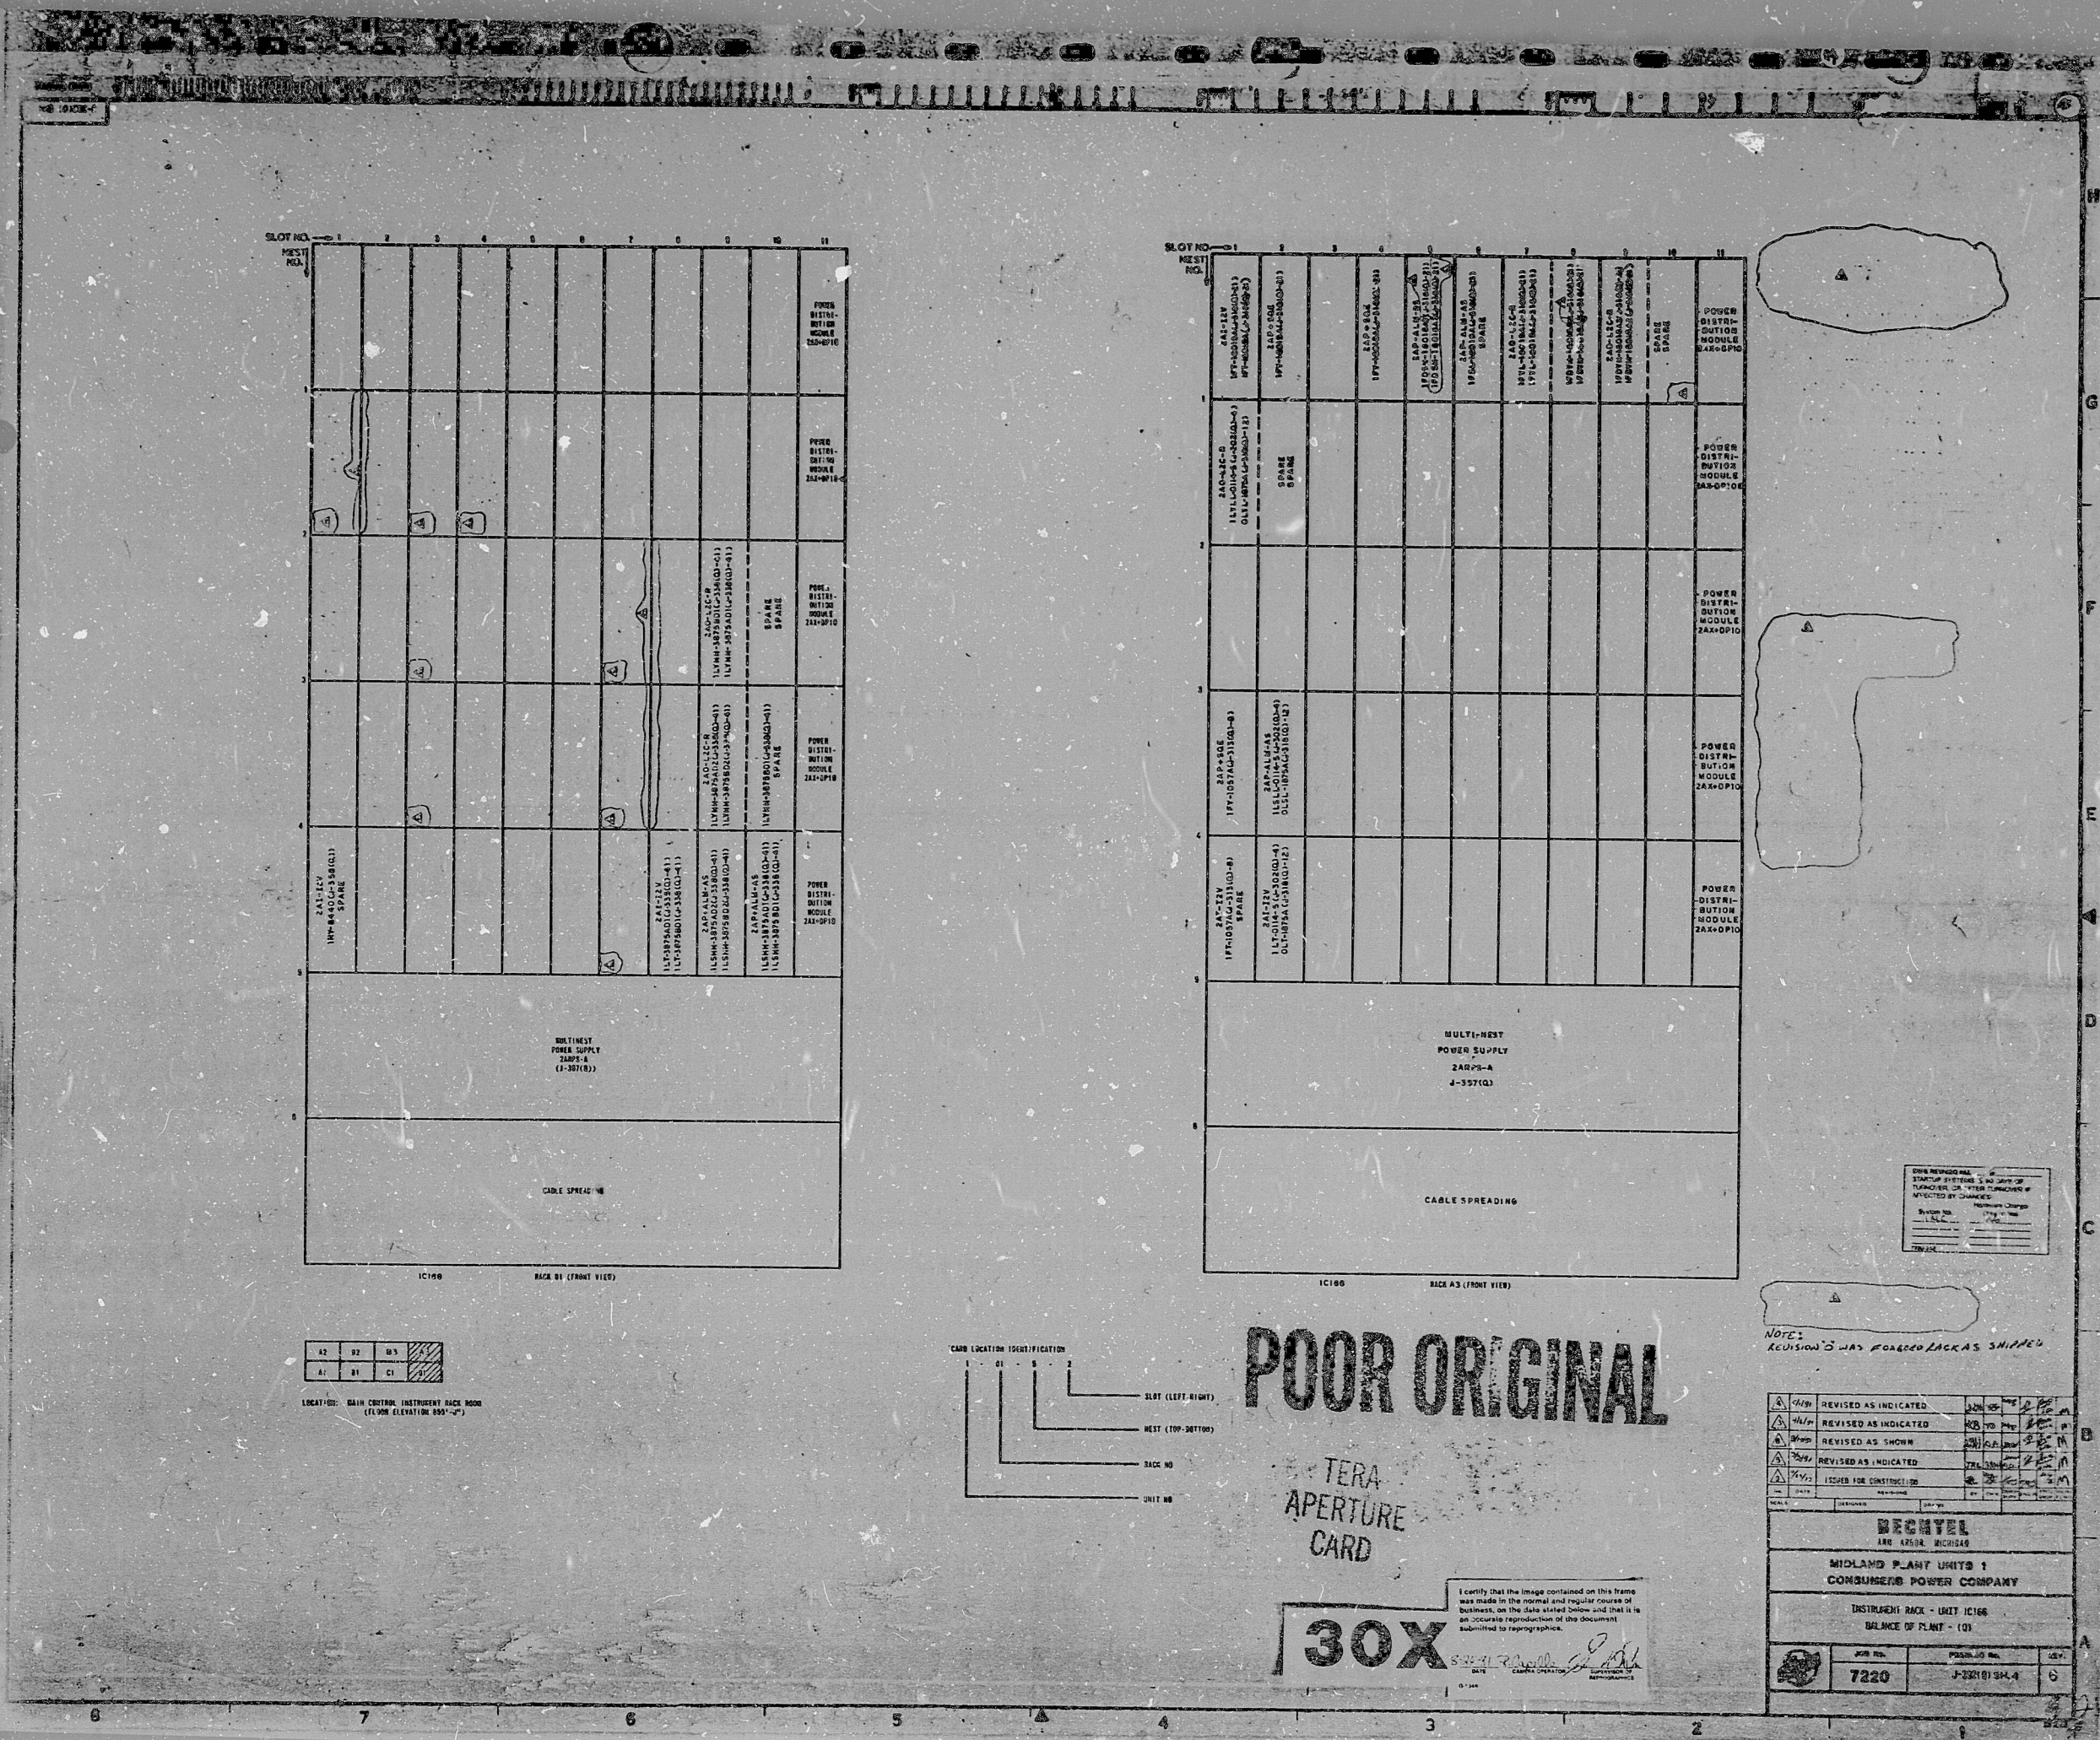

POOR ORIGINAL

TERA APERTURE CARD

30X

REVISION	REVISION	REVISION	REVISION	REVISION	REVISION
1	2	3	4	5	6
1	2	3	4	5	6
1	2	3	4	5	6
1	2	3	4	5	6
1	2	3	4	5	6

RECHTEL
ARG. APDR. MICHAEL

MIDLAND PLANT UNIT 1
CONSUMER POWER COMPANY

INSTRUMENT RACK - UNIT 106
BALANCE OF PLANT - (C)

7220
J-2201(1) 34-4
6

RIDS

820110356

