


FOR OFFICE AND
ENGINEERING USE ONLY

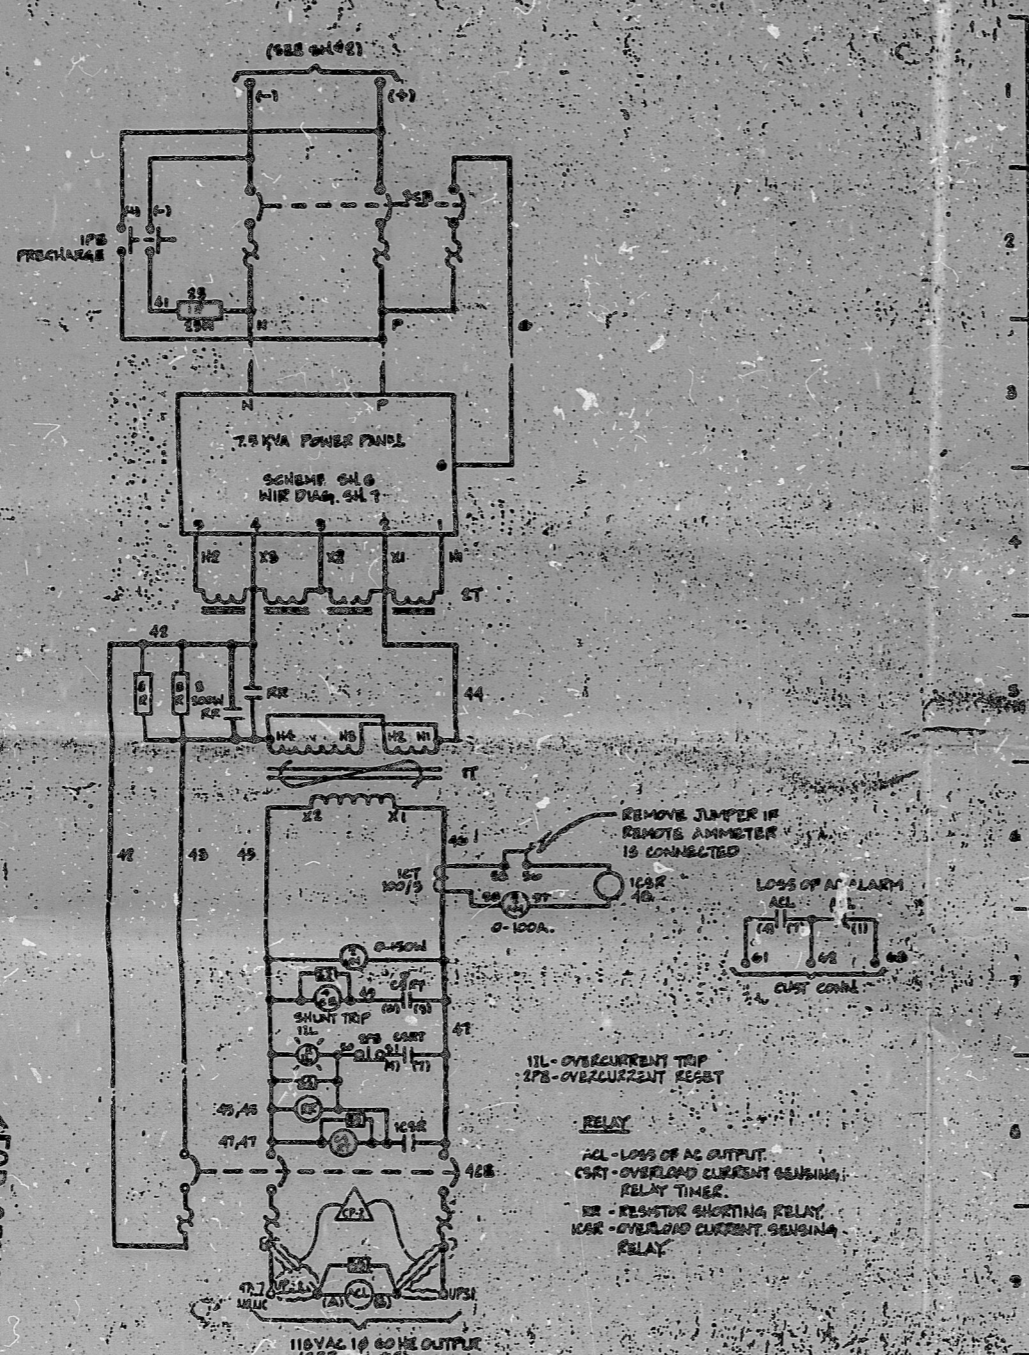

WESTINGHOUSE ELECTRIC CORPORATION
 7.5 kVA 115 VAC 10 60 HZ
 FIXED-FREQUENCY INVERTER

SI
 APERTURE
 CARD

TYP. FOR: TXU-848LIV-01
 TXU-848LIV-02
 TXU-848LIV-03
 TXU-848LIV-04

TEXAS UTILITIES SERVICES, INC.
 PLANT: DONAHUE PEAK STEAM ELECTRIC STATION
 UNIT: 1 AND 2
 STATE: TEXAS
 CERTIFICATION NUMBER: 87-100
 AUTHORITY: G. C. WAGMANN
 DATE: 1/18/67

REV	DATE	BY	CHKD	APP'D	DESCRIPTION
1	1/18/67				INCORPORATED TECH. ALT.

CLASS I
 (NUCLEAR SAFETY-RELATED)
 SAFETY CLASS I SEISMIC CATEGORY 2
 SAFETY CLASS 2 CATEGORY 1
 SAFETY CLASS 2 ASSOCIATED EQUIPMENT

**TEXAS UTILITIES
 GENERATING CO.**
 CLEVELAND, TEXAS

7.5 kVA 115 VAC 10 60 HZ
 FIXED-FREQUENCY INVERTOR

4950667 4

4950667

4 CP-2

8706120239 LONDON Ex. 7

PDR / DF

8906120239

