

04

06

08


10

09

11

17

22

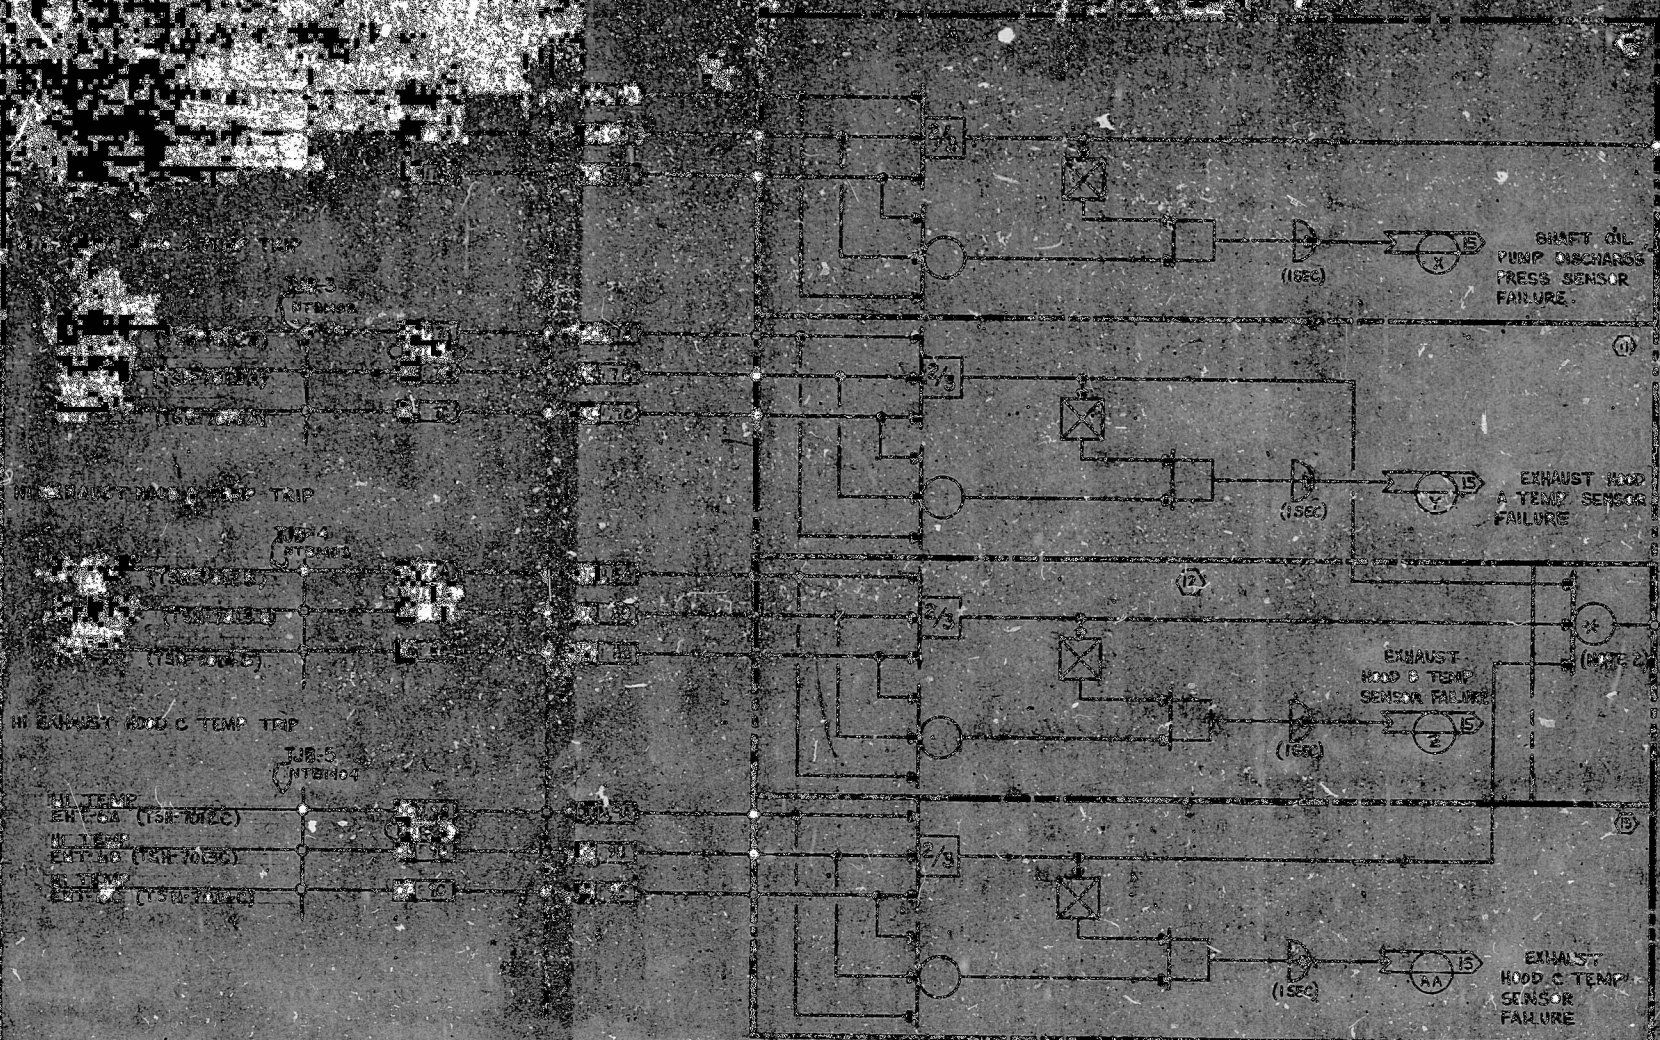

TURBINE 2/3 TRIPS CONTINUED

INDUSTRIAL HOLDING CO.

- 1. THE POWER SUPPLY FOR WIRE 'P' IS PROVIDED BY A COMMON SOURCE OF 125 VDC POWER IN THE ECU CABINET.
- 2. THIS RATE IS TO BE IMPLEMENTED BY PARALLEL WIRING CONTACTS OF DRIVERS OF CIRCUITS 11, 12 AND 13.
- 3. DELETED
- 4. DELETED
- 5. USE OF 'P' SHALL BE LIMITED TO A SINGLE CIRCUIT IN THE ECU CABINET.

INDUSTRIAL HOLDING CO.

PRO APERTURE CARD

POOR ORIGINAL

NAME	DATE
APERTURE	11/11/11
DATE	11/11/11
DATE	11/11/11
DATE	11/11/11

11/11/11

11/11/11

04

06

08

10

09

11

17

22

RIDS

8308050417

