


J-0100-0 SHT 13

ANN. LC C690

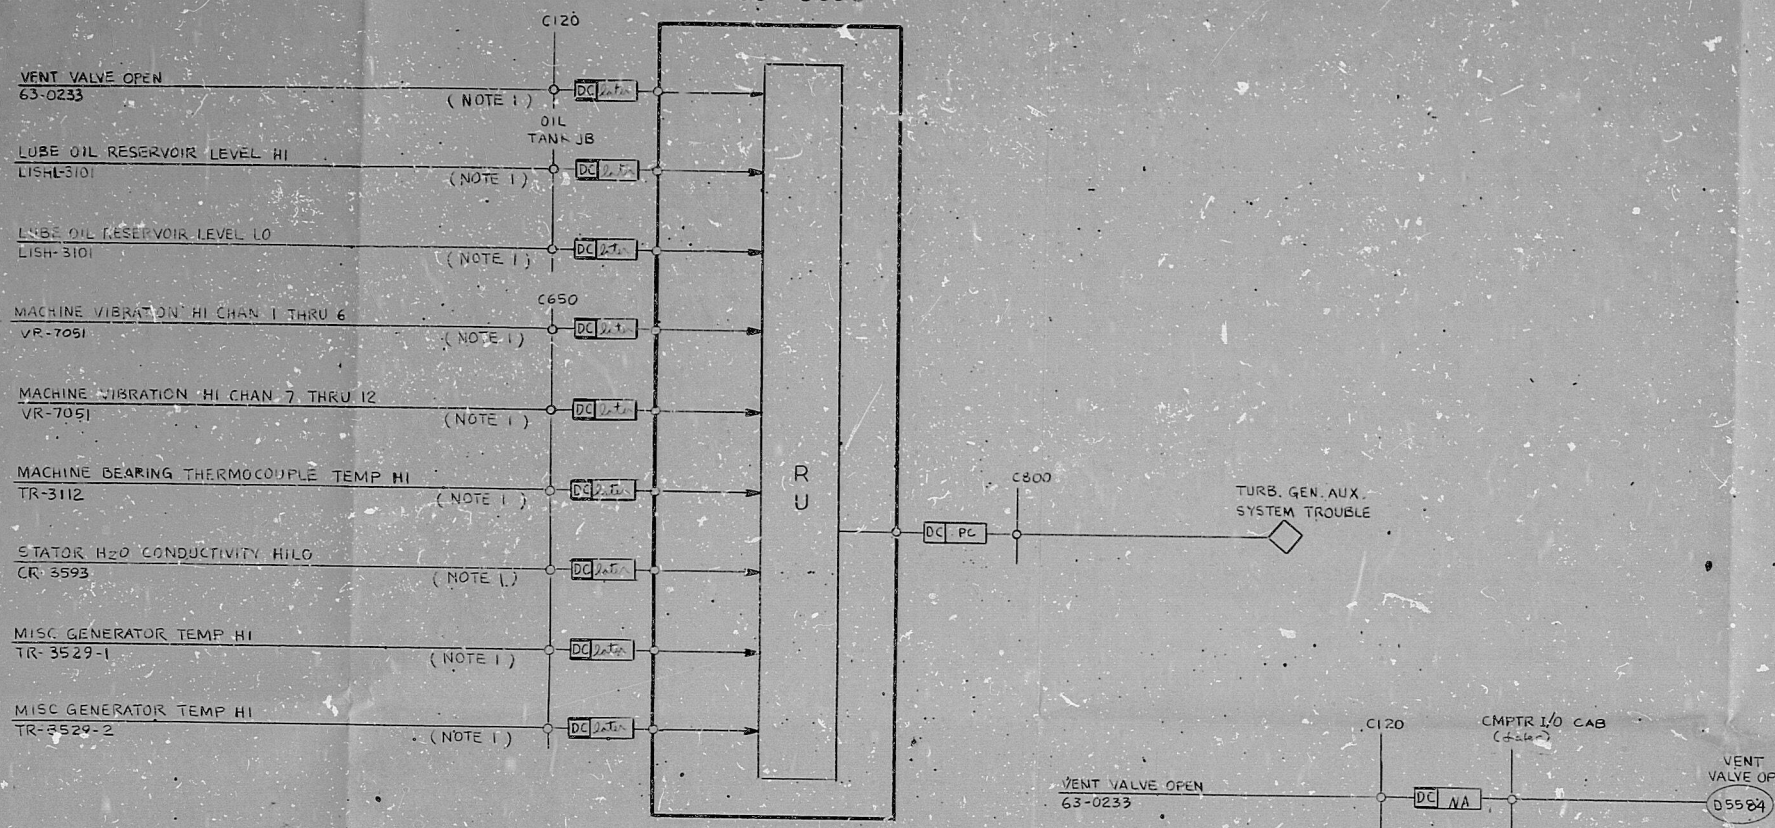

NOTES:

1. CONTACTS OPEN UPON CONDITION STATED.

DESCRIPTION	PANEL NO.	WIRE NO.	I/O CAB	CMPTD NO.
VENT VALVE OPEN 63-0233	C120	NA	(later)	D5584
LUBE OIL RESERVOIR LEVEL HI LISHL-310	OTJB			D5585
LUBE OIL RESERVOIR LEVEL LO LISHL-310	OTJB			D5586
MACHINE BEARING TC TEMP HI TR-3112	C650	NA	(later)	D5589
STATOR WTR CONDUCTIVITY HI LO CR-3593				D5590
MISC. GENERATOR TEMP HI TR-3529-1				D5591
MISC. GENERATOR TEMP HI TR-3529-2				D5592

PROC
APERTURE
CARD

NO.	DATE	REVISIONS	BY	CHKD	DESIGN	ENGR	PROD	APPR
1	1/1/62	ISSUED FOR CONSTRUCTION & DESIGN FREEZE 15516						
SCALE: NONE DESIGNED: T. PHUNG DRAWN: EAT BECHTEL SAN FRANCISCO PUBLIC SERVICE ELECTRIC AND GAS COMPANY HOPE CREEK GENERATING STATION LOGIC DIAGRAM MISC. TURBINE AUXILIARIES TURB. GEN. AUX. SYSTEM TROUBLE JOB NO. 10855 DRAWING NO. J-0100-0 SHT 13 REV. 0								

22 x 34 1/2" SIZE

RIDS

8308050429

