
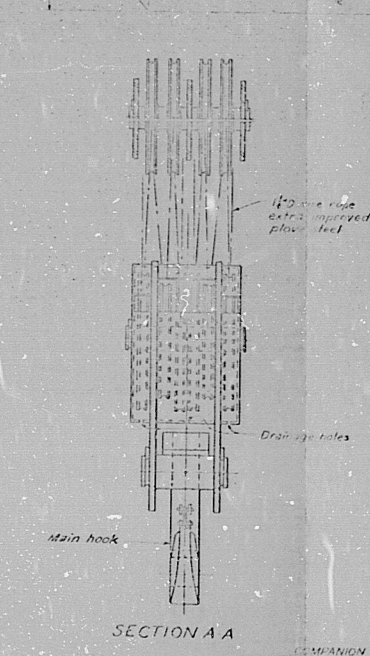
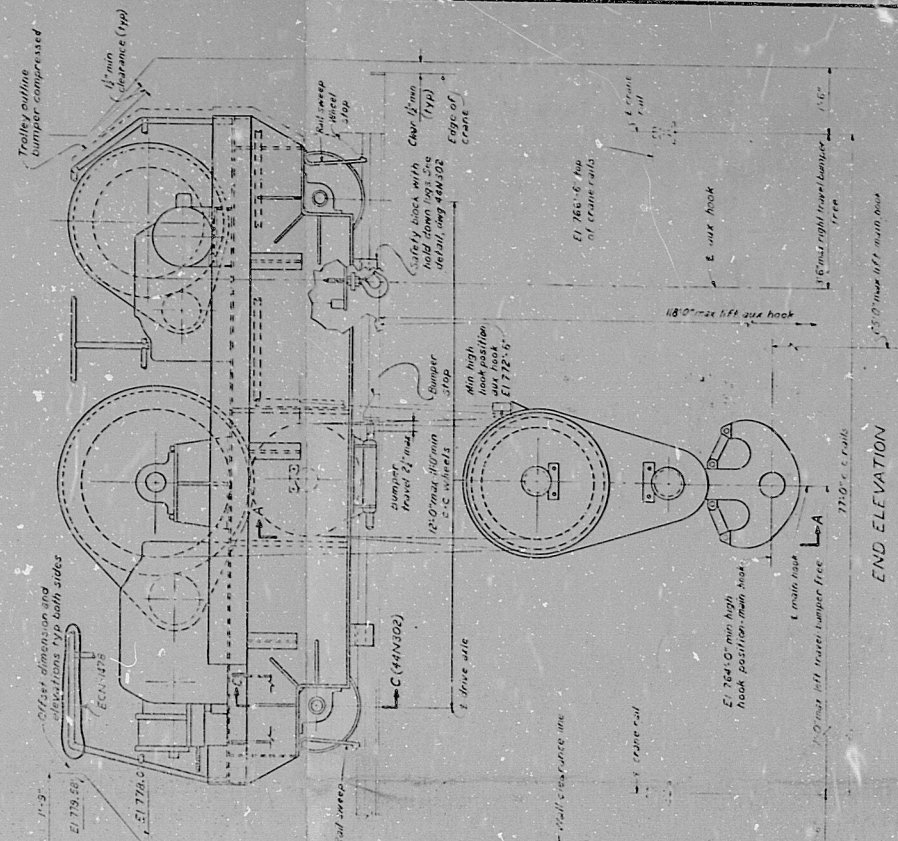
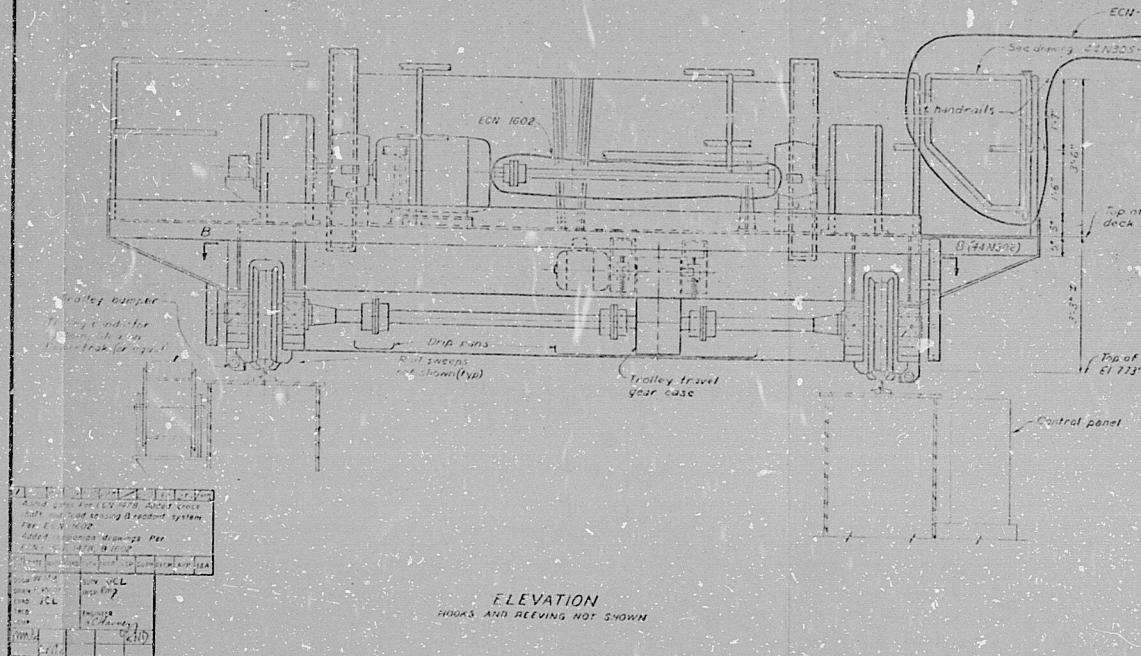


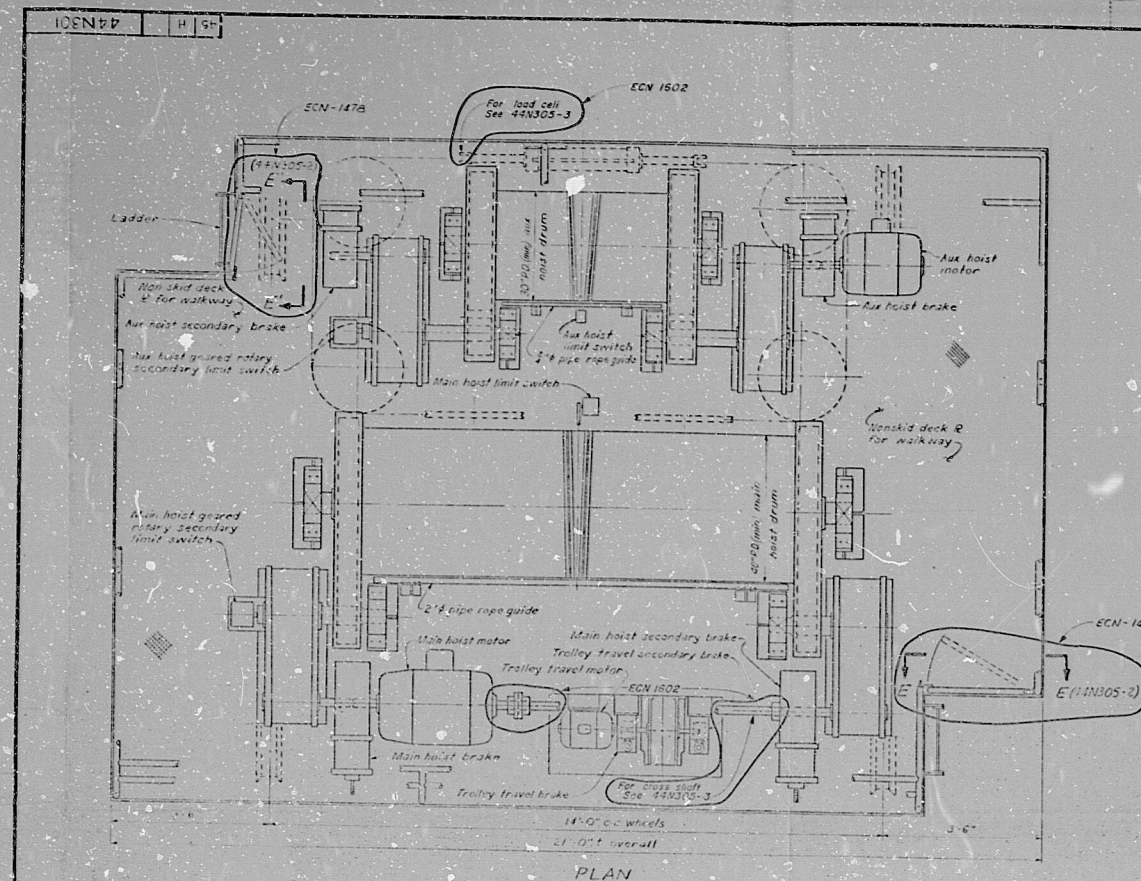

POOR ORIGINAL

- NOTES:
1. MAIN HOIST REEVEING, 12 PARTS OF 1-1/4" WIRE ROPES, EXTRA IMPROVED PLOW STEEL, SEE SPECIFICATIONS.
 2. AUXILIARY HOIST REEVEING, DIRECT LIFT WITH STEEL, 7/8" WIRE ROPES, EXTRA IMPROVED PLOW STEEL, SEE SPECIFICATIONS.
 3. FOR LIFTING ALL TYPES OF LOADS AND TENDERS, BELLOWS, CONTRACTOR SHALL FURNISH COPPER TUBING OR PIPING FROM EXISTING, SHUT, OR BURNING, PIPED TO THE CRANE, BELLOWS, BLOCKS WITH HIGH-PRESSURE FITTINGS LOCATED AT ACCESSIBLE POINTS ABOVE DECK.
 4. FOR DRIP PAN, SEE SPECIFICATIONS.
 5. FOR GENERAL MAINTENANCE OF CRANE, SEE 444100.

APERTURE CARD

AUXILIARY BUILDING UNITS 1 & 2	
125-TON CRANE TROLLEY ARRANGEMENT	
SEQUOYAH NUCLEAR PLANT TENNESSEE VALLEY AUTHORITY DIVISION OF ENGINEERING DESIGN	
SUBMITTED ECN 1478 100 4,300-0	RECOMMENDED J.B. Williams S. Kline KNOXVILLE 3-17-71 410 301 41
THIS DRAWING IS UNDER CONFIGURATION CONTROL	

8203040515

PHOTOGRAPHED
IN KNOXVILLE

30V

RIDS

8203040515

