


22"
17"
11"
8.5"
8.5"
11"
17"
22"

22"
17"
11"
8.5"
8.5"
11"
17"
22"

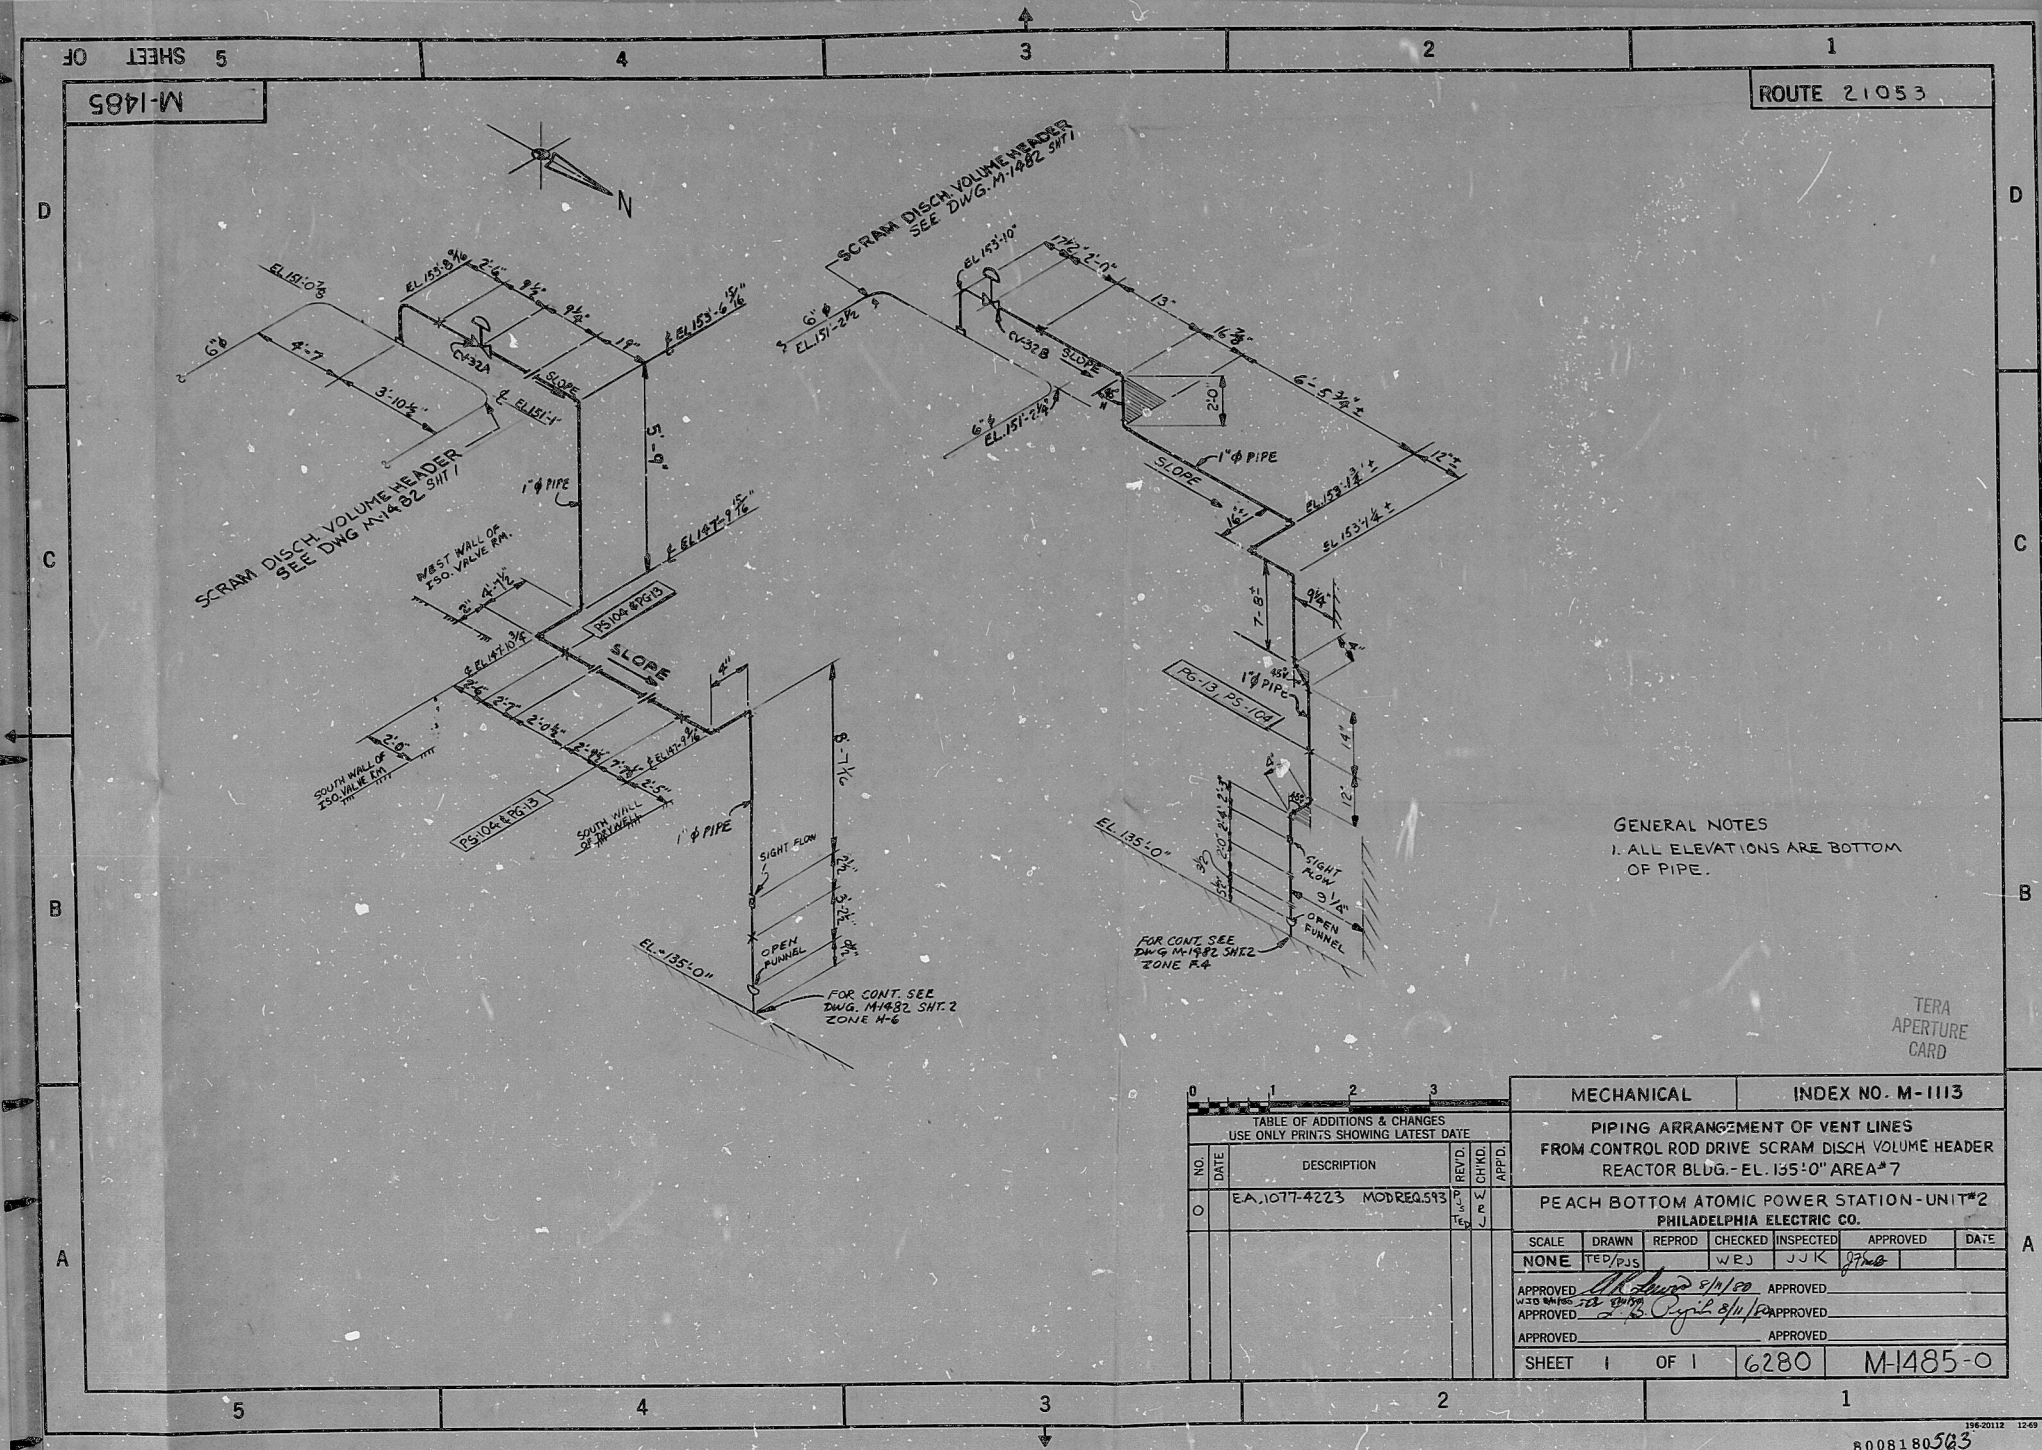

GENERAL NOTES
1. ALL ELEVATIONS ARE BOTTOM OF PIPE.

TABLE OF ADDITIONS & CHANGES USE ONLY PRINTS SHOWING LATEST DATE					
NO.	DATE	DESCRIPTION	REV'D BY	CHK'D BY	APP'D BY
0	EA. 1077-4223	MODREQ. 513			

MECHANICAL		INDEX NO. M-1113	
PIPING ARRANGEMENT OF VENT LINES FROM CONTROL ROD DRIVE SCRAM DISCH VOLUME HEADER REACTOR BLDG. - EL. 135'-0" AREA*7			
PEACH BOTTOM ATOMIC POWER STATION - UNIT #2 PHILADELPHIA ELECTRIC CO.			
SCALE	DRAWN	REPROD	CHECKED
NONE	TED/pjs	WBJ	JJK
APPROVED	APPROVED	APPROVED	APPROVED
APPROVED	APPROVED	APPROVED	APPROVED
APPROVED	APPROVED	APPROVED	APPROVED
SHEET 1	OF 1	6280	M-1485-0

8008180523

CF.

8008180563

46

