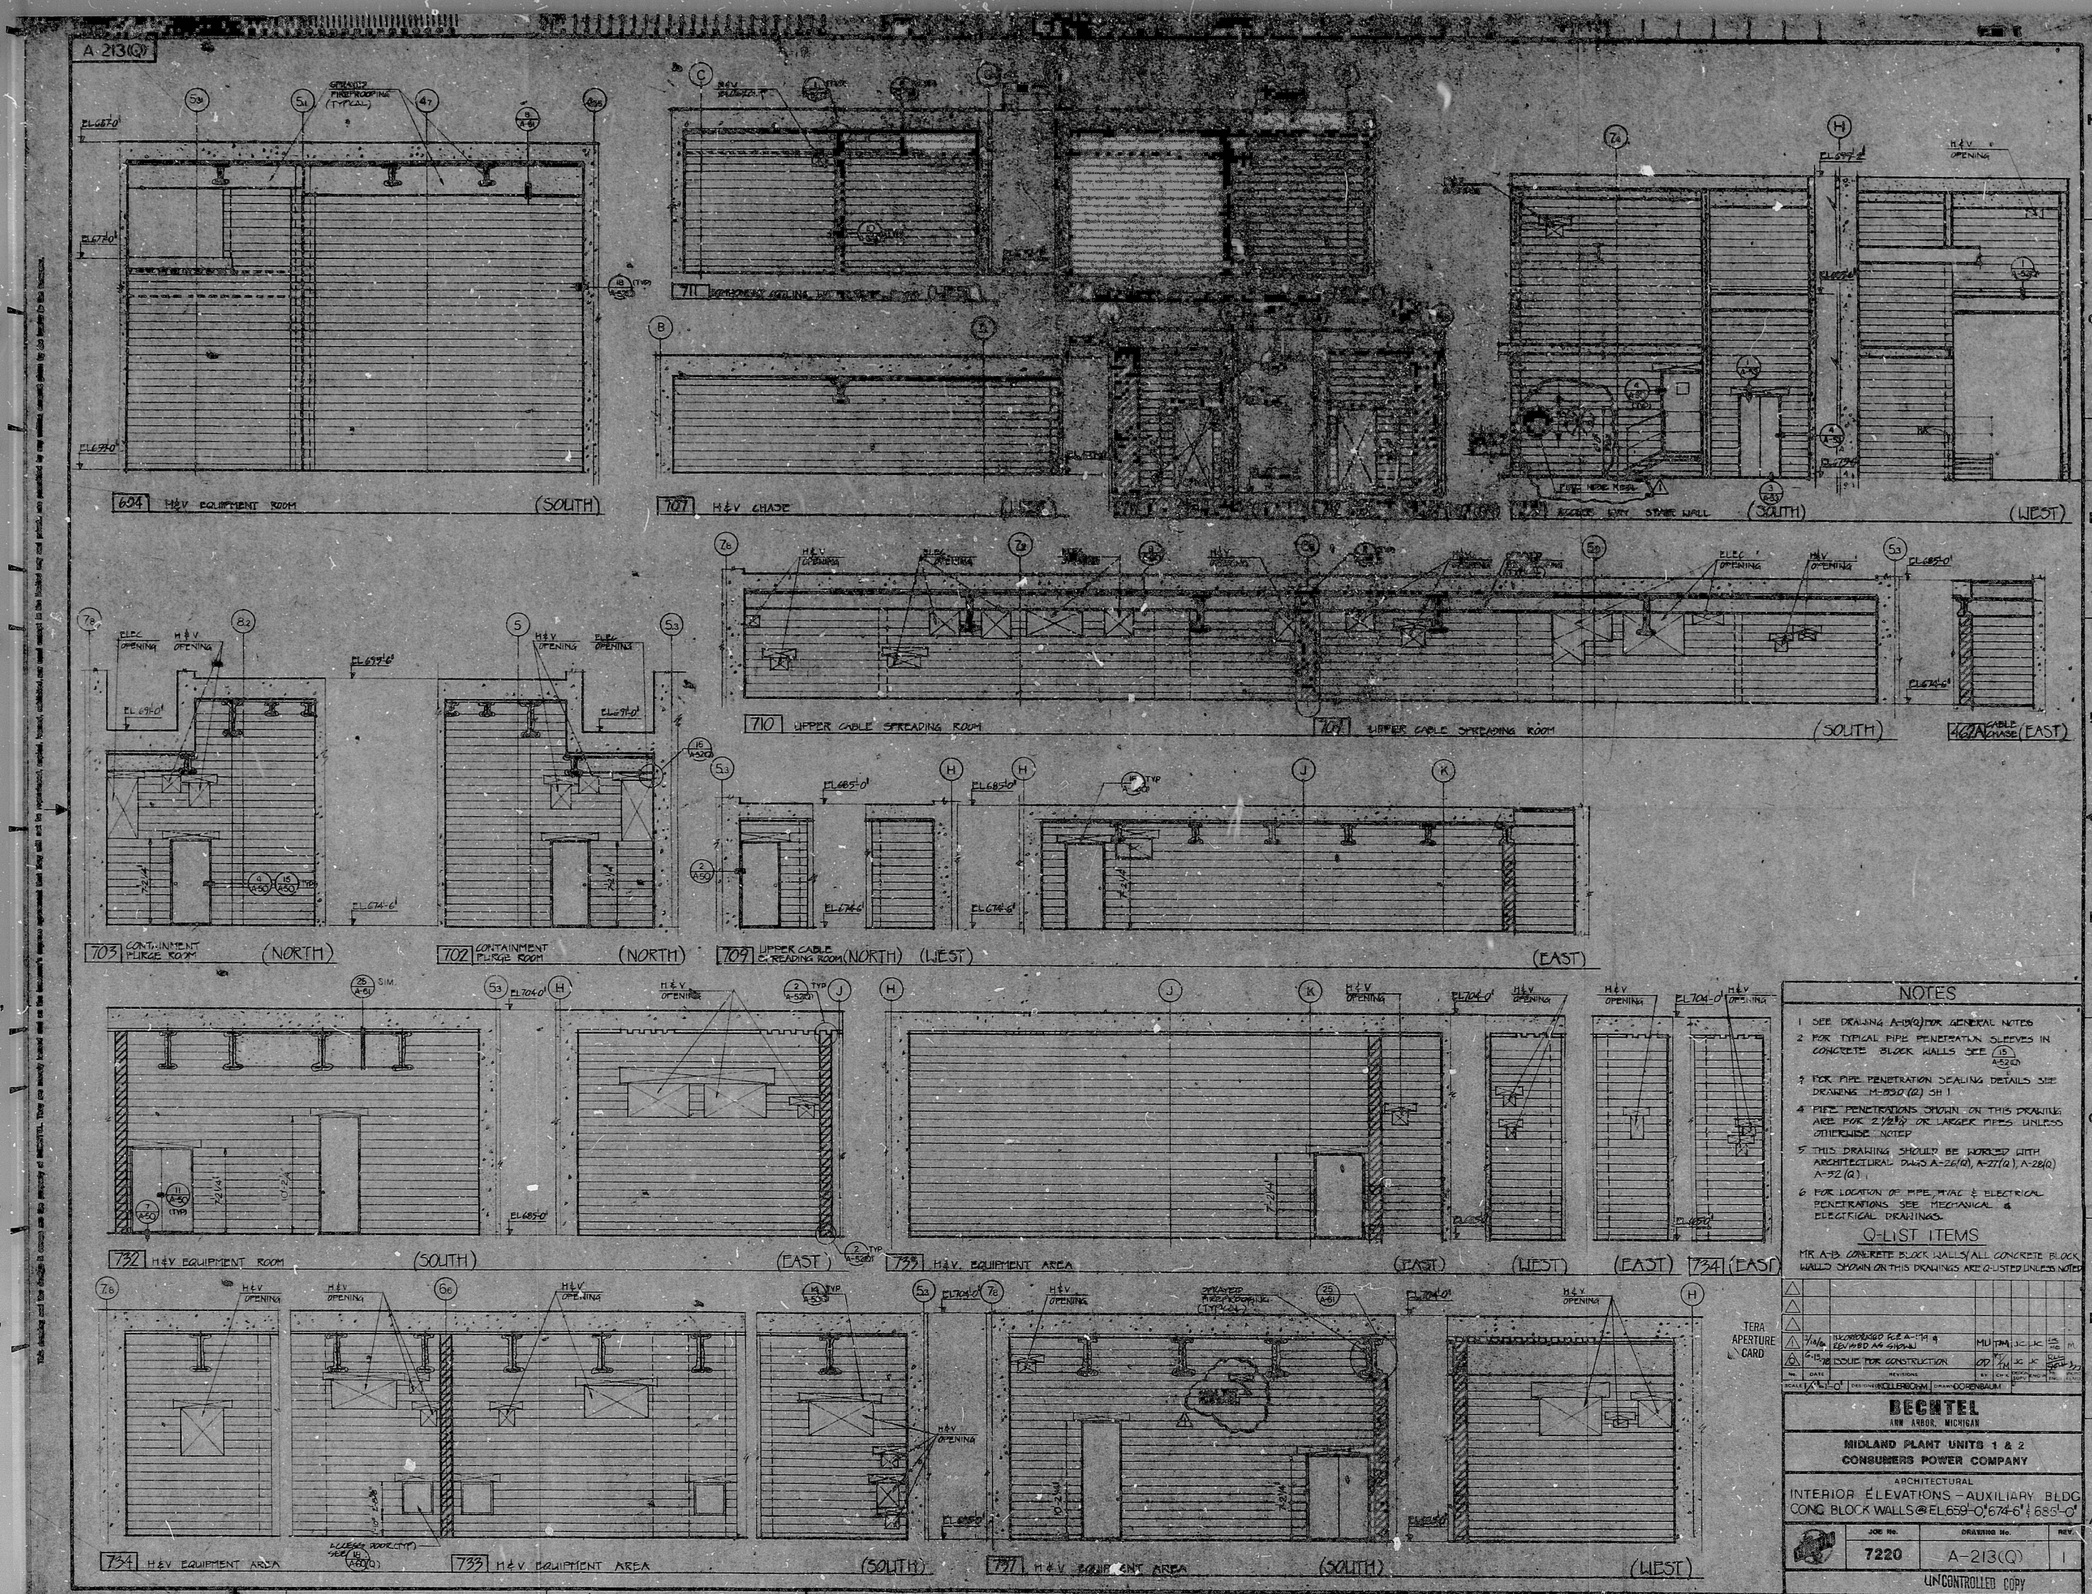

NOTES

1. SEE DRAWING A-13(Q) FOR GENERAL NOTES
2. FOR TYPICAL PIPE PENETRATION SLEEVES IN CONCRETE BLOCK WALLS SEE 15/A-52(Q)
3. FOR PIPE PENETRATION SEALING DETAILS SEE DRAWING M-850(Q) SH 1
4. PIPE PENETRATIONS SHOWN ON THIS DRAWING ARE FOR 2 1/2"Ø OR LARGER PIPES UNLESS OTHERWISE NOTED
5. THIS DRAWING SHOULD BE WORKED WITH ARCHITECTURAL DWGS A-26(Q), A-27(Q), A-28(Q) A-52(Q).
6. FOR LOCATION OF PIPE, HVAC & ELECTRICAL PENETRATIONS SEE MECHANICAL & ELECTRICAL DRAWINGS.

Q-LIST ITEMS

MR A-13 CONCRETE BLOCK WALLS/ALL CONCRETE BLOCK WALLS SHOWN ON THIS DRAWINGS ARE Q-LISTED UNLESS NOTED

No.	DATE	REVISIONS	BY	CH'K	DESIGN	ENG'R	DRAWN	CHK'D
1	7/16/80	INCORPORATED FOR A-19 & REVISED AS SHOWN	MU	TJM	JC	JC		
0	6-13-78	ISSUE FOR CONSTRUCTION	OD	TJM	JC	JC		

SCALE 1/8"=1'-0" DESIGNED NOLLERBOHM DRAWN DORENBAUM

BECHTEL
ANN ARBOR, MICHIGAN

MIDLAND PLANT UNITS 1 & 2
CONSUMERS POWER COMPANY

ARCHITECTURAL
INTERIOR ELEVATIONS - AUXILIARY BLDG
CONC BLOCK WALLS @ EL 659'-0", 674'-6" & 685'-0"

JOB No.	DRAWING No.	REV.
7220	A-213(Q)	1

UNCONTROLLED COPY

8009230303

CF

8009230503

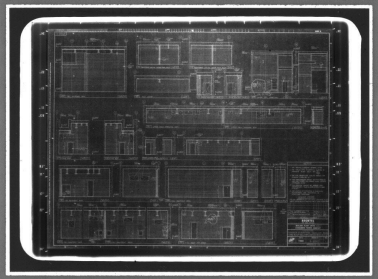

MMM 5824 — FILMSORT* Brand Aperture & Camera Cards and DUPLICARD* Brand Copy Cards — Product of 3M Company, St. Paul, Minn.