


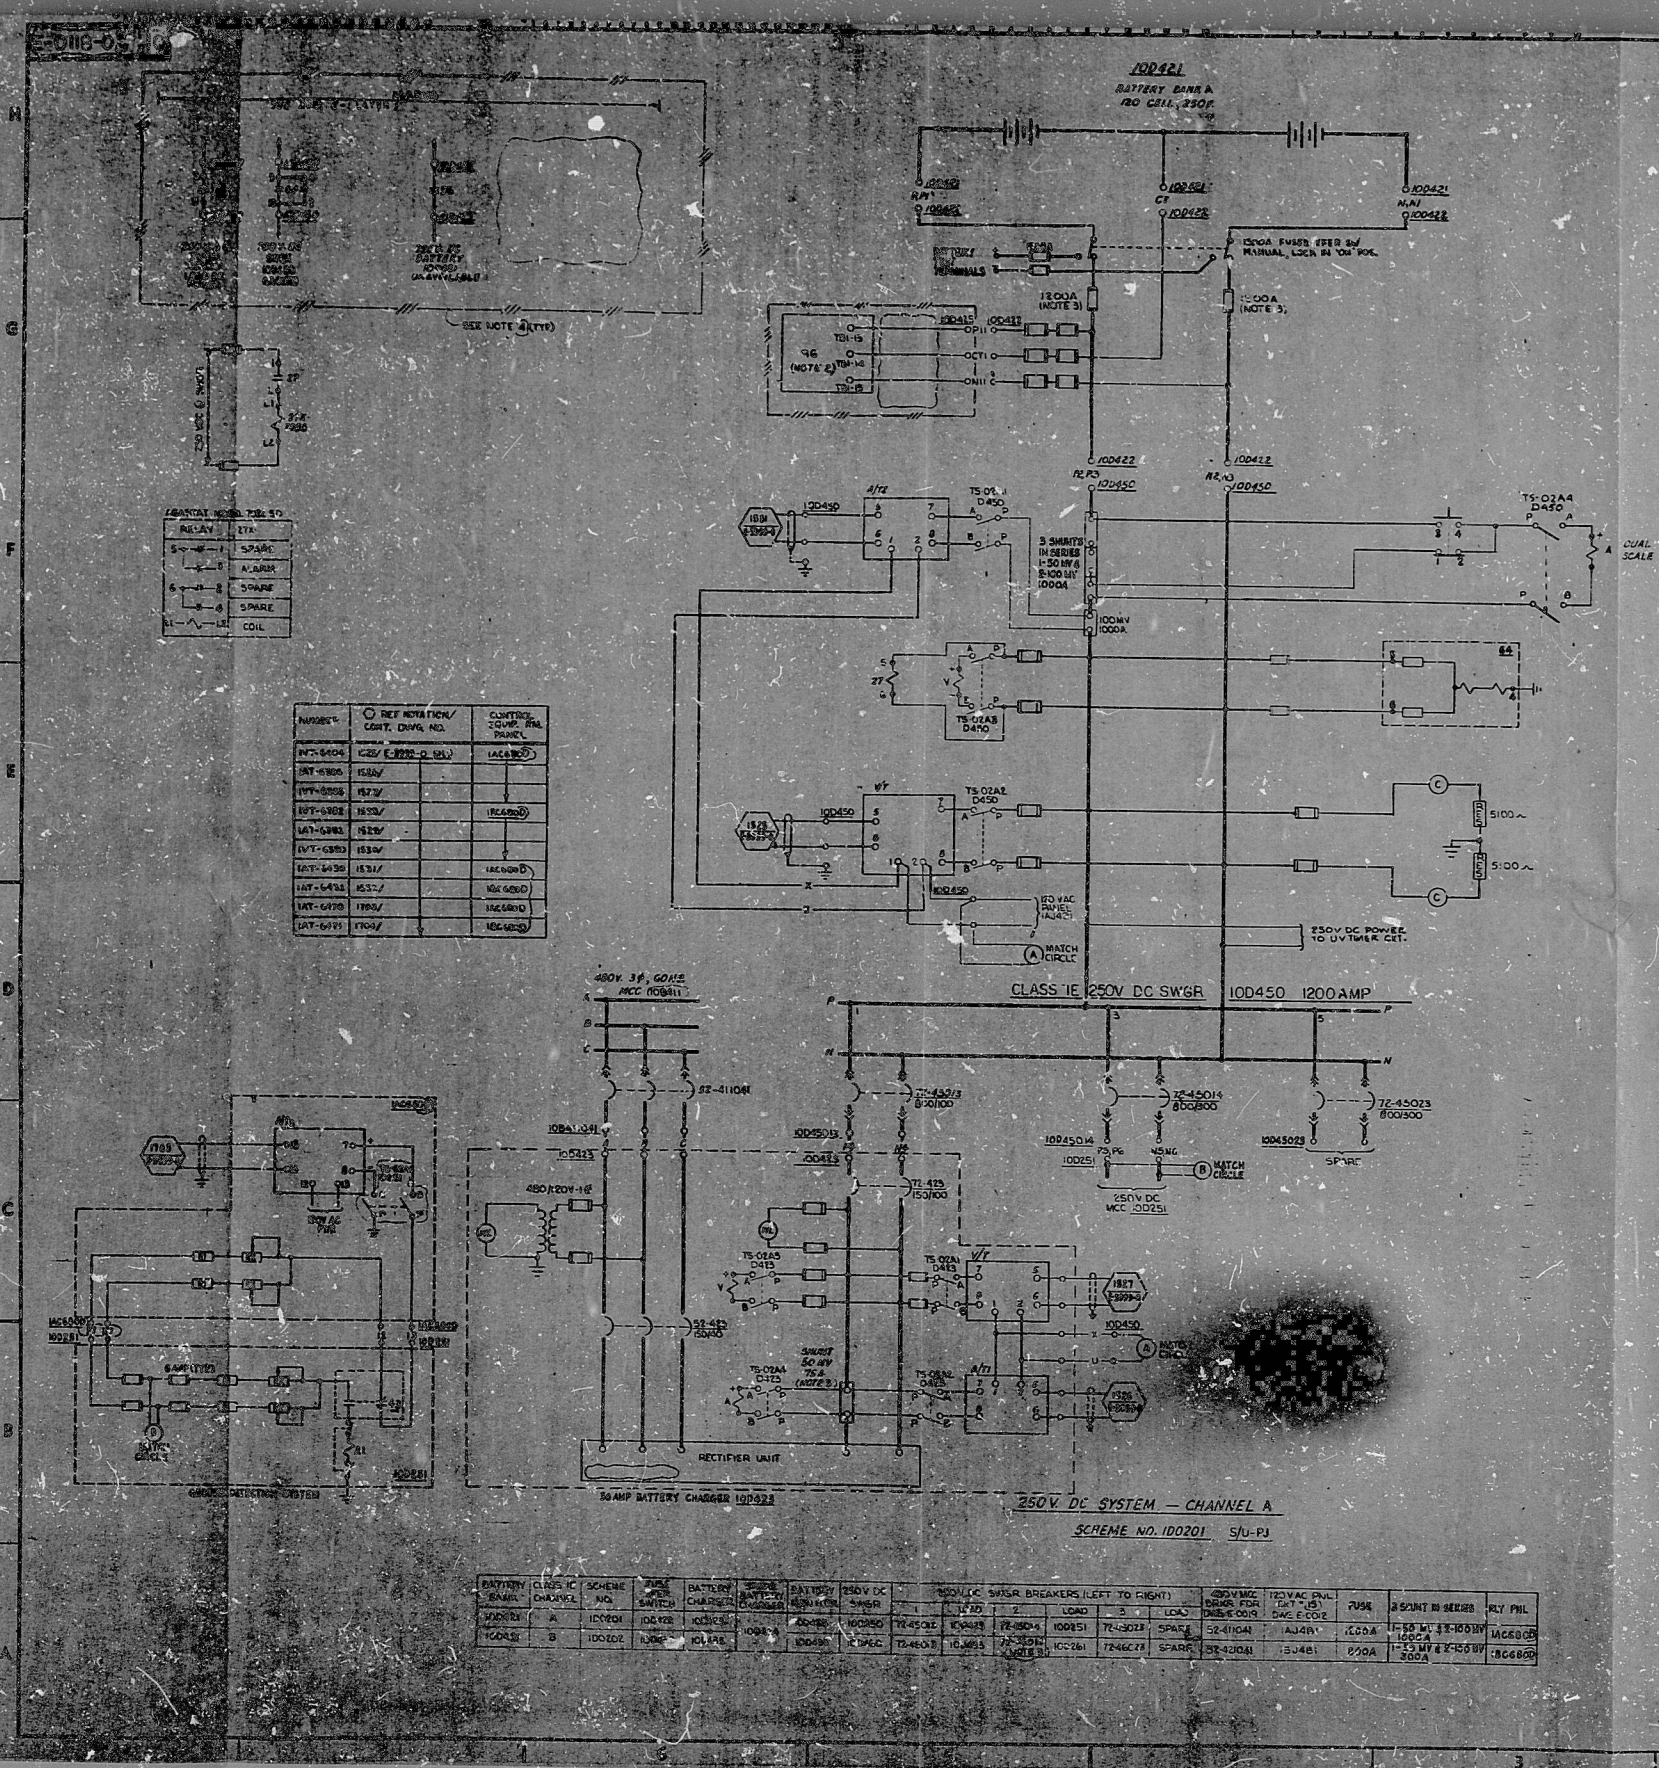

NO.	DESCRIPTION	QTY.	UNIT
1	100V 15A	1	RELAY
2	100V 15A	1	RELAY
3	100V 15A	1	RELAY
4	100V 15A	1	RELAY
5	100V 15A	1	RELAY
6	100V 15A	1	RELAY
7	100V 15A	1	RELAY
8	100V 15A	1	RELAY
9	100V 15A	1	RELAY
10	100V 15A	1	RELAY

- NOTES:
1. ALL FUSES ARE 5 AMPS UNLESS OTHERWISE NOTED.
 2. FOR 250V DC SINGLE LINE DIAGRAM WITH DEVICE TABLE SEE DWG E-0011-1 SHEET 1 & 2.
 3. CONSULT THE APPROPRIATE SINGLE LINE DIAGRAM FOR THE SPECIFIC VALUES, DESIGNATION, OR DEVICE TABLE.
- NON-CLASS I.E. EQUIPMENT WITHIN ENCLOSED BOUNDARY

PRO
APERTURE
CARD

- REFERENCES:
1. ELECTRICAL SINGLE LINE E-0011-1 SHEET 1, 2.
 2. CABLE QUICK E-0011-1 SHEET 1, 2.
 3. VENDOR DWG. 19855-1-1 (E-0011-1).
 4. TEST IN PLACE (C) BUCK DETAILS DWG. E-0011-1.

NO.	DESCRIPTION	QTY.	UNIT
1	100V 15A	1	RELAY
2	100V 15A	1	RELAY
3	100V 15A	1	RELAY
4	100V 15A	1	RELAY
5	100V 15A	1	RELAY
6	100V 15A	1	RELAY
7	100V 15A	1	RELAY
8	100V 15A	1	RELAY
9	100V 15A	1	RELAY
10	100V 15A	1	RELAY

BECHTEL
SAN FRANCISCO
PUBLIC SERVICE ELECTRIC AND GAS COMPANY
HOPE CREEK GENERATING STATION
SCHEMATIC METER & RELAY DIAGRAM
250 VOLT DC SYSTEM

10855 E-0118-0 OF 2 3 Q

RIDS

8308100083

