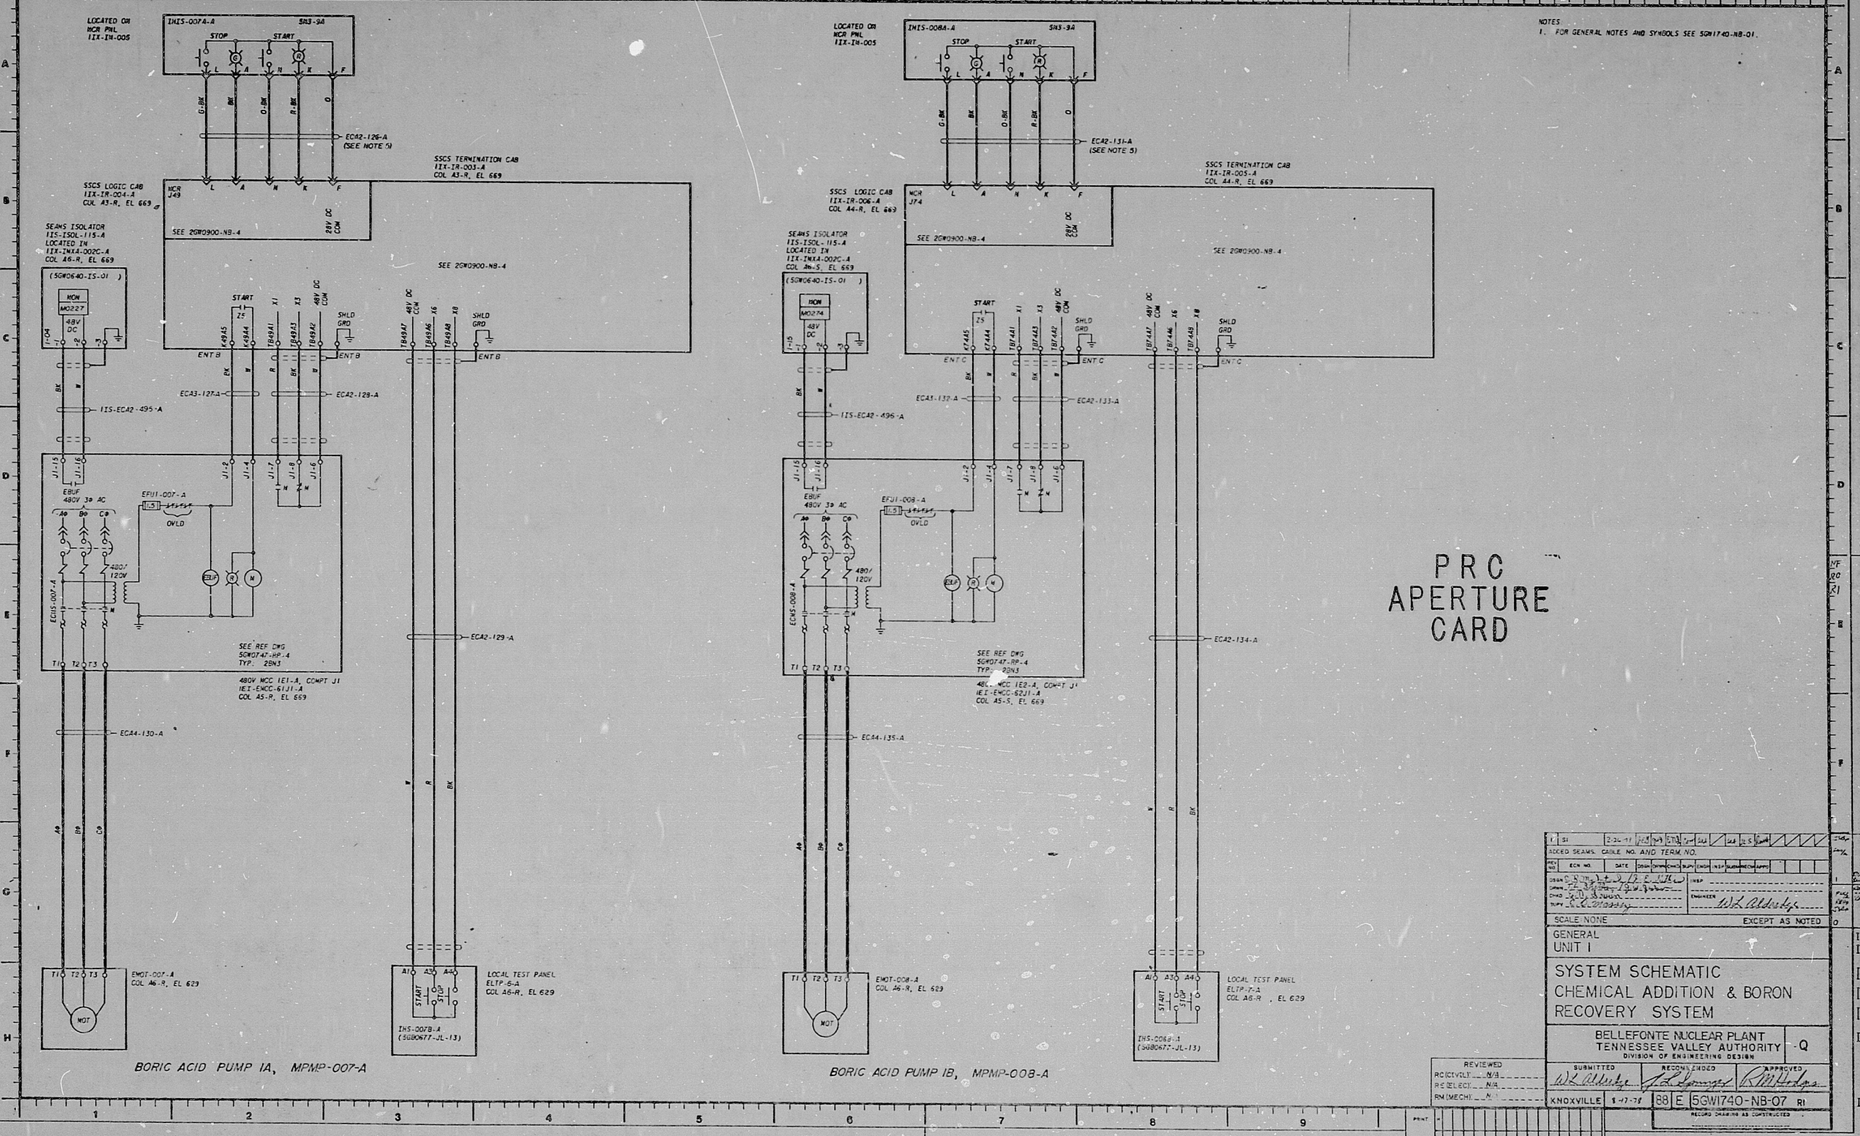
88 E 5GW1740-NB-07
LOCATED ON NCR PNL. 11X-IN-005
INIS-007A-A
SW3-3A
STOP
START
ECA2-126-A (SEE NOTE 5)
SSCS TERMINATION CAB 11X-IR-003-A COL A3-R, EL 669
SSCS LOGIC CAB 11X-IR-004-A COL A3-R, EL 669
NCR 2A9
SEE 2GW0900-NB-4
SEAMS ISOLATOR 11S-ISOL-115-A LOCATED IN 11X-IMXA-002C-A COL A6-R, EL 669
(5GW0640-IS-01)
MCC M0227
48V DC
11S-ECA2-495-A
EBUF 480V 3ø AC
EFJ1-007-A
OVLD
480/120V
ECM5-007-A
SEE REF DWG 5GW0747-RP-4 TYP: 2DN3
480V MCC 1E1-A, COMPT J1 1E1-EMCC-6J1/1-A COL A5-R, EL 669
ECA4-130-A
EMOT-007-A COL A6-R, EL 629
MOT
ECA3-127-A
ECA2-128-A
ECA2-129-A
LOCAL TEST PANEL ELTP-6-A COL A6-R, EL 629
INIS-007B-A (5GW0677-JL-13)
BORIC ACID PUMP 1A, MPMP-007-A
LOCATED ON NCR PNL. 11X-IN-005
INIS-008A-A
SW3-3A
ECA2-131-A (SEE NOTE 5)
SSCS TERMINATION CAB 11X-IR-005-A COL A4-R, EL 669
SSCS LOGIC CAB 11X-IR-006-A COL A4-R, EL 669
NCR 3A4
SEAMS ISOLATOR 11S-ISOL-115-A LOCATED IN 11X-IMXA-002C-A COL A4-R, EL 669
(5GW0640-IS-01)
MCC M0214
11S-ECA2-496-A
EFJ1-008-A
ECM5-008-A
SEE REF DWG 5GW0747-RP-4 TYP: 2DN3
480V MCC 1E2-A, COMPT J1 1E1-EMCC-6J2/1-A COL A5-R, EL 669
ECA4-135-A
EMOT-008-A COL A6-R, EL 629
ECA1-137-A
ECA2-133-A
ECA2-134-A
LOCAL TEST PANEL ELTP-7-A COL A6-R, EL 629
INIS-008B-A (5GW0677-JL-13)
BORIC ACID PUMP 1B, MPMP-008-A
NOTES
1. FOR GENERAL NOTES AND SYMBOLS SEE 5GW1740-NB-01.
PRC APERTURE CARD
SCALE: NONE
EXCEPT AS NOTED
GENERAL
UNIT 1
SYSTEM SCHEMATIC
CHEMICAL ADDITION & BORON RECOVERY SYSTEM
BELLEFONTE NUCLEAR PLANT
TENNESSEE VALLEY AUTHORITY
DIVISION OF ENGINEERING DESIGN
Q
SUBMITTED
RECOMMENDED
APPROVED
XNOXVILLE
88 E 5GW1740-NB-07 R1
RECORD DRAWING AS CONSTRUCTED

RIDS

8204020115

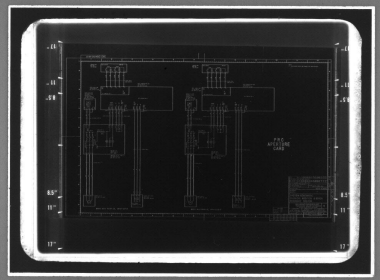

MMM 5824 FILMSORT® Brand Aperture & Camera Cards and DUPLICARD® Brand Copy Cards — Product of 3M Company, St. Paul, Minn.