



E-0435-0(Q) 5H.2

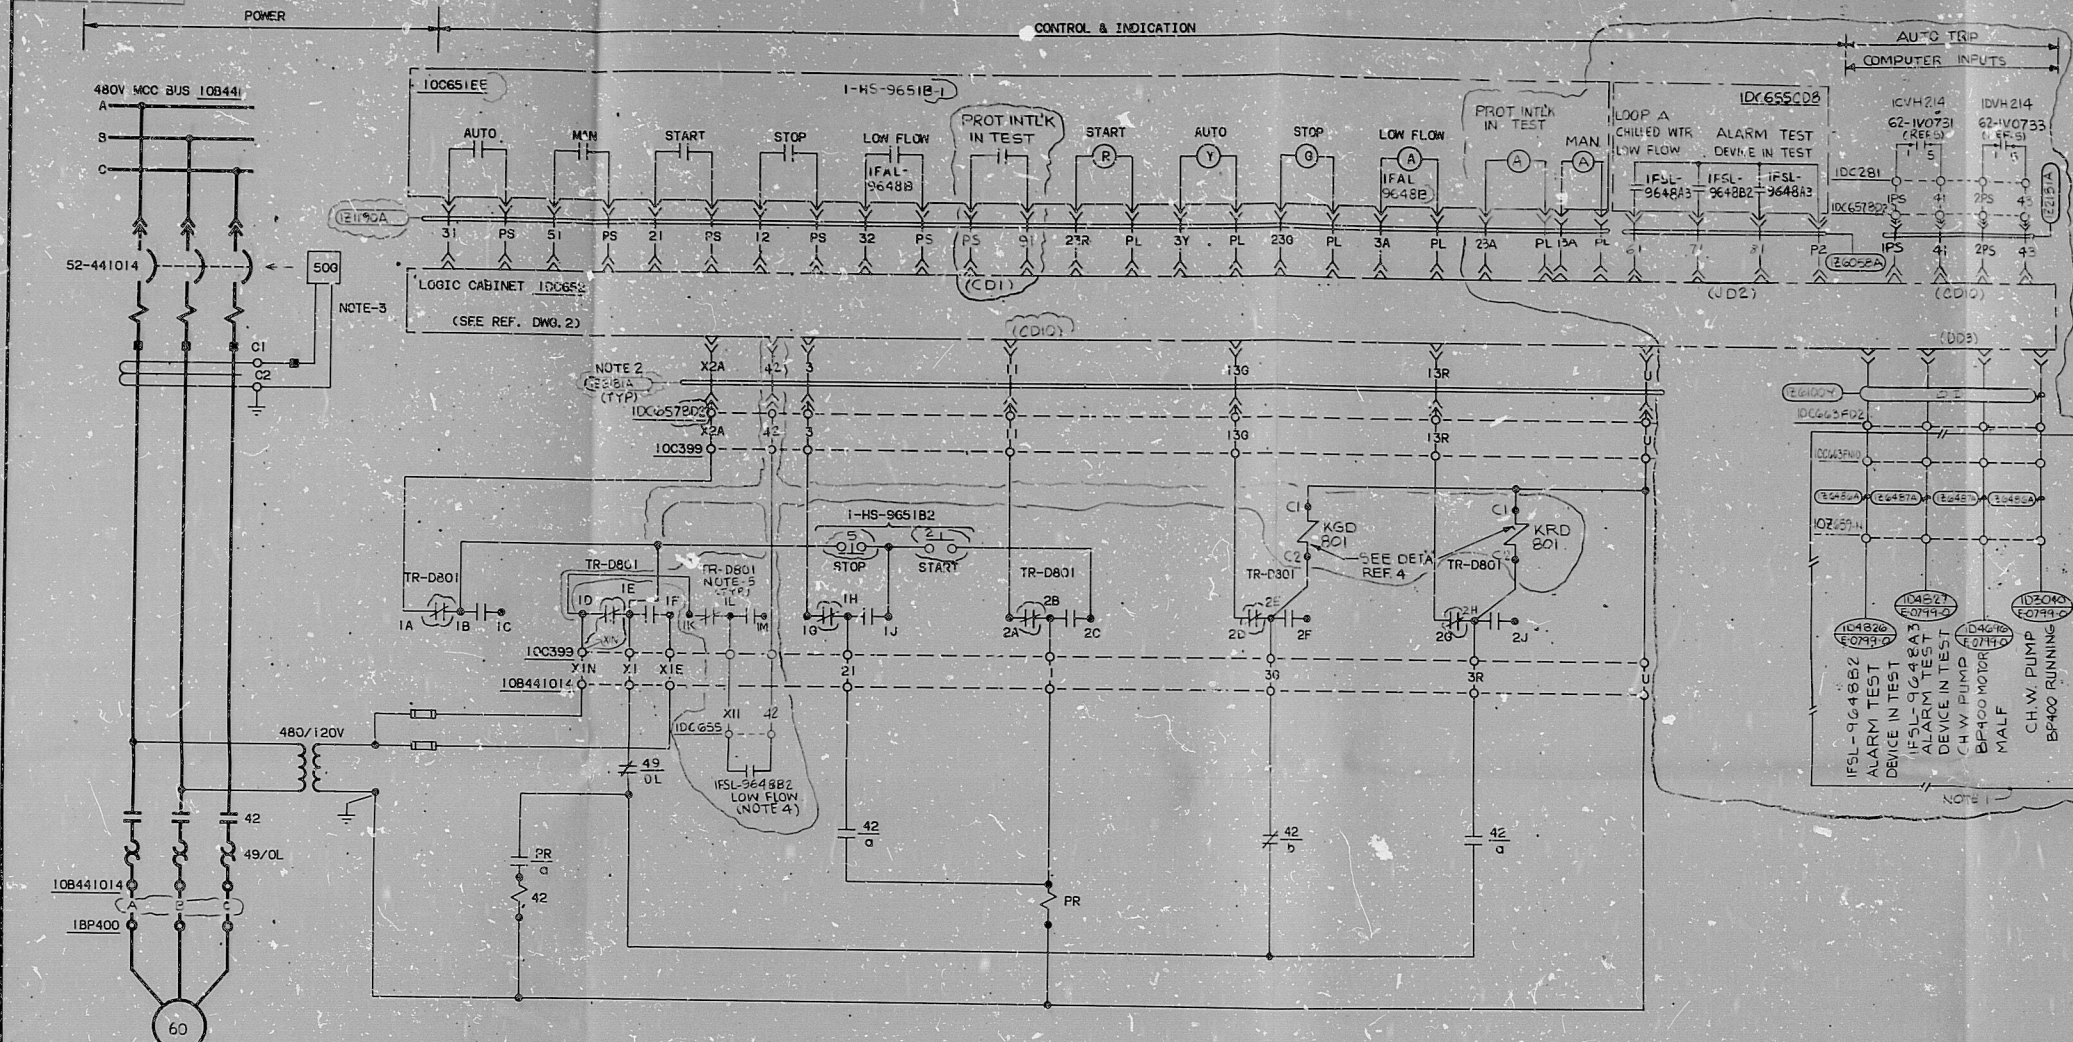

- NOTES:
1. ALL EQUIPMENT SHOWN ON THIS DWG IS LISTED EXCEPT AS SHOWN ENCLOSED IN THIS BOUNDARY.
 2. DENOTES A SCHEME CABLE NUMBER FOR A VENDOR SUPPLIED CABLE WHICH INCLUDES THE ENCLOSED CONDUCTORS. SEE REF. DWG. NO. 5.
 3. SEE OUTLET-HAMMER DWG. OF 792764-D1-6 FOR GROUND FAULT RELAY CONNECTION.
 4. CONTACT CLOSING ON LO CHILLED WTR. FLOW.
 5. RELAY TRD801 CONTACTS ARE SHOWN WITH THE NORMAL COIL ENERGIZED (SEE REF. 4).

- REFERENCE DWGS:
1. LOGIC DIAG. DWG. H-90-0(Q) 5H.2
 2. BAILEY METER CO. DWG. (255-1200Q)-1124, 1141, 2246, 434
 3. 480 MCC TAB DWG. E-0019-1(03)
 4. ELECTRICAL SCHEM. DWG. ASP-0003-0 E-0004-0
 5. ELECTRICAL SCHEM. DWG. E-0465-3
 6. BAILEY METER CO. DWG. 10855-3200(D)-1881 SH. 61, 2297 SH. 3, 13, 15; 1470 SH. 3
 7. BECHTEL C.B.D. DWG. 5-4512-C E-4515-0 E-4519-0

CHILLED WATER CIRC. PUMP IBP400
SCHEME NO. 1V0618 S/U-GJ (INST. TAG NO 15J-1)
CLASS 1E CHANNEL B

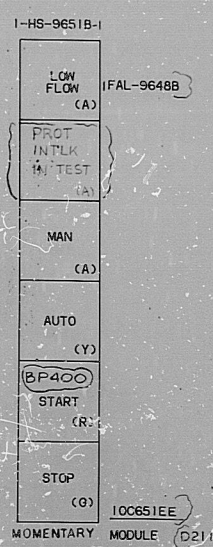

1HS-9651B-2

CONTACTS	POSITIONS	REF. DWG.
START DEPD	STOP DEPD	
0 1 0	X	SP
0 2 0	X	THIS DWG
0 3 0	X	THIS DWG
0 4 0	X	SP
0 5 0	X	SP

1HS-9651B-2
MOMENTARY CONTACTS

COLORS SHOWN ARE FOR NON-ILLUMINATED PUSHBUTTONS

10C399 MOD. DISB

PRO
APERTURE
CARD

REV. 1/1	REV. 2/1	REV. 3/1	REV. 4/1	REV. 5/1	REV. 6/1	REV. 7/1	REV. 8/1	REV. 9/1	REV. 10/1
1/1	2/1	3/1	4/1	5/1	6/1	7/1	8/1	9/1	10/1
1/1	2/1	3/1	4/1	5/1	6/1	7/1	8/1	9/1	10/1
1/1	2/1	3/1	4/1	5/1	6/1	7/1	8/1	9/1	10/1
1/1	2/1	3/1	4/1	5/1	6/1	7/1	8/1	9/1	10/1
1/1	2/1	3/1	4/1	5/1	6/1	7/1	8/1	9/1	10/1
1/1	2/1	3/1	4/1	5/1	6/1	7/1	8/1	9/1	10/1
1/1	2/1	3/1	4/1	5/1	6/1	7/1	8/1	9/1	10/1
1/1	2/1	3/1	4/1	5/1	6/1	7/1	8/1	9/1	10/1
1/1	2/1	3/1	4/1	5/1	6/1	7/1	8/1	9/1	10/1

BECHTEL
SAN FRANCISCO
PUBLIC SERVICE ELECTRIC AND GAS COMPANY
HOPE CREEK GENERATING STATION
ELECTRICAL SCHEMATIC DIAGRAM
CHILLED WTR. CIRC. PUMP IBP400

JOB No.	DRAWING No.	REV.
10855	E-0435-0	1

10855 E-0435-0

RIDS

8308100480

