


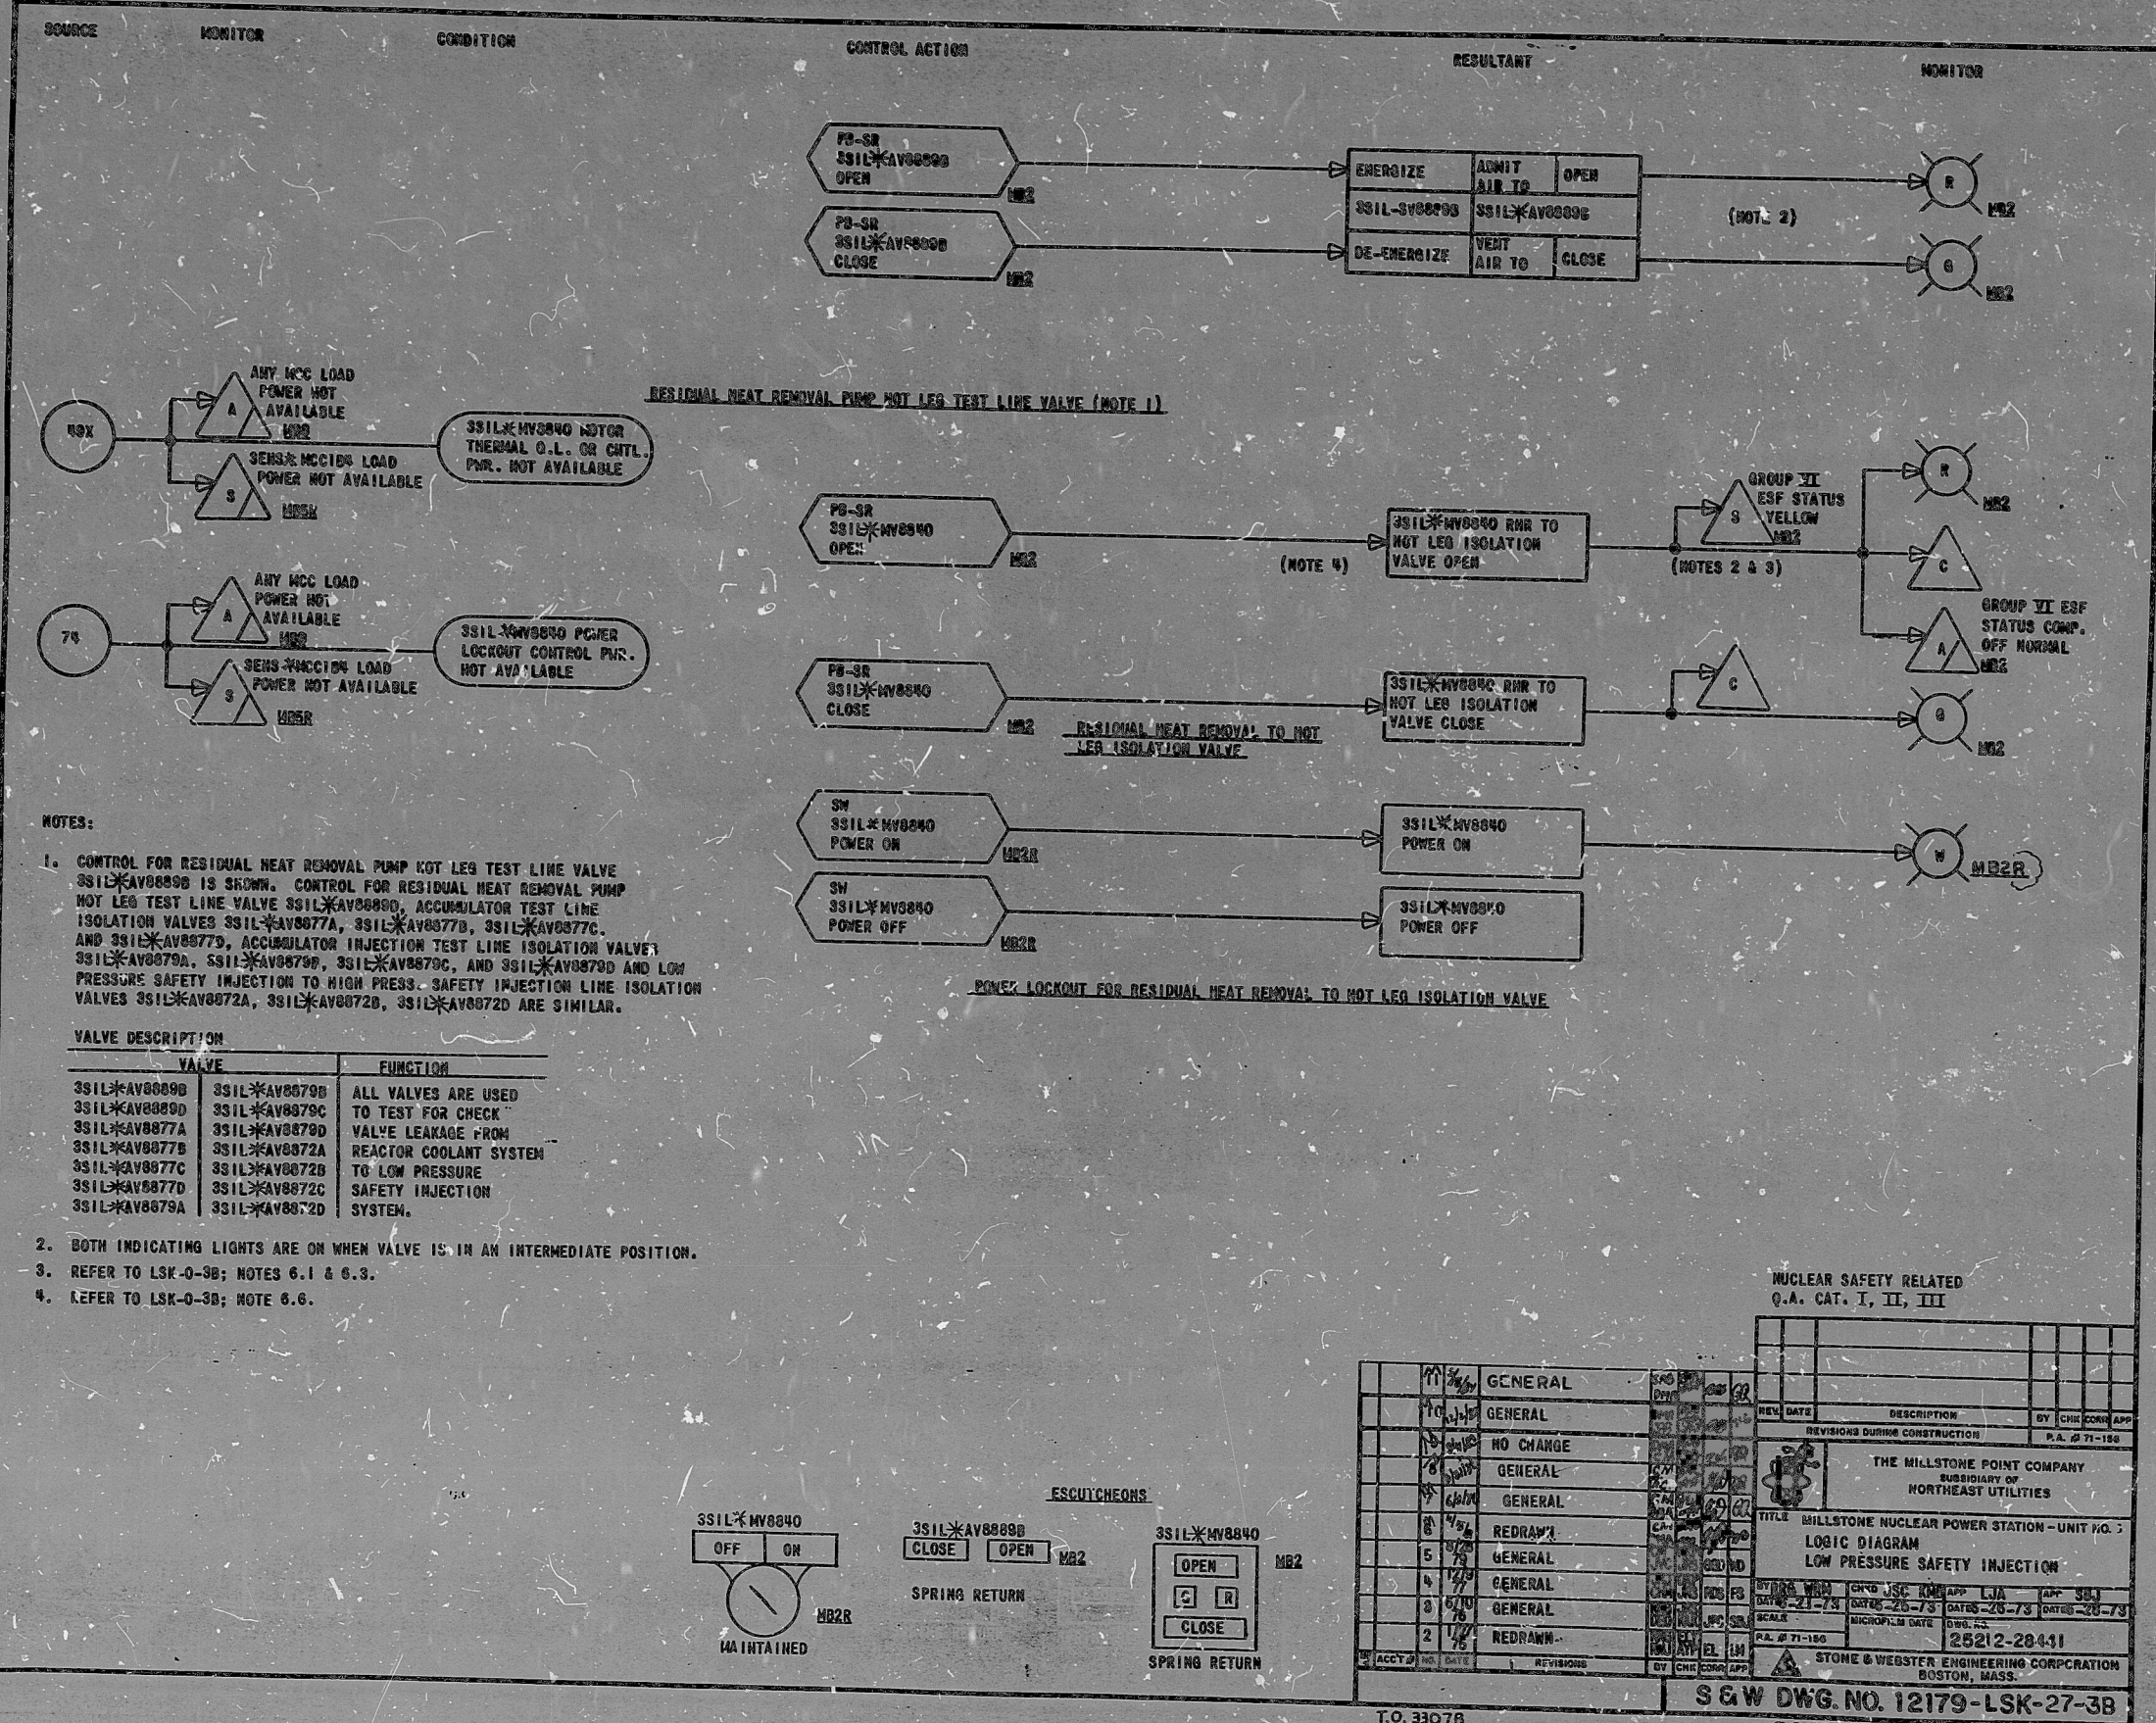

NUCLEAR SAFETY RELATED  
Q.A. CAT. I, II, III

| REV. | DATE   | DESCRIPTION | BY  | CHK | APP |
|------|--------|-------------|-----|-----|-----|
| 1    | 7/1/73 | GENERAL     | ... | ... | ... |
| 2    | 7/1/73 | GENERAL     | ... | ... | ... |
| 3    | 7/1/73 | GENERAL     | ... | ... | ... |
| 4    | 7/1/73 | GENERAL     | ... | ... | ... |
| 5    | 7/1/73 | GENERAL     | ... | ... | ... |
| 6    | 7/1/73 | GENERAL     | ... | ... | ... |
| 7    | 7/1/73 | GENERAL     | ... | ... | ... |
| 8    | 7/1/73 | GENERAL     | ... | ... | ... |
| 9    | 7/1/73 | GENERAL     | ... | ... | ... |
| 10   | 7/1/73 | GENERAL     | ... | ... | ... |
| 11   | 7/1/73 | GENERAL     | ... | ... | ... |
| 12   | 7/1/73 | GENERAL     | ... | ... | ... |
| 13   | 7/1/73 | GENERAL     | ... | ... | ... |
| 14   | 7/1/73 | GENERAL     | ... | ... | ... |
| 15   | 7/1/73 | GENERAL     | ... | ... | ... |
| 16   | 7/1/73 | GENERAL     | ... | ... | ... |
| 17   | 7/1/73 | GENERAL     | ... | ... | ... |
| 18   | 7/1/73 | GENERAL     | ... | ... | ... |
| 19   | 7/1/73 | GENERAL     | ... | ... | ... |
| 20   | 7/1/73 | GENERAL     | ... | ... | ... |
| 21   | 7/1/73 | GENERAL     | ... | ... | ... |
| 22   | 7/1/73 | GENERAL     | ... | ... | ... |
| 23   | 7/1/73 | GENERAL     | ... | ... | ... |
| 24   | 7/1/73 | GENERAL     | ... | ... | ... |
| 25   | 7/1/73 | GENERAL     | ... | ... | ... |
| 26   | 7/1/73 | GENERAL     | ... | ... | ... |
| 27   | 7/1/73 | GENERAL     | ... | ... | ... |
| 28   | 7/1/73 | GENERAL     | ... | ... | ... |
| 29   | 7/1/73 | GENERAL     | ... | ... | ... |
| 30   | 7/1/73 | GENERAL     | ... | ... | ... |
| 31   | 7/1/73 | GENERAL     | ... | ... | ... |
| 32   | 7/1/73 | GENERAL     | ... | ... | ... |
| 33   | 7/1/73 | GENERAL     | ... | ... | ... |
| 34   | 7/1/73 | GENERAL     | ... | ... | ... |
| 35   | 7/1/73 | GENERAL     | ... | ... | ... |
| 36   | 7/1/73 | GENERAL     | ... | ... | ... |
| 37   | 7/1/73 | GENERAL     | ... | ... | ... |
| 38   | 7/1/73 | GENERAL     | ... | ... | ... |
| 39   | 7/1/73 | GENERAL     | ... | ... | ... |
| 40   | 7/1/73 | GENERAL     | ... | ... | ... |
| 41   | 7/1/73 | GENERAL     | ... | ... | ... |
| 42   | 7/1/73 | GENERAL     | ... | ... | ... |
| 43   | 7/1/73 | GENERAL     | ... | ... | ... |
| 44   | 7/1/73 | GENERAL     | ... | ... | ... |
| 45   | 7/1/73 | GENERAL     | ... | ... | ... |
| 46   | 7/1/73 | GENERAL     | ... | ... | ... |
| 47   | 7/1/73 | GENERAL     | ... | ... | ... |
| 48   | 7/1/73 | GENERAL     | ... | ... | ... |
| 49   | 7/1/73 | GENERAL     | ... | ... | ... |
| 50   | 7/1/73 | GENERAL     | ... | ... | ... |
| 51   | 7/1/73 | GENERAL     | ... | ... | ... |
| 52   | 7/1/73 | GENERAL     | ... | ... | ... |
| 53   | 7/1/73 | GENERAL     | ... | ... | ... |
| 54   | 7/1/73 | GENERAL     | ... | ... | ... |
| 55   | 7/1/73 | GENERAL     | ... | ... | ... |
| 56   | 7/1/73 | GENERAL     | ... | ... | ... |
| 57   | 7/1/73 | GENERAL     | ... | ... | ... |
| 58   | 7/1/73 | GENERAL     | ... | ... | ... |
| 59   | 7/1/73 | GENERAL     | ... | ... | ... |
| 60   | 7/1/73 | GENERAL     | ... | ... | ... |
| 61   | 7/1/73 | GENERAL     | ... | ... | ... |
| 62   | 7/1/73 | GENERAL     | ... | ... | ... |
| 63   | 7/1/73 | GENERAL     | ... | ... | ... |
| 64   | 7/1/73 | GENERAL     | ... | ... | ... |
| 65   | 7/1/73 | GENERAL     | ... | ... | ... |
| 66   | 7/1/73 | GENERAL     | ... | ... | ... |
| 67   | 7/1/73 | GENERAL     | ... | ... | ... |
| 68   | 7/1/73 | GENERAL     | ... | ... | ... |
| 69   | 7/1/73 | GENERAL     | ... | ... | ... |
| 70   | 7/1/73 | GENERAL     | ... | ... | ... |
| 71   | 7/1/73 | GENERAL     | ... | ... | ... |
| 72   | 7/1/73 | GENERAL     | ... | ... | ... |
| 73   | 7/1/73 | GENERAL     | ... | ... | ... |
| 74   | 7/1/73 | GENERAL     | ... | ... | ... |
| 75   | 7/1/73 | GENERAL     | ... | ... | ... |
| 76   | 7/1/73 | GENERAL     | ... | ... | ... |
| 77   | 7/1/73 | GENERAL     | ... | ... | ... |
| 78   | 7/1/73 | GENERAL     | ... | ... | ... |
| 79   | 7/1/73 | GENERAL     | ... | ... | ... |
| 80   | 7/1/73 | GENERAL     | ... | ... | ... |
| 81   | 7/1/73 | GENERAL     | ... | ... | ... |
| 82   | 7/1/73 | GENERAL     | ... | ... | ... |
| 83   | 7/1/73 | GENERAL     | ... | ... | ... |
| 84   | 7/1/73 | GENERAL     | ... | ... | ... |
| 85   | 7/1/73 | GENERAL     | ... | ... | ... |
| 86   | 7/1/73 | GENERAL     | ... | ... | ... |
| 87   | 7/1/73 | GENERAL     | ... | ... | ... |
| 88   | 7/1/73 | GENERAL     | ... | ... | ... |
| 89   | 7/1/73 | GENERAL     | ... | ... | ... |
| 90   | 7/1/73 | GENERAL     | ... | ... | ... |
| 91   | 7/1/73 | GENERAL     | ... | ... | ... |
| 92   | 7/1/73 | GENERAL     | ... | ... | ... |
| 93   | 7/1/73 | GENERAL     | ... | ... | ... |
| 94   | 7/1/73 | GENERAL     | ... | ... | ... |
| 95   | 7/1/73 | GENERAL     | ... | ... | ... |
| 96   | 7/1/73 | GENERAL     | ... | ... | ... |
| 97   | 7/1/73 | GENERAL     | ... | ... | ... |
| 98   | 7/1/73 | GENERAL     | ... | ... | ... |
| 99   | 7/1/73 | GENERAL     | ... | ... | ... |
| 100  | 7/1/73 | GENERAL     | ... | ... | ... |

THE MILLSTONE POINT COMPANY  
SUBSIDIARY OF  
NORTHEAST UTILITIES

TITLE: MILLSTONE NUCLEAR POWER STATION - UNIT NO. 1  
LOGIC DIAGRAM  
LOW PRESSURE SAFETY INJECTION

DATE: 7-1-73  
SCALE: 1/4" = 1'-0"  
MICROFILM DATE: 7-1-73  
R.A. # 71-150  
25212-28431

STONE & WEBSTER ENGINEERING CORPORATION  
BOSTON, MASS.

S & W DWG. NO. 12179-LSK-27-3B

T.O. 3307B T.O. 3307A T.O. 3301

TI  
APERTURE  
CAT



PDR RIDS

8503280231

