

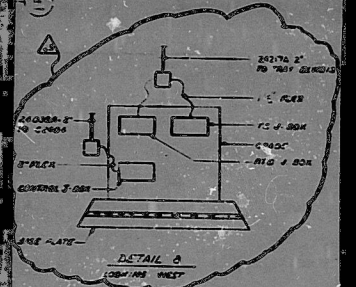

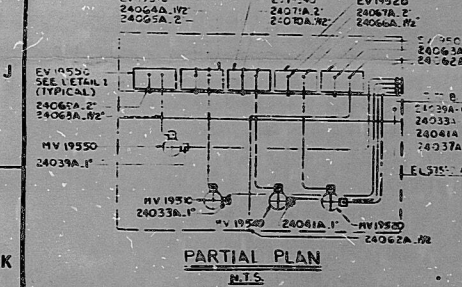
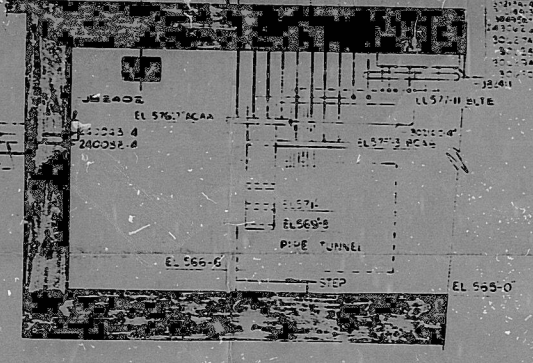
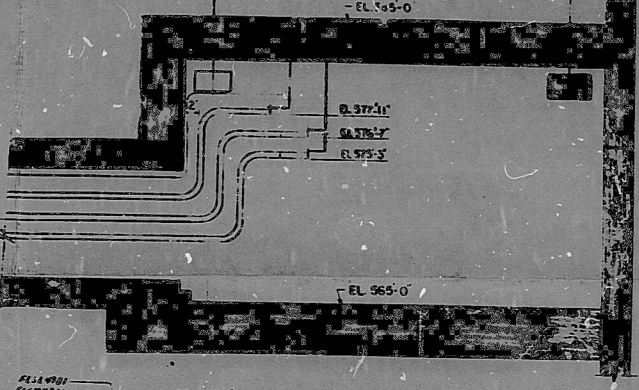



NOTES

1. FOR NOTES, REFER TO VOLUME 1 LEGEND 400 DRAWING E-307
2. FOR TYPICAL ROOM MOUNT CONNECTIONS SEE ELECTRICAL STANDARDS DETAILS: SEE SIZE
3. ELECTRICAL WORK SHALL BE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND ALL APPLICABLE LOCAL ORDINANCES AND REGULATIONS.
4. ALL WORK SHALL BE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND ALL APPLICABLE LOCAL ORDINANCES AND REGULATIONS.
5. ALL WORK SHALL BE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND ALL APPLICABLE LOCAL ORDINANCES AND REGULATIONS.
6. ALL WORK SHALL BE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND ALL APPLICABLE LOCAL ORDINANCES AND REGULATIONS.



NO.	DESCRIPTION	DATE	BY	CHKD.
1	ISSUED FOR CONSTRUCTION			
2	REVISION			
3	REVISION			
4	REVISION			
5	REVISION			
6	REVISION			
7	REVISION			
8	REVISION			
9	REVISION			
10	REVISION			
11	REVISION			
12	REVISION			
13	REVISION			
14	REVISION			



9φφ/φ3φ366

SI APERTURE CARD

DECATEL COMPANY CINCINNATI, OHIO		
DAVIS-BESSE NUCLEAR POWER STATION THE WOLFE GROUP COMPANY THE CLEVELAND ELECTRIC MANUFACTURING COMPANY		
TURBINE RACEWAY & GROUNDING BUILDING EL 2(567') AREA 4		
JOB NO.	CONTRACT NO.	REV.
7749	E-308	23

1. CHECK FOR THE WORK SHOWN ON THIS DRAWING TO BE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND ALL APPLICABLE LOCAL ORDINANCES AND REGULATIONS.

PDR RIDS

9001030366

