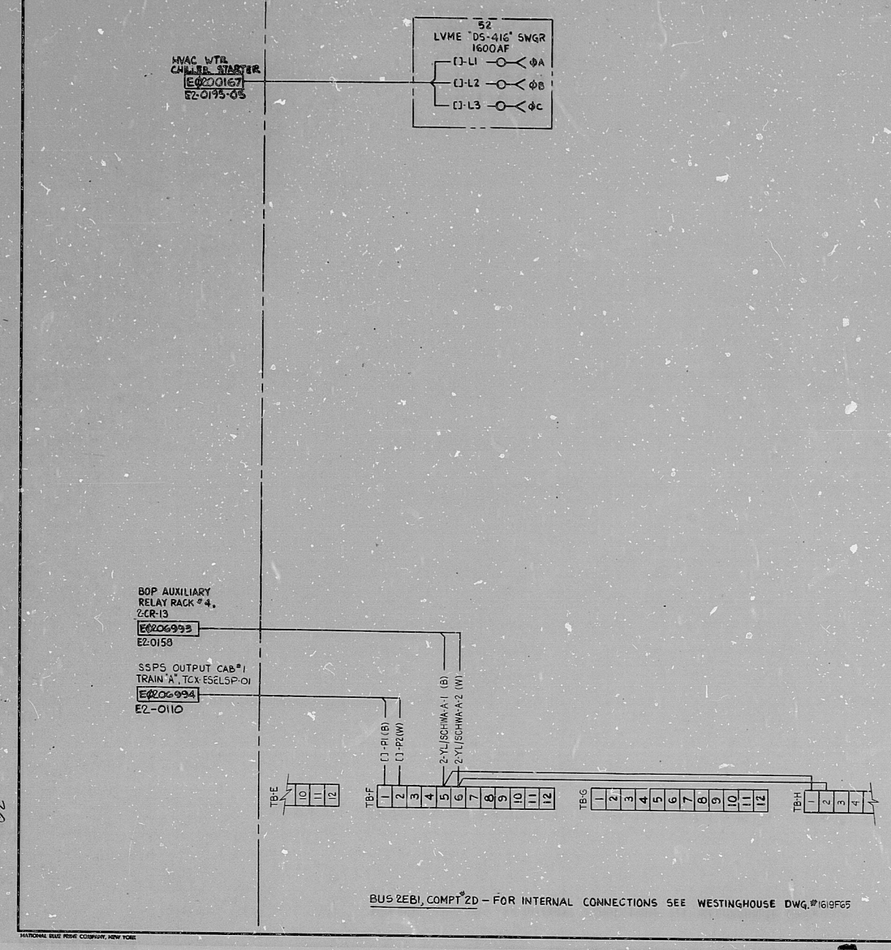

TERA APERTURE CARD

TRAIN "A"

NOTES:

1. FOR SHEET ISSUE RECORD & SHEET INDEX SEE THIS DWG., SHEET # 0
2. FOR SCHEMATIC DIAGRAM SEE THIS DWG., SHEET # 29.
3. FOR ADDITIONAL NOTES & SYMBOLS SEE THIS DWG., SHEET # 29.
4. ALL WIRING & EQUIPMENTS ON THIS SHEET IS CLASS "1E", TRAIN "A" EXCEPT AS NOTED.

SYMBOLS:

[] - INDICATES WIRE PREFIX SAME AS BREAKER NUMBER [2CICE5]

CABLE DESTINATION
CABLE NO
DRAWING REFERENCE

CLASS I

STRUCTURES, MECHANICAL AND ELECTRICAL EQUIPMENT AND SYSTEMS THAT ARE ESSENTIAL TO ASSURE: (1) THE INTEGRITY OF THE REACTOR COOLANT PRESSURE BOUNDARY (2) THE CAPABILITY TO SHUTDOWN THE REACTOR AND MAINTAIN IT IN A SAFE SHUTDOWN CONDITION, OR (3) CAPABILITY TO PREVENT OR MITIGATE THE CONSEQUENCES OF ACCIDENTS WHICH COULD RESULT IN POTENTIAL OFFSITE EXPOSURES COMPARABLE TO THE GUIDELINE EXPOSURES.

REVISION NO.	DATE	DWN.	CHKD.	MECH. ENGR.	ARCH.	ELECL.	CHEM.	STRUCT.	MECH.	ELEC.	P.E.	ISSUED FOR
1	12.8.80	GT	AV	—	—	—	—	—	—	—	—	CONSTRUCTION

NUCLEAR

TEXAS UTILITIES SERVICES INC.
AGENT FOR:
DALLAS POWER & LIGHT COMPANY
TEXAS ELECTRIC SERVICE COMPANY
TEXAS POWER & LIGHT COMPANY

COMANCHE PEAK S.E.S.
1980-82 — 2300 MW INSTALLATION

480V SWITCHGEAR BUS 2EB1
HVAC CENTRIFUGAL WTR CHILLER
*CP2-CHCICE-05 BKR 2CICE5
CONNECTION DIAGRAM

Gibbs & Hill, Inc.
NEW YORK

JOB NO. 2323

2323-E2-0033

SHEET No. 30

NATIONAL BLUE PRINT COMPANY, NEW YORK

8102260560

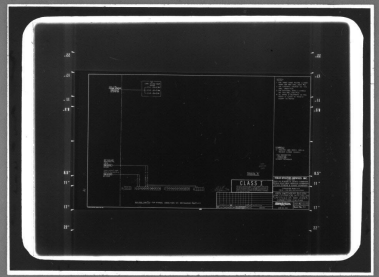

DDAELE
NRCA ANPGF EØØ45
" " AAØ 4117

MMM 5824 — FILMSORT® Brand Aperture & Camera Cards and DUPLICARD® Brand Copy Cards — Product of 3M Company, St. Paul, Minn.