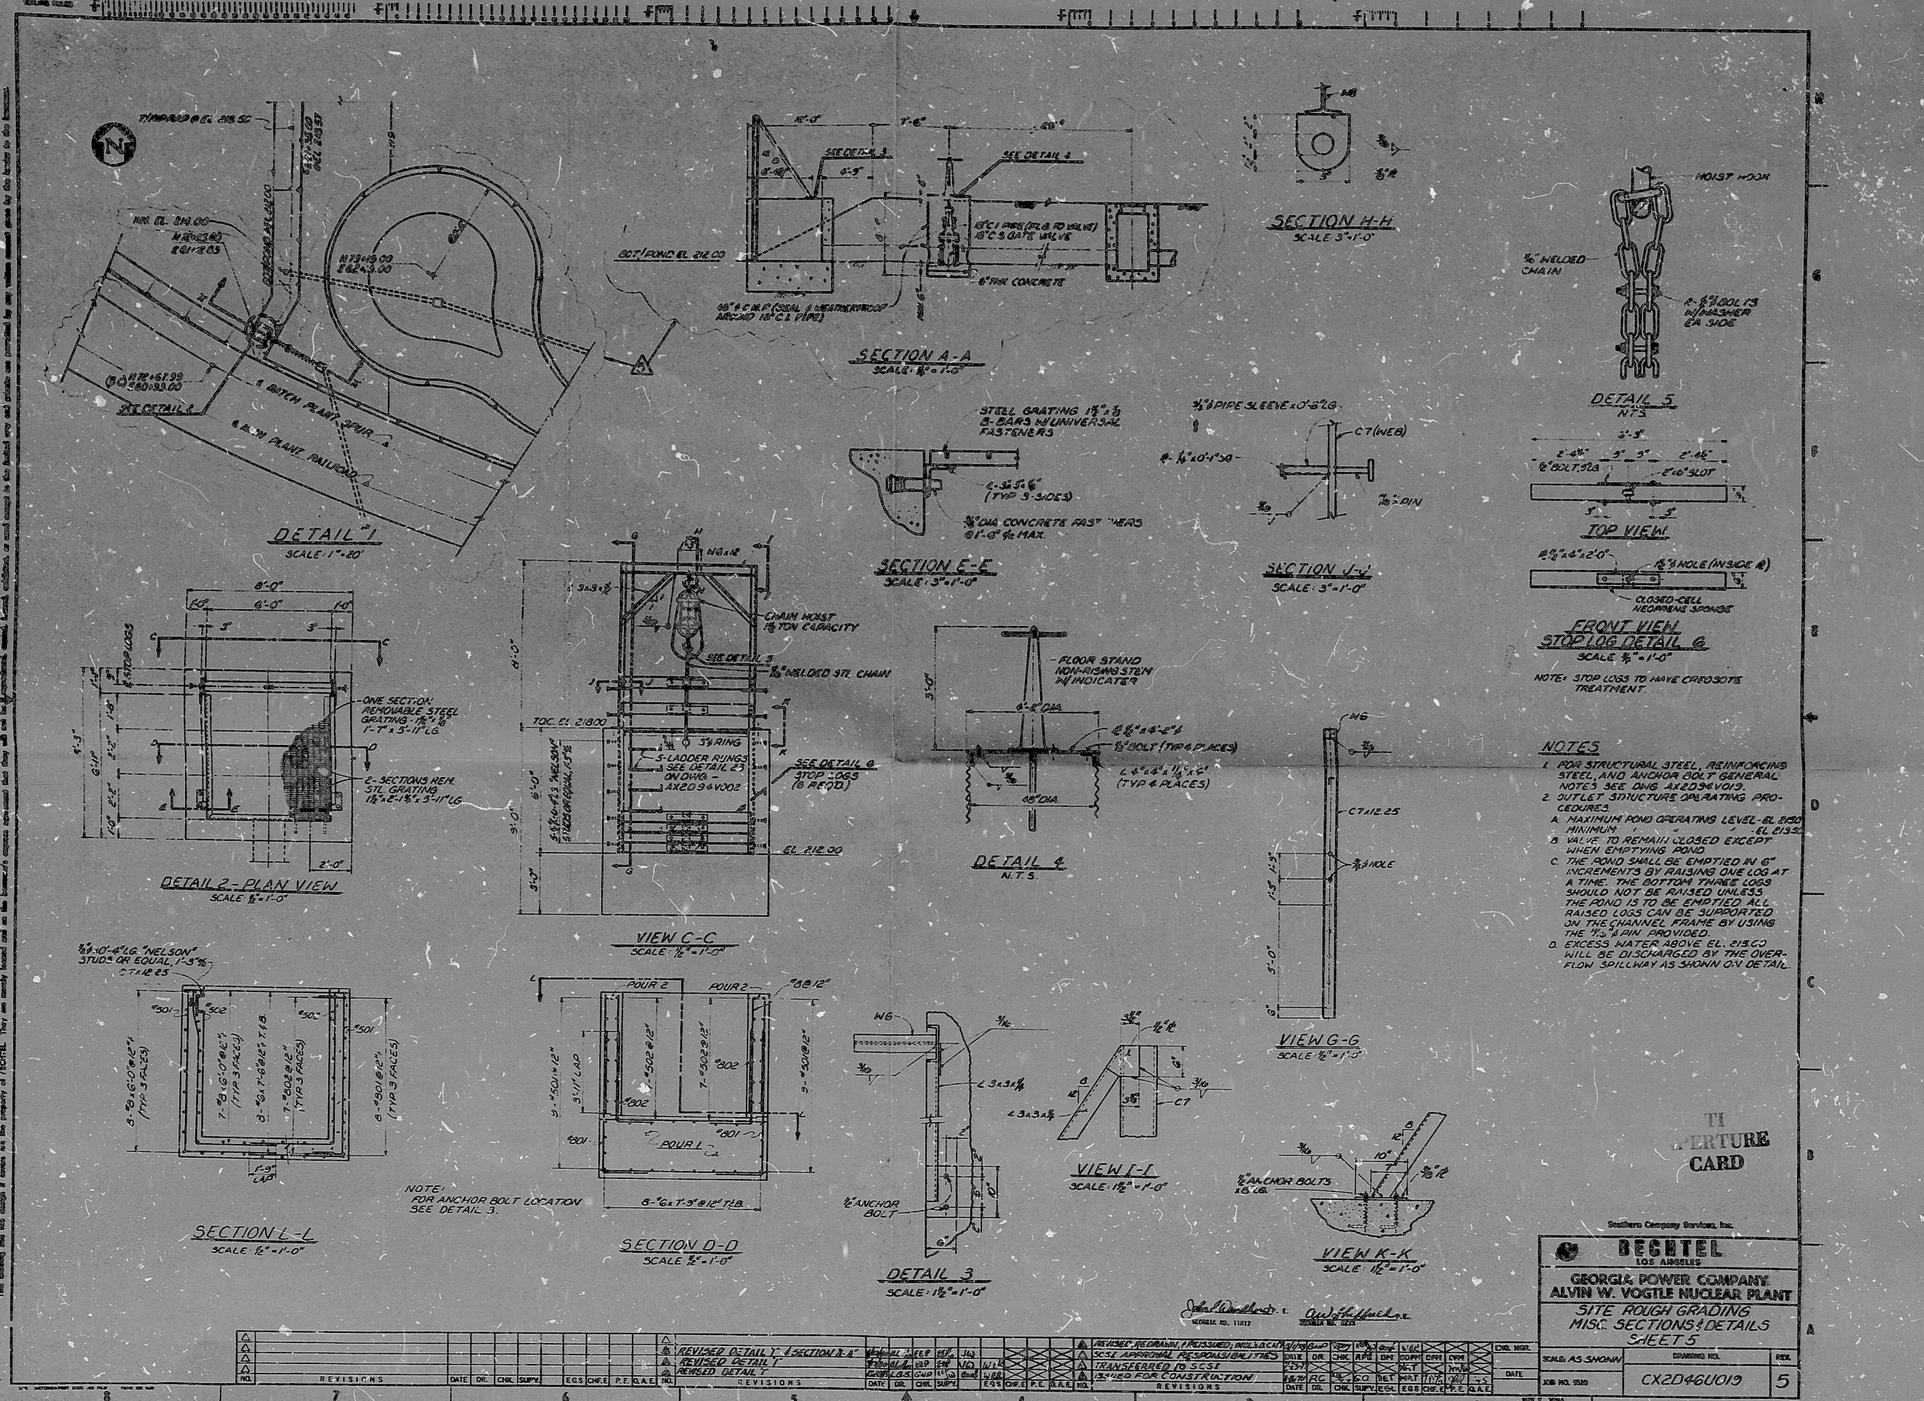
DETAIL #1
SCALE: 1"=20'
SECTION A-A
SCALE: 1/8"=1'-0"
SECTION H-H
SCALE: 3"=1'-0"
DETAIL 5
N.T.S.
TOP VIEW
FRONT VIEW
STOP LOG DETAIL 6
SCALE: 3/4"=1'-0"
NOTE: STOP LOGS TO HAVE CREOSOTE TREATMENT.
SECTION E-E
SCALE: 3"=1'-0"
SECTION J-J
SCALE: 3"=1'-0"
DETAIL 2 - PLAN VIEW
SCALE: 1/2"=1'-0"
VIEW C-C
SCALE: 1/2"=1'-0"
DETAIL 4
N.T.S.
VIEW G-G
SCALE: 1/2"=1'-0"
SECTION L-L
SCALE: 1/2"=1'-0"
SECTION D-D
SCALE: 1/2"=1'-0"
DETAIL 3
SCALE: 1 1/2"=1'-0"
VIEW I-I
SCALE: 1 1/2"=1'-0"
VIEW K-K
SCALE: 1 1/2"=1'-0"
NOTES
1. FOR STRUCTURAL STEEL, REINFORCING STEEL, AND ANCHOR BOLT GENERAL NOTES SEE DWG. AX2D46V019.
2. OUTLET STRUCTURE OPERATING PROCEDURES
A. MAXIMUM POND OPERATING LEVEL - EL. 215.0
MINIMUM " " - EL. 213.5
B. VALVE TO REMAIN CLOSED EXCEPT WHEN EMPTYING POND
C. THE POND SHALL BE EMPTIED IN 6" INCREMENTS BY RAISING ONE LOG AT A TIME. THE BOTTOM THREE LOGS SHOULD NOT BE RAISED UNLESS THE POND IS TO BE EMPTIED. ALL RAISED LOGS CAN BE SUPPORTED ON THE CHANNEL FRAME BY USING THE 1"x3/4" PIN PROVIDED.
D. EXCESS WATER ABOVE EL. 215.0 WILL BE DISCHARGED BY THE OVERFLOW SPILLWAY AS SHOWN ON DETAIL
TI
ERTURE
CARD
Southern Company Services, Inc.
BECHTEL
LOS ANGELES
GEORGIA POWER COMPANY
ALVIN W. VOGTLE NUCLEAR PLANT
SITE ROUGH GRADING
MISC. SECTIONS & DETAILS
SHEET 5
SCALE: AS SHOWN
DRAWING NO. CX2D46U019
REV. 5
JOB NO. 9530
REVISIONS
REVISED DETAIL 7, SECTION B-B
REVISED DETAIL 7
REVISED DETAIL 7
SCSE APPROVAL RESPONSIBILITIES
TRANSFERRED TO SCSE
ISSUED FOR CONSTRUCTION

PDR RIDS

8503290095

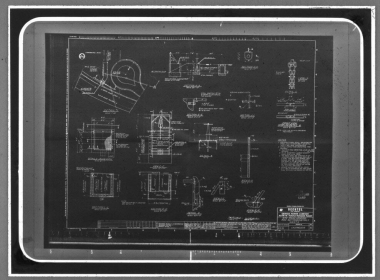

MMM 5824 — FILMSORT® Brand Aperture & Camera Cards and DUPLICARD® Brand Copy Cards — Product of 3M Company, St. Paul, Minn.