


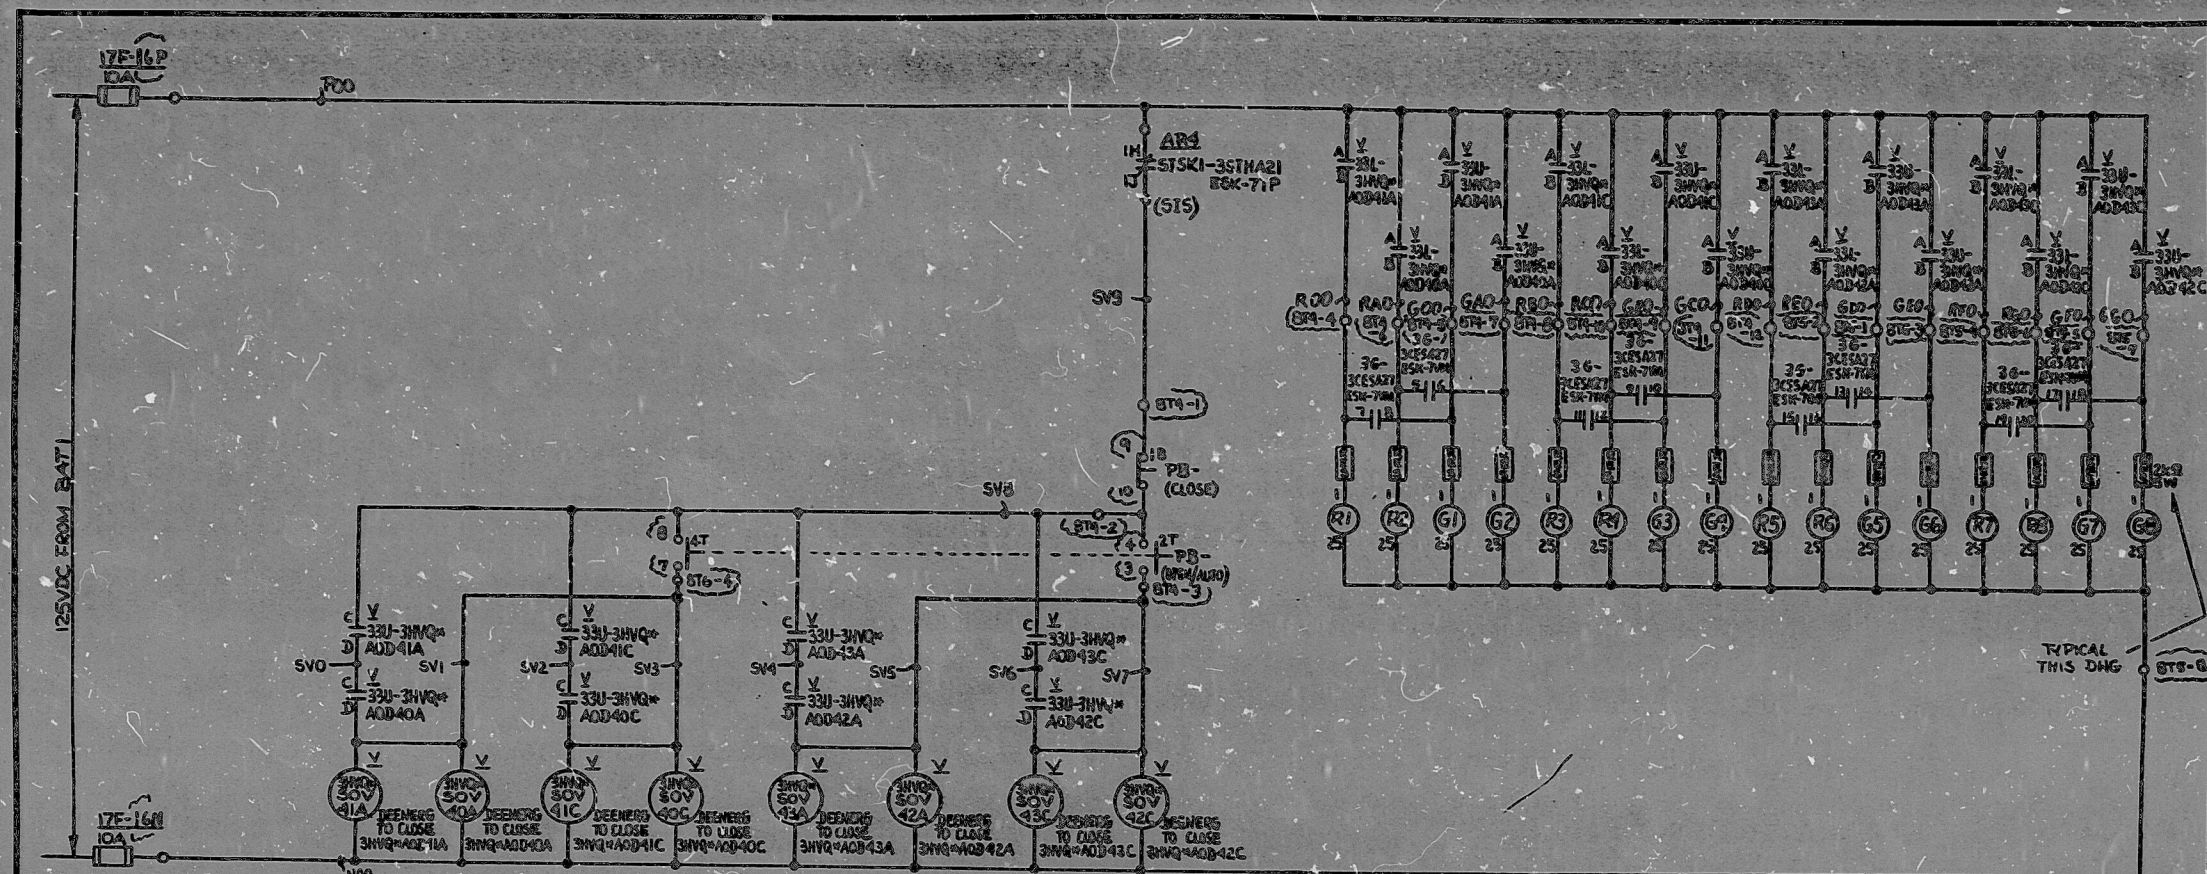

ENGINEERED SAFETY FEATURES BUILDING VENTILATION DAMPERS [3HVQ*ADD40A, 41A, 40C, 41C, 42A, 42C, 43A & 43C] (-O), CKT.3HVQAO2

LIMIT SWITCHES CONTACT DEVELOPMENT		FUNCTION									
		3HVQ*ADD41A	3HVQ*ADD40A	3HVQ*ADD41C	3HVQ*ADD40C	3HVQ*ADD43A	3HVQ*ADD42A	3HVQ*ADD43C	3HVQ*ADD42C		
33U	SEAL IN	SEAL IN	SEAL IN	SEAL IN	SEAL IN	SEAL IN	SEAL IN	SEAL IN	SEAL IN		
	GREEN LT	GREEN LT	GREEN LT	GREEN LT	GREEN LT	GREEN LT	GREEN LT	GREEN LT	GREEN LT		
	SP	SP	SP	SP	SP	SP	SP	SP	SP		
	SP	SP	SP	SP	SP	SP	SP	SP	SP		
33L	ESP STATUS THIS DWG	ESP STATUS THIS DWG	ESP STATUS THIS DWG	ESP STATUS THIS DWG	ESP STATUS THIS DWG	ESP STATUS THIS DWG	ESP STATUS THIS DWG	ESP STATUS THIS DWG	ESP STATUS THIS DWG		
	RED LT	RED LT	RED LT	RED LT	RED LT	RED LT	RED LT	RED LT	RED LT		
	SP	SP	SP	SP	SP	SP	SP	SP	SP		
	SP	SP	SP	SP	SP	SP	SP	SP	SP		

33U-3HVQ*ADD41A
40A
41C
40C
43A
42A
43C
42C

33L-3HVQ*ADD41A
40A
41C
40C
43A
42A
43C
42C

NOTES:

1. ALL EQUIP LOCATED AT VPI UNLESS OTHERWISE NOTED
2. REF LOGIC DIAG 1SK-22-26C, ISSUE 7
3. LIMIT SWITCHES ARE NAMCO SERIES EA740, HEAVY DUTY

33L-3HVQ*ADD41A THIS DWG
33L-3HVQ*ADD41C THIS DWG
33L-3HVQ*ADD43A THIS DWG
33L-3HVQ*ADD43C THIS DWG

ESP STATUS ANN 2144 ESK-10LB
ESP STATUS ANN 2146 ESK-10LB
ESP STATUS ANN 2148 ESK-10LB
ESP STATUS ANN 2150 H-BE20

NUCLEAR SAFETY RELATED
QA CAT I, II, III

CS PD-3HVQAO2
CONT DIAG AGI
ESK 3E
SPARES IT 3T 2B, 3B, 4B

REV DATE		DESCRIPTION		BY	CHK	APP
REVISIONS DURING CONSTRUCTION						
NORTHEAST NUCLEAR ENERGY COMPANY SUBSIDIARY OF NORTHEAST UTILITIES						
TITLE: MILLSTONE NUCLEAR POWER STATION - UNIT NO. 3 ELEM DIAG 125VDC ESF BLDG VENT DAMPERS						
DATE 11-17-77	DATE 11-17-77	DATE 11-17-77	DATE 11-17-77	DATE 11-17-77	DATE 11-17-77	DATE 11-17-77
25212-32587	25212-32587	25212-32587	25212-32587	25212-32587	25212-32587	25212-32587
STONE & WEBSTER ENGINEERING CORPORATION BOSTON, MASS.						
S & W DWG. NO. 12179-ESK-7RG						

TI
APERTURE
CARD

PDR RIDS

8504120117

