




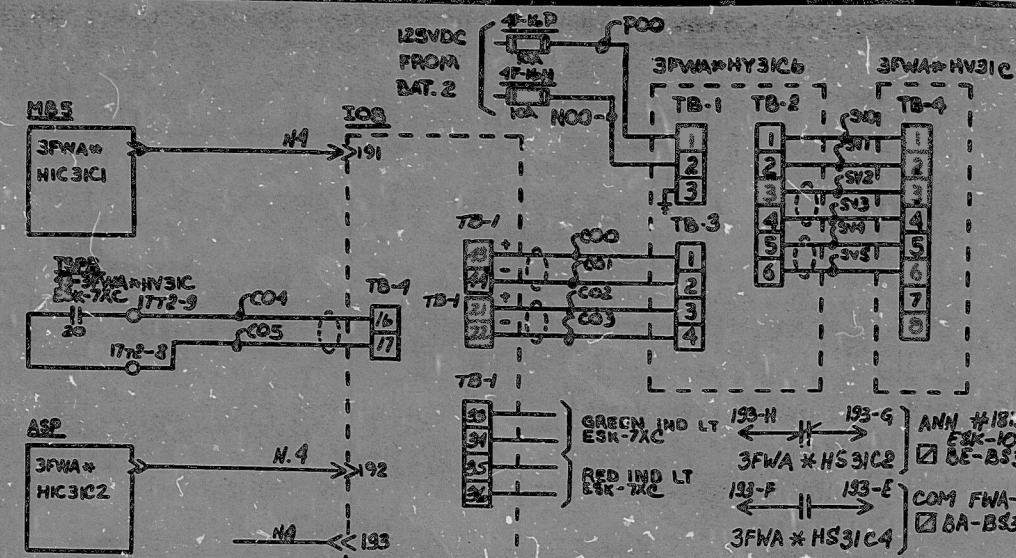

AUXILIARY FEEDWATER CONTROL VALVE [3FWA*HV31C] (C,P) CKT NO. 3FWAC10

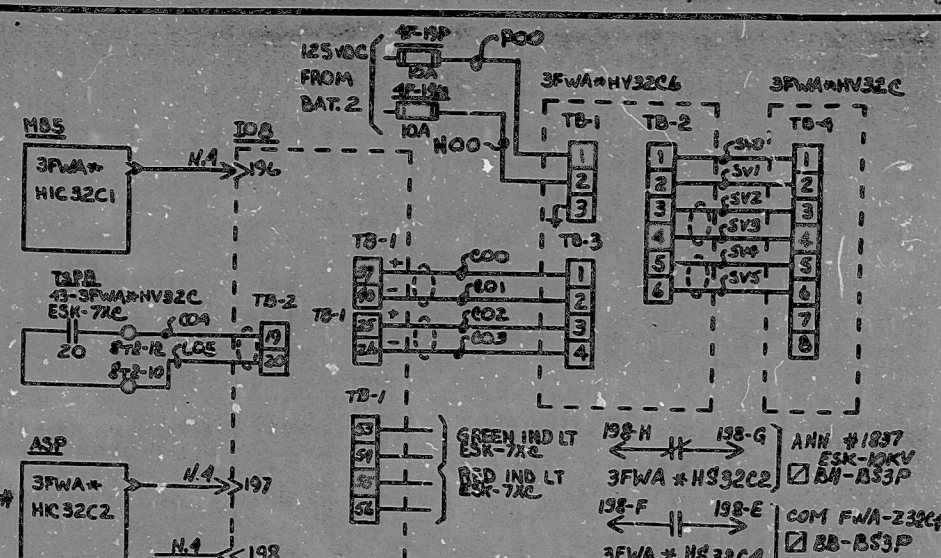

AUXILIARY FEEDWATER CONTROL VALVE [3FWA*HV32C] (C,P) CKT NO. 3FWAC11

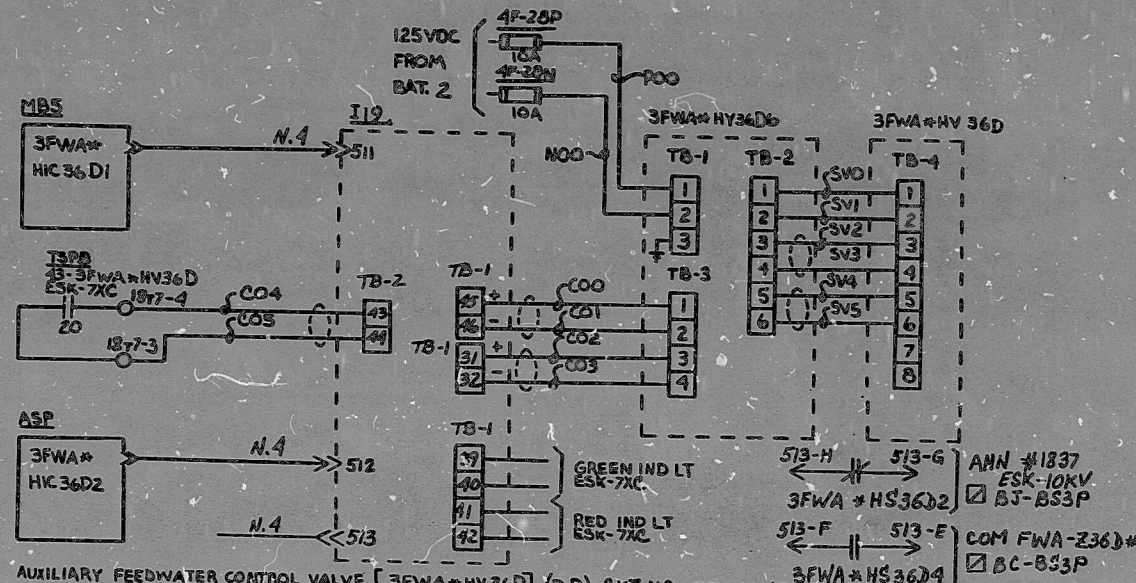

AUXILIARY FEEDWATER CONTROL VALVE [3FWA*HV36D] (D,P) CKT NO. 3FWAC12

- NOTES:
1. REFER TO LSK-6-2.1C-F, ISSUE 6
 2. REFER TO TARGET ROCK DWG, S+W FILE NO. 2472-110-654-418, FOR ADDITIONAL VALVE WIRING INFORMATION.
 3. FOR ADDITIONAL INSTRUMENT RACK WIRING INFORMATION REFER TO FOXBORO DWG, S+W FILE NO. 2472-710-392-502, 503, 504, 507, 512, 513.
 4. REFER TO "INSTRUMENT RACK EXTERNAL CABLE LIST", S+W SKETCH NO. 12179-I-212, FOR ADDITIONAL CABLE INFORMATION.

NUCLEAR SAFETY RELATED
QA CAT I,II,III

REV	DATE	DESCRIPTION	BY	CHK	APP
1	12/1/79	ISSUED FOR CONSTRUCTION	W.A.	J.T.	W.A.

NORTH EAST NUCLEAR ENERGY COMPANY
 SUBSIDIARY OF
 NORTH EAST UTILITIES
 TITLE: MILLSTONE NUCLEAR POWER STATION - UNIT NO. 3
 ELEM. DIAG.
 AUX. FDWTR. CONT. VV's
 (3FWA*HV31C, 32C, & 36D)
 DATE: 12/1/79
 SCALE: 1/2"=1'-0"
 DRAWN: W.A.
 CHECKED: J.T.
 IN CHARGE: W.A.
 S & W DWG. NO. 12179-ESK-7AAR

TI
APERTURE
CARD

PDR RIDS

8504150054

