

34"

22"

17"

11"

8.5"


0.5"

11"

17"

22"

34"

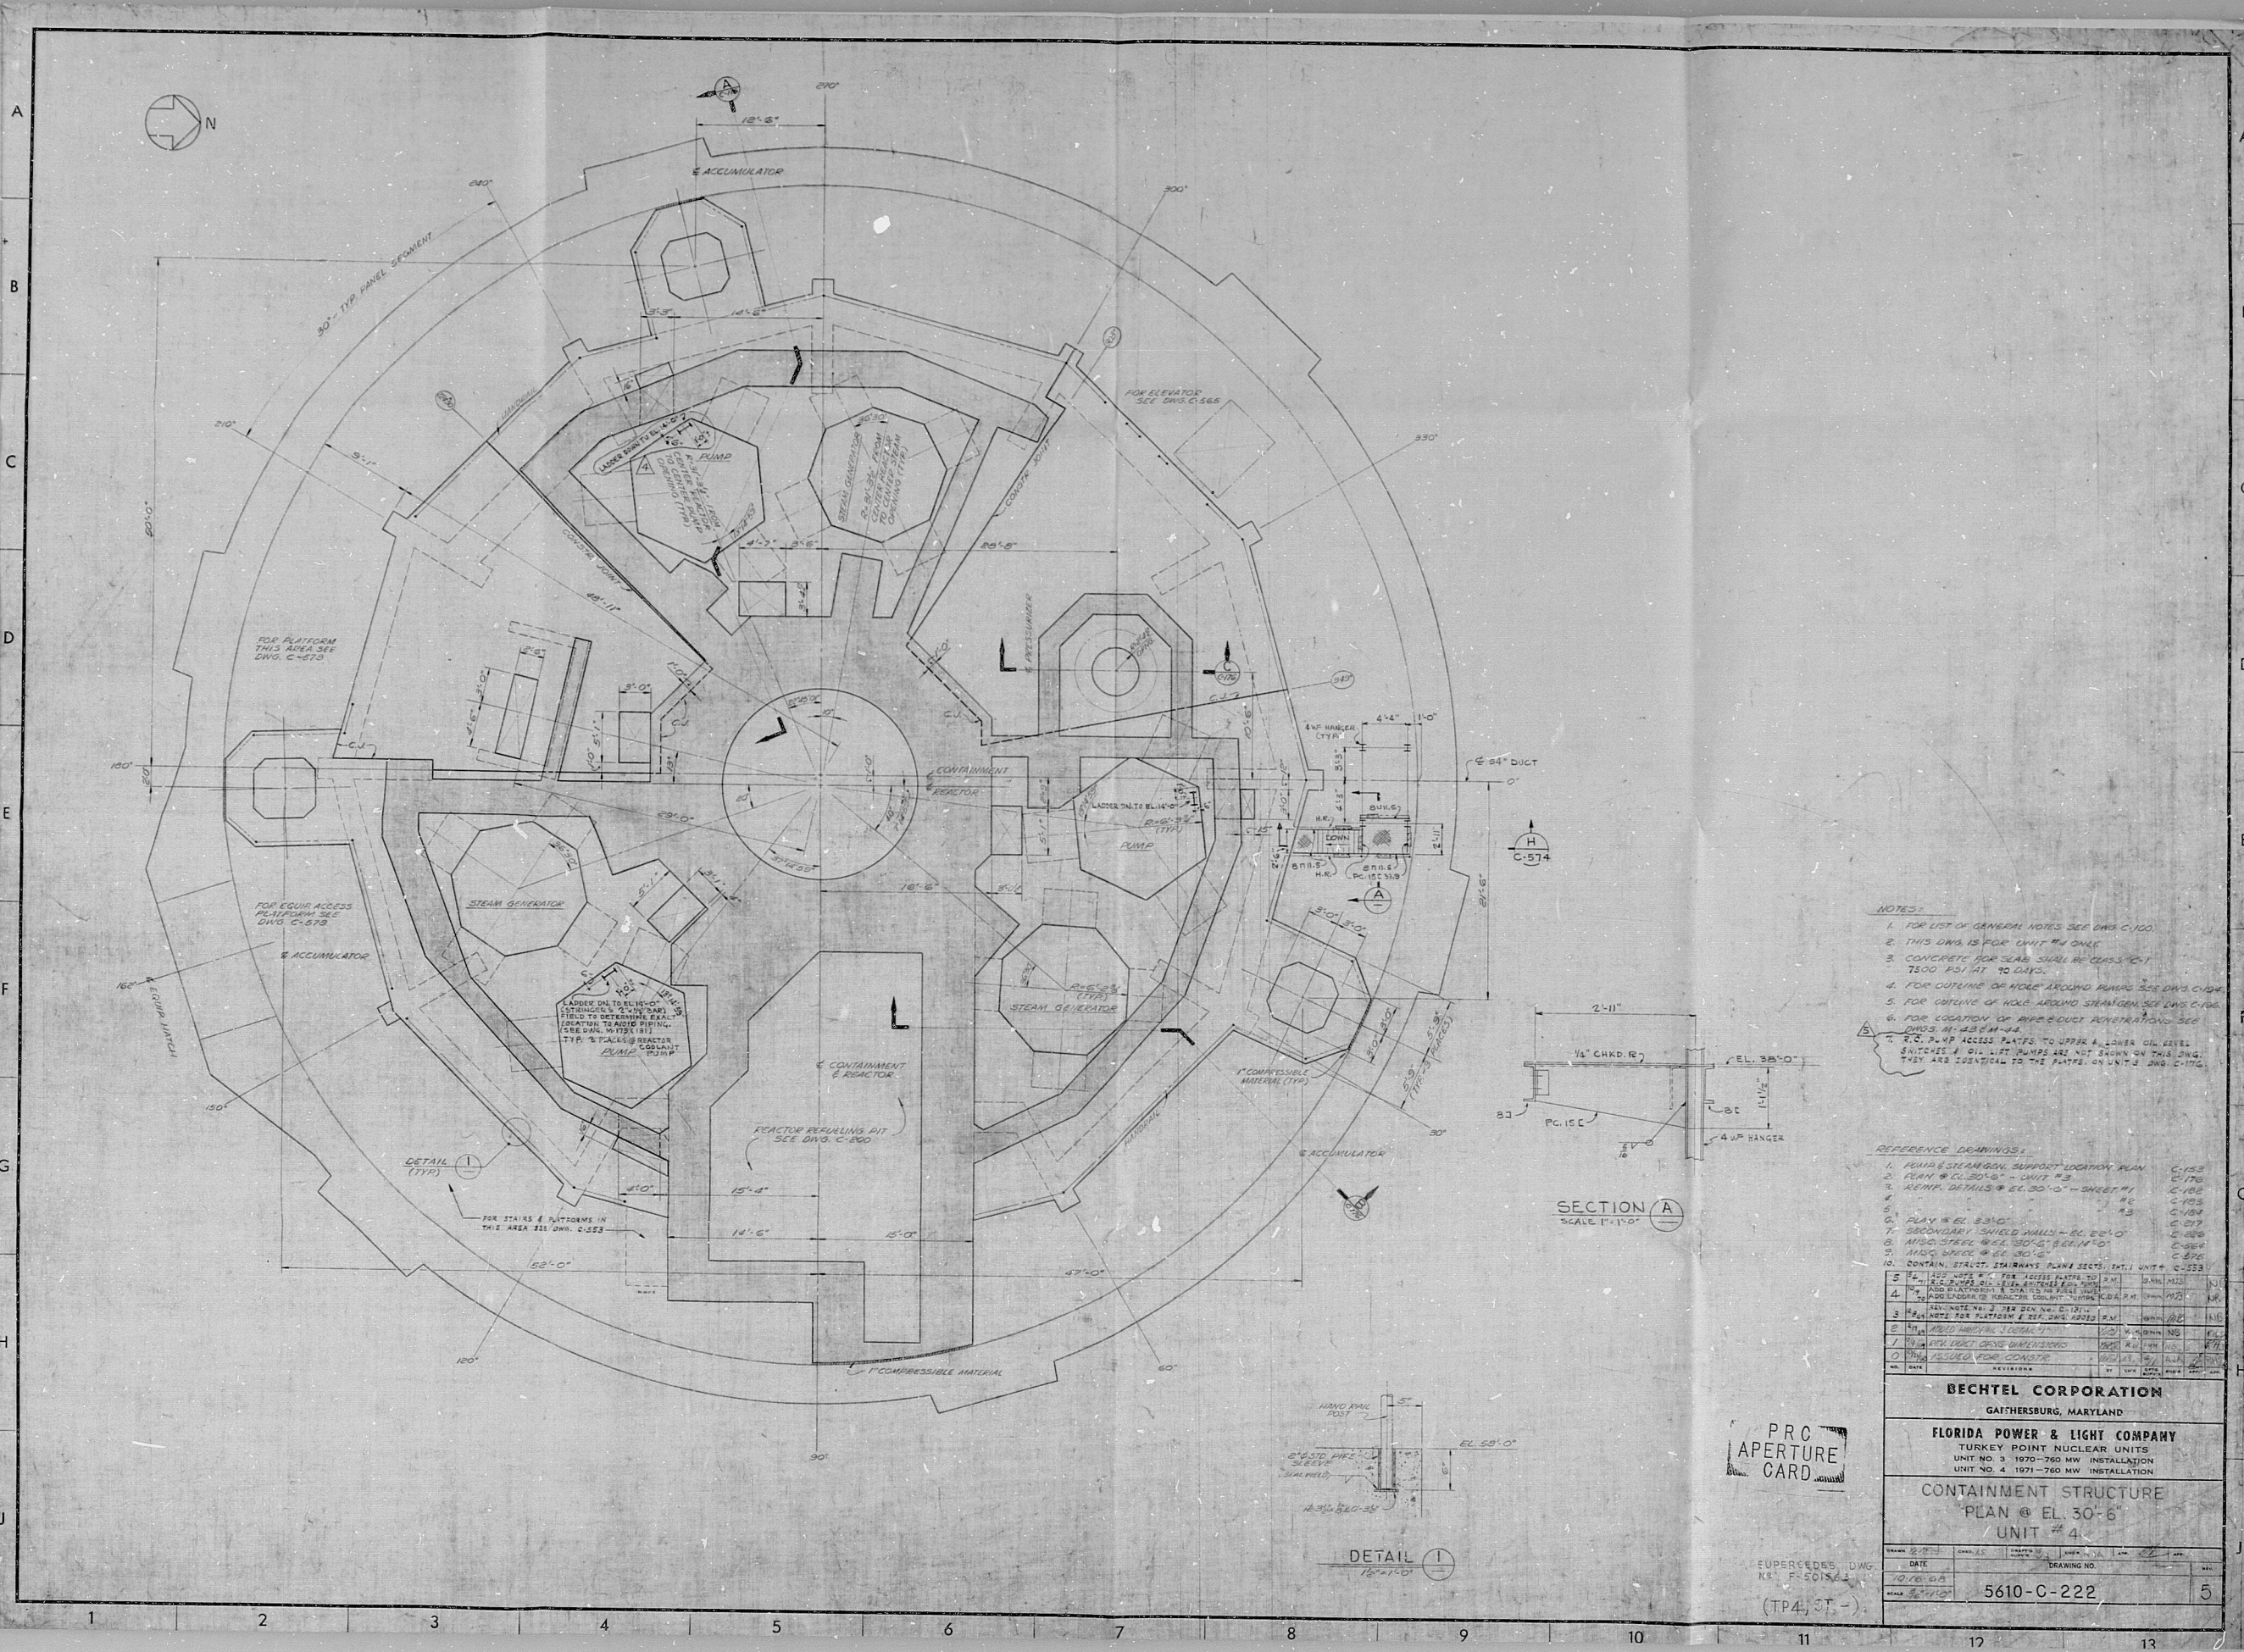

- NOTES:
1. FOR LIST OF GENERAL NOTES SEE DWG. C-100.
 2. THIS DWG. IS FOR UNIT #1 ONLY.
 3. CONCRETE FOR SLAB SHALL BE CLASS. C-1 7500 PSI AT 70 DAYS.
 4. FOR OUTLINE OF HOLES AROUND PUMPS SEE DWG. C-100.
 5. FOR OUTLINE OF HOLES AROUND STEAMGEN SEE DWG. C-100.
 6. FOR LOCATION OF PIPE & DUCT ANNOTATIONS SEE DWG. C-100.
 7. PUMP ACCESS PLATES TO UPPER & LOWER OIL LEVEL SWITCHES & OIL LIFT PUMPS ARE NOT SHOWN ON THIS DWG. THEY ARE IDENTICAL TO THE PLATES ON UNIT 2 DWG. C-100.

REFERENCE DRAWINGS:

1. PUMPS & STEAMGEN, SUPPORT LOCATION PLAN	C-100
2. PUMP & STEAMGEN, UNIT #1	C-100
3. PUMP, DETAILS @ EL. 30'-0" - SHEET #1	C-100
4. PUMP, DETAILS @ EL. 30'-0" - SHEET #2	C-100
5. PUMP, DETAILS @ EL. 30'-0" - SHEET #3	C-100
6. PUMP, DETAILS @ EL. 30'-0" - SHEET #4	C-100
7. SECONDARY SHIELD WALLS - EL. 20'-0"	C-100
8. HOLES STEAM GEN. 30'-0" (SEE UNIT #1)	C-100
9. HOLES STEAM GEN. 30'-0" (SEE UNIT #1)	C-100
10. CONTAIN. STRUCT. STAIRWAYS PLANS SECT. INT. UNIT #1	C-100

BECHTEL CORPORATION	
GAITHERSBURG, MARYLAND	
FLORIDA POWER & LIGHT COMPANY	
TURKEY POINT NUCLEAR UNITS	
UNIT NO. 3 1070-760 MW INSTALLATION	
UNIT NO. 4 1071-760 MW INSTALLATION	
CONTAINMENT STRUCTURE	
PLAN @ EL. 30'-6"	
UNIT #4	
DATE	DRAWING NO.
10/16/68	5610-C-222
BY	5

PRO
APERTURE
CARD

REPLACES DWG.
NO. F-50156
(TP4; ST. -)

22"

17"

11"

8.5"

0.5"

11"

17"

22"

34"

RIDS

6204270544

