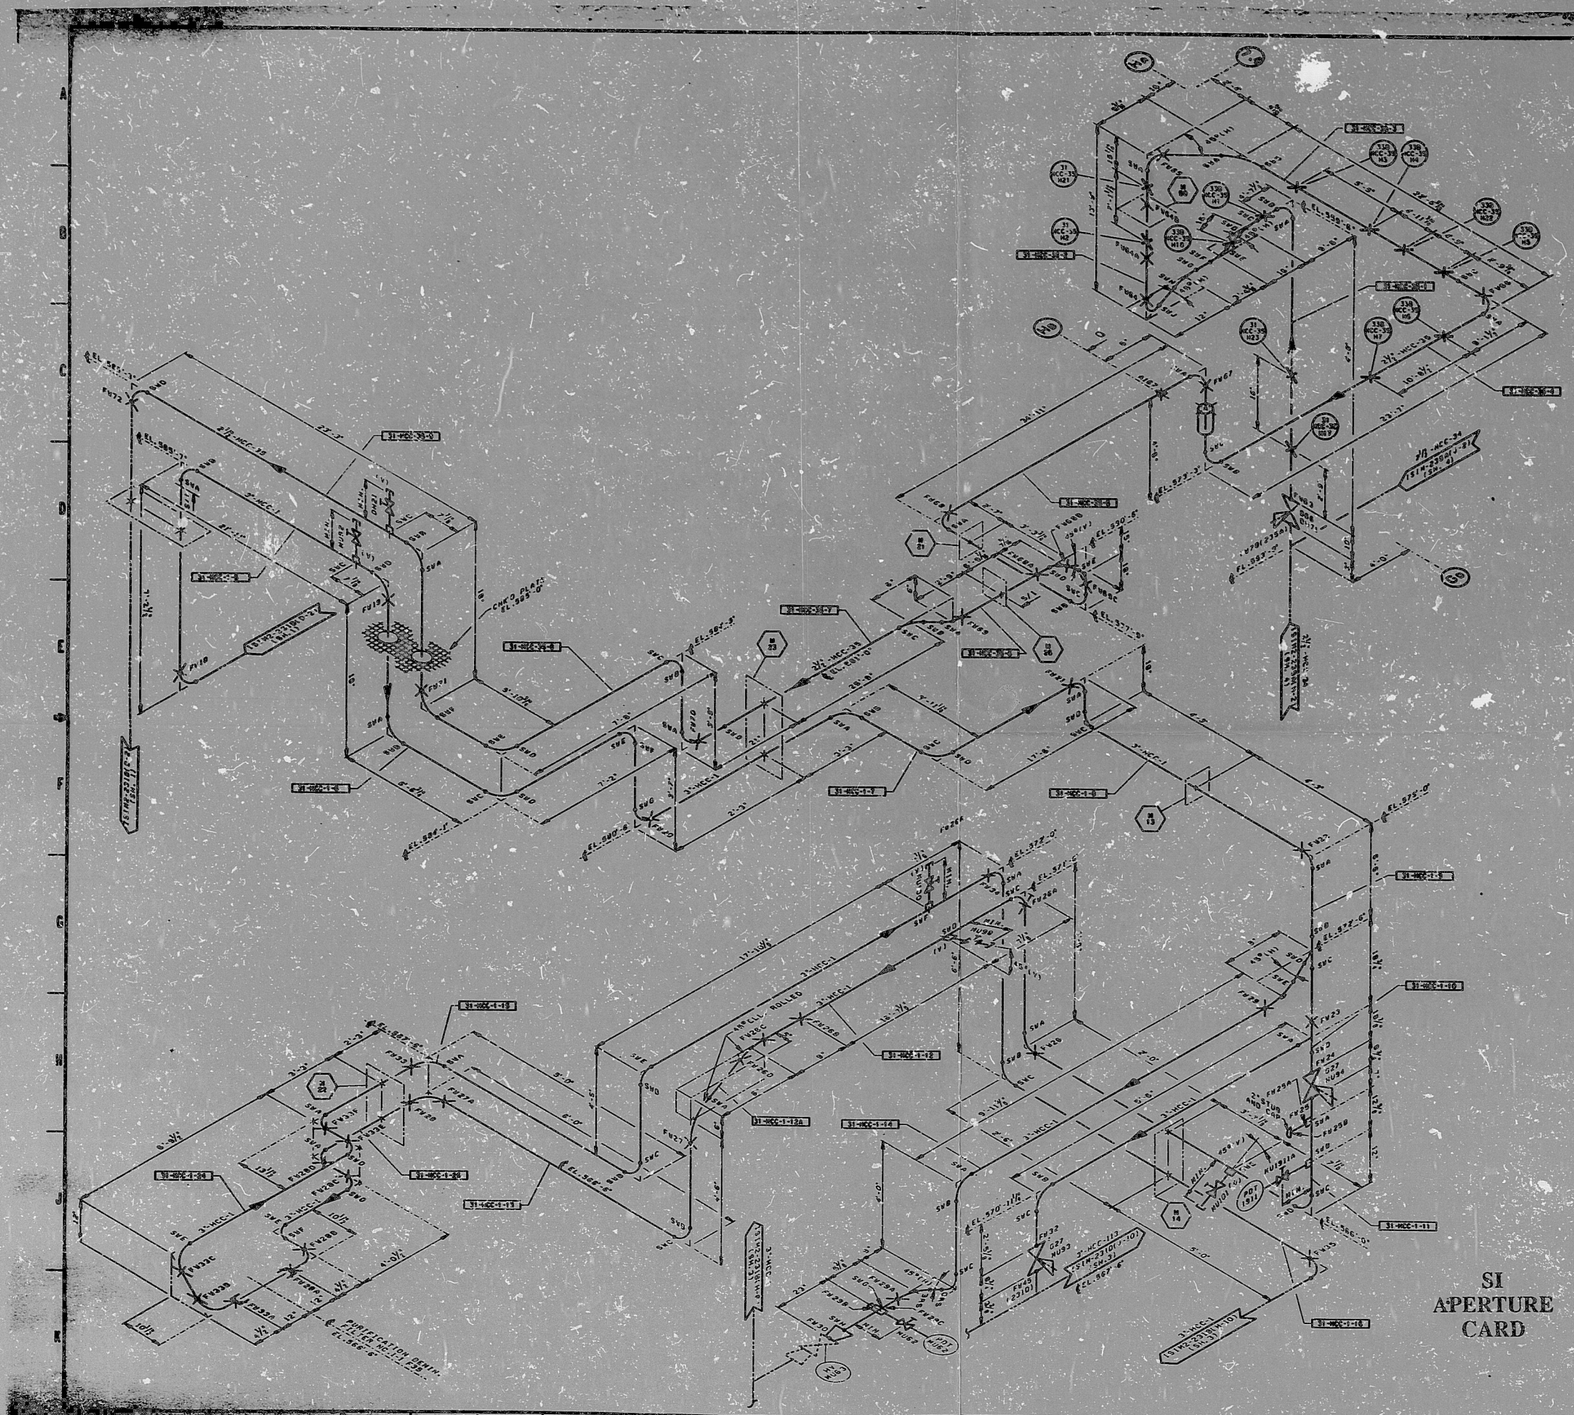

LEGEND

- ASME SECTION XI CLASS 1 PIPING
- ASME SECTION XI CLASS 2 PIPING
- ASME SECTION XI CLASS 3 PIPING
- NON-ISI INCLUDED CLASS AND NSC CLASS
- PRESSURE BOUNDARY EXTENSION
- REFERENCE & CONTINUITY
- SYMC BOLT
- A ANCHOR
- CS CONSTANT SPRING HANGER
- VS VARIABLE SPRING HANGER
- HS HYDRAULIC SNUBBER
- MS MECHANICAL SNUBBER
- R NON-WELDED SUPPORT ATTACHMENT
- W WELDED INTEGRAL SUPPORT ATTACHMENT
- R RIGID SUPPORT
- T SWAY STRUT
- SW SHOP WELD
- FW FIELD WELD
- LW LONGITUDINAL WELD
- ISI WELD NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INTERVAL INSPECTION SCHEDULE.

NOTES:

1. THE PIPING SHOWING ON THIS DRAWING ARE REVISION OF THE ISI DRAWINGS. THEY ARE CONSTRUCTION ISOMETRICS AND CONTINUITY PURPOSES ONLY. THE CONFIGURATION SHOWN MAY NOT REPRESENT THE ACTUAL AS-BUILT CONDITION.

REFERENCE DRAWINGS:

M-2310 MAKE-UP AND DEMINERALIZER SYSTEM AUXILIARY BUILDING, SHEET 1

INFORMATION ONLY

SI APERTURE CARD

NO.	DATE	REVISIONS	BY	APP'D	DRAWING NO.	REV. NO.
0		ISSUED FOR SECOND 10 YEAR ISI PERIOD				

DRAWN B.T.S. | DESIGNED | CHKD CS | DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1 0
THE TOLEDO EDISON COMPANY

INSERVICE INSPECTION ISOMETRIC
MAKE-UP AND PURIFICATION SYSTEM
AUXILIARY BUILDING - SHEET 2

ISIM2-231B 0
(SHEET 2)

I CERTIFY THAT THE IMAGE CONTAINED ON THIS FRAME IS MADE IN THE NORMAL AND REGULAR COURSE OF BUSINESS, ON THE DATE STATED BELOW AND THAT IT IS AN ACCURATE REPRODUCTION OF THE RECORD(S) SUBMITTED TO THE RECORDS ADMINISTRATOR.

9103120480

PDR RIDS

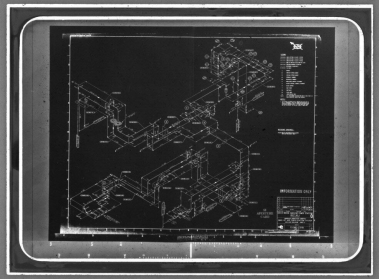

MMM 5824 — FILMSORT® Brand Aperture B Camera Cards and DUPLICARD® Brand Copy Cards — Product of 3M — St. Paul, Minn.