


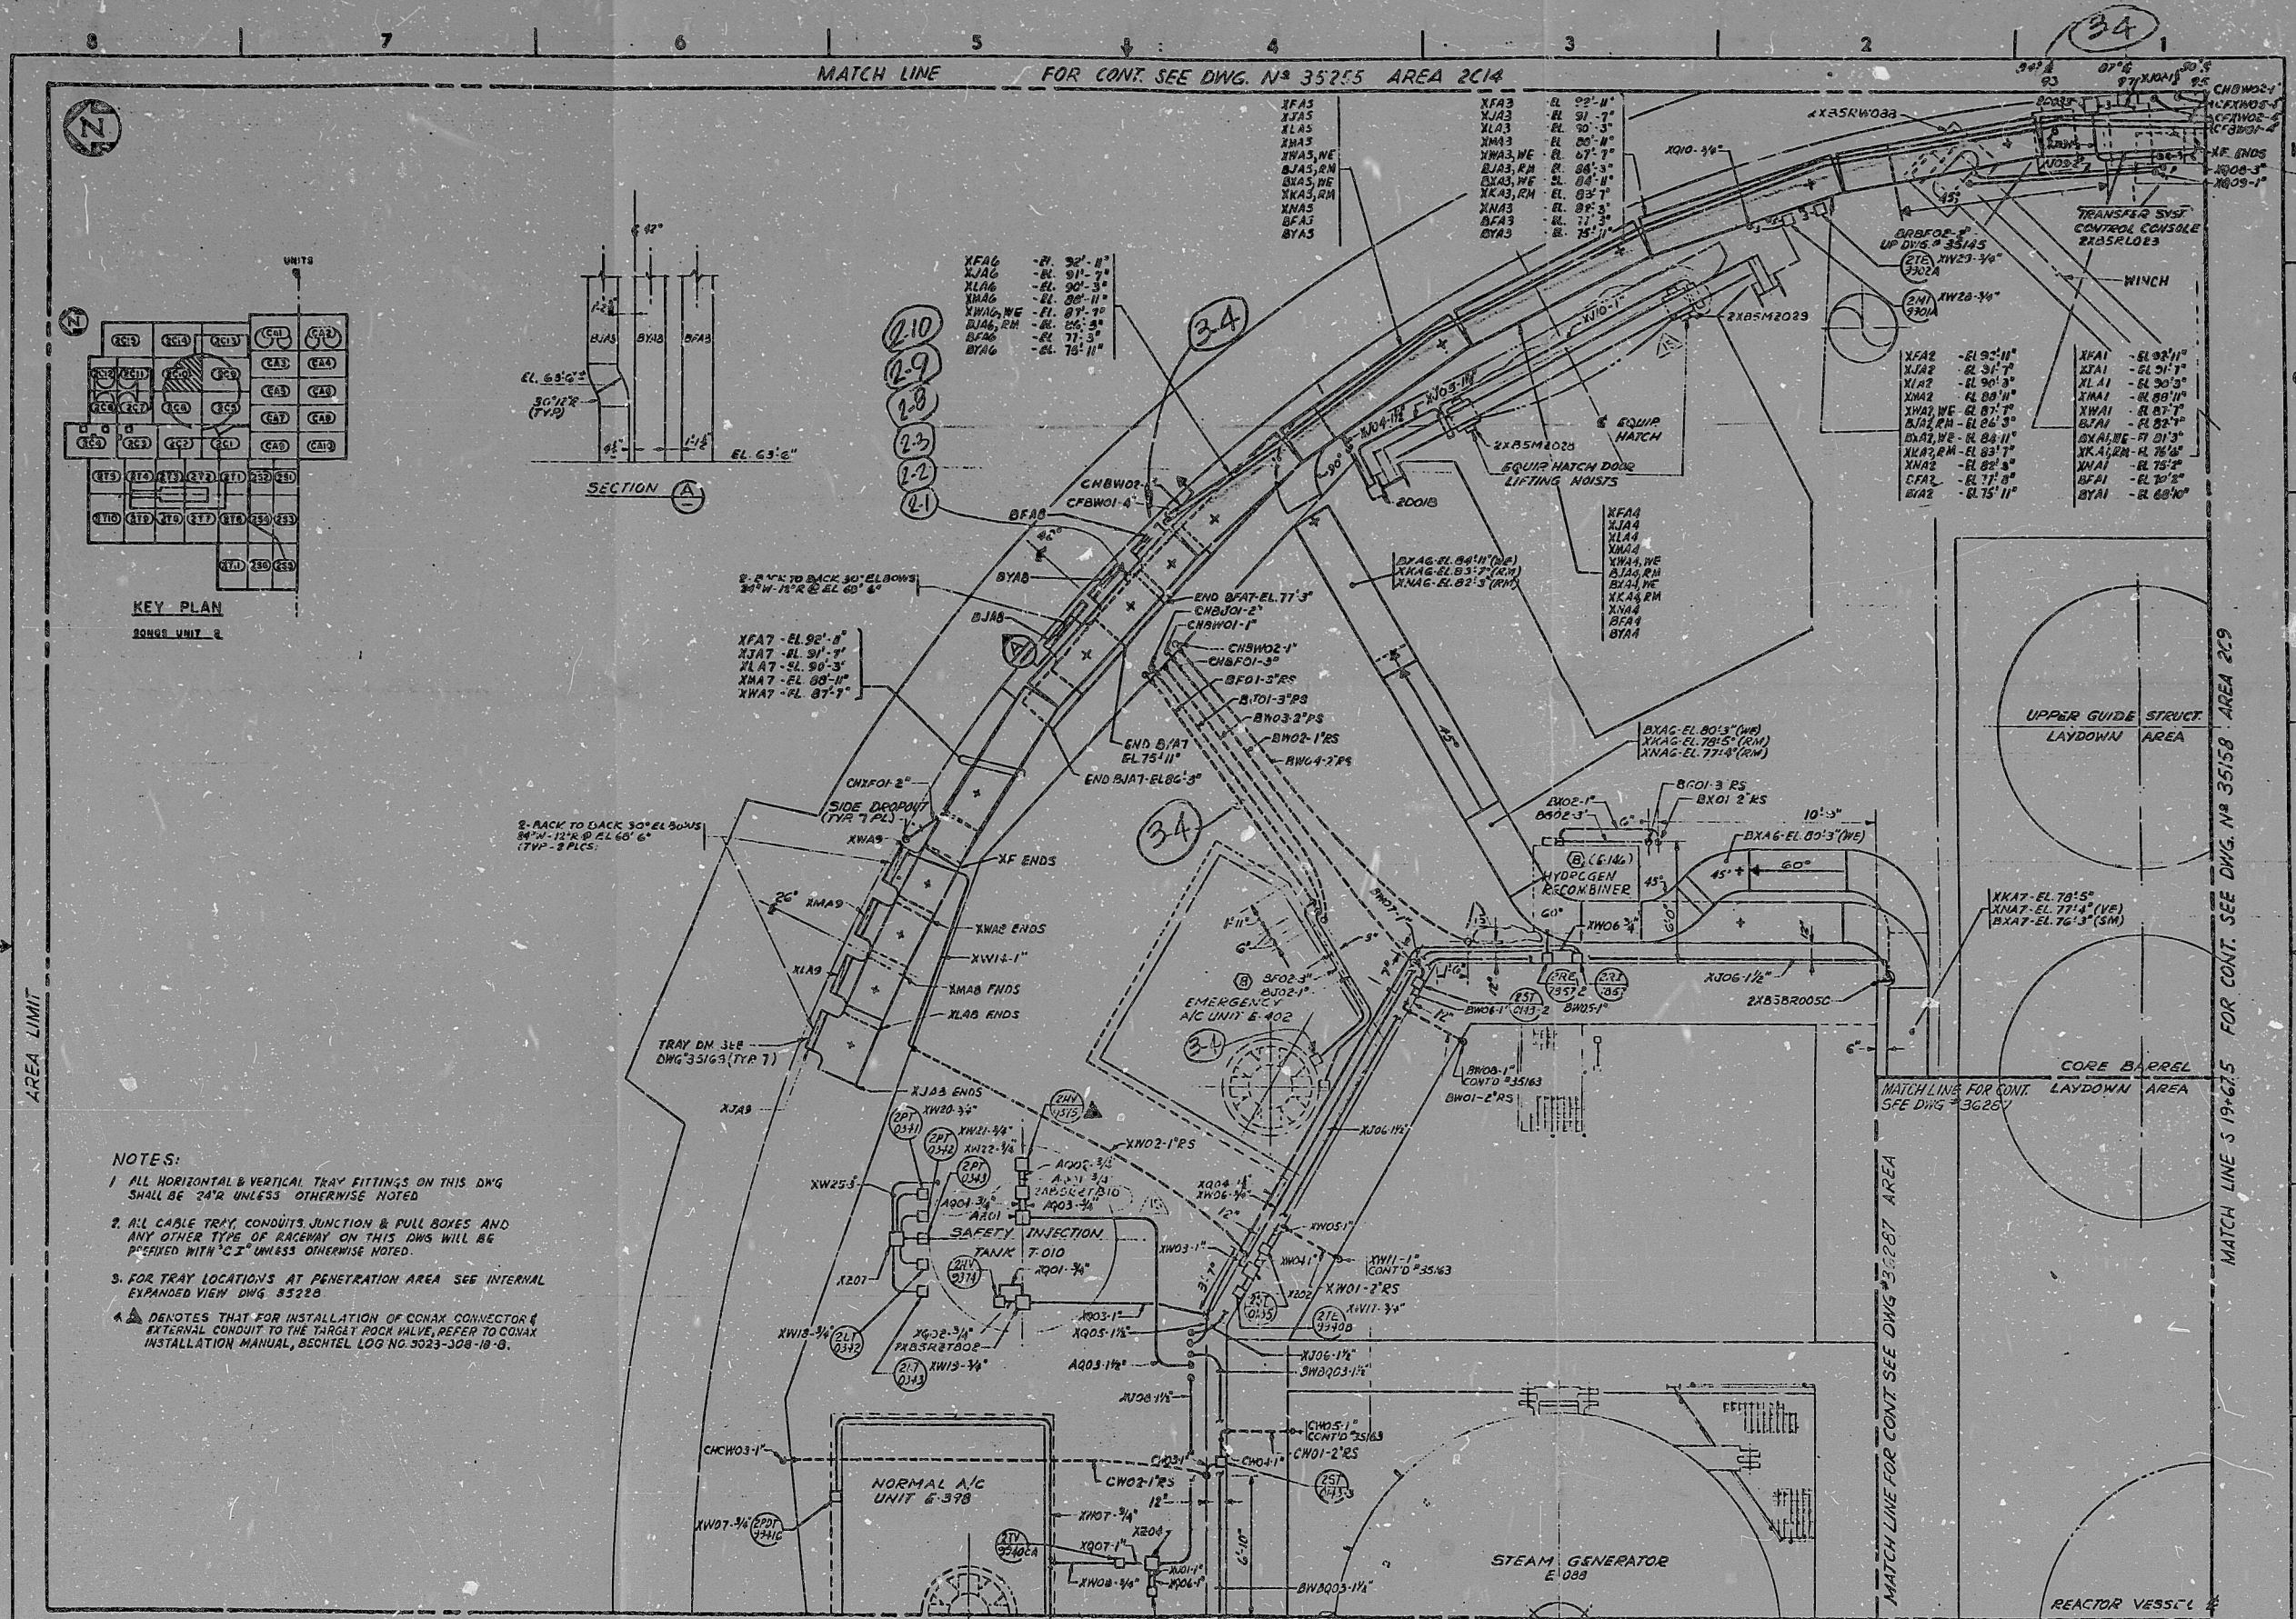

- NOTES:**
1. ALL HORIZONTAL & VERTICAL TRAY FITTINGS ON THIS DWG SHALL BE 24" UNLESS OTHERWISE NOTED.
 2. ALL CABLE TRAY CONDUITS JUNCTION & PULL BOXES AND ANY OTHER TYPE OF RACEWAY ON THIS DWG WILL BE IDENTIFIED WITH "C" UNLESS OTHERWISE NOTED.
 3. FOR TRAY LOCATIONS AT PENETRATION AREA SEE INTERNAL EXPANDED VIEW DWG 55228.
 4. DENOTES THAT FOR INSTALLATION OF CONAX CONNECTOR & EXTERNAL CONDUIT TO THE TARGET ROCK VALVE, REFER TO CONAX INSTALLATION MANUAL, BECHTEL LOG NO. 5023-308-10-B.

MATCH LINE W 3-875 FOR CONT. SEE DWG. NO. 35151 AREA 2C6
UNIT 2-CONTAINMENT SAFE SHUTDOWN CIRCUITS ROUTING

BECHTEL CORPORATION ENGINEERS & CONSTRUCTORS LOS ANGELES, CALIF.		UNIT 2 AREA 2C10 CONDUIT & TRAY PLAN EL. 83'-0" TO 93'-0"	
DWG. NO. 10019 -003	DATE 10/1/73	APPROVED [Signature]	UNIT 2 AREA 2C10 CONDUIT & TRAY PLAN EL. 83'-0" TO 93'-0"

8108120 564

DWG. No. 35164-15

PDIR PDR

8103120364

