


0
 20-0023
 00 29-00-01-2 # ON 5444380

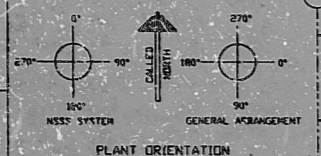


NOTES
 1. ALL FLOORS AND CEILING SHALL BE 3 HOUR RATED BARRIERS. PENETRATIONS SHALL BE SEALED TO MAINTAIN FIRE RESISTANCE RATING FOR ALL BARRIERS.

LEGEND OF SYMBOLS
 [Symbol] THREE HOUR FIRE RATED BARRIER (NUCLEAR SAFETY & PROPERTY PROTECTION)
 [Symbol] TWO HOUR FIRE RATED BARRIER (LIFE SAFETY & PROPERTY PROTECTION)
 [Symbol] ONE HOUR FIRE RATED BARRIER (LIFE SAFETY)
 [Symbol] ONE HOUR FIRE RATED BARRIER (NUCLEAR SAFETY)

SYSTEM 80+™
 DESIGN CERTIFICATION

DRAWING TITLE
 NUCLEAR ISLAND
 FIRE BARRIER LOCATION
 PLAN AT EL 70+0



91
 APERTURE
 CARD

FILE NAME: K20002.DWG INSERT NAME: PLANES.DWG

9202140003

PDR

