


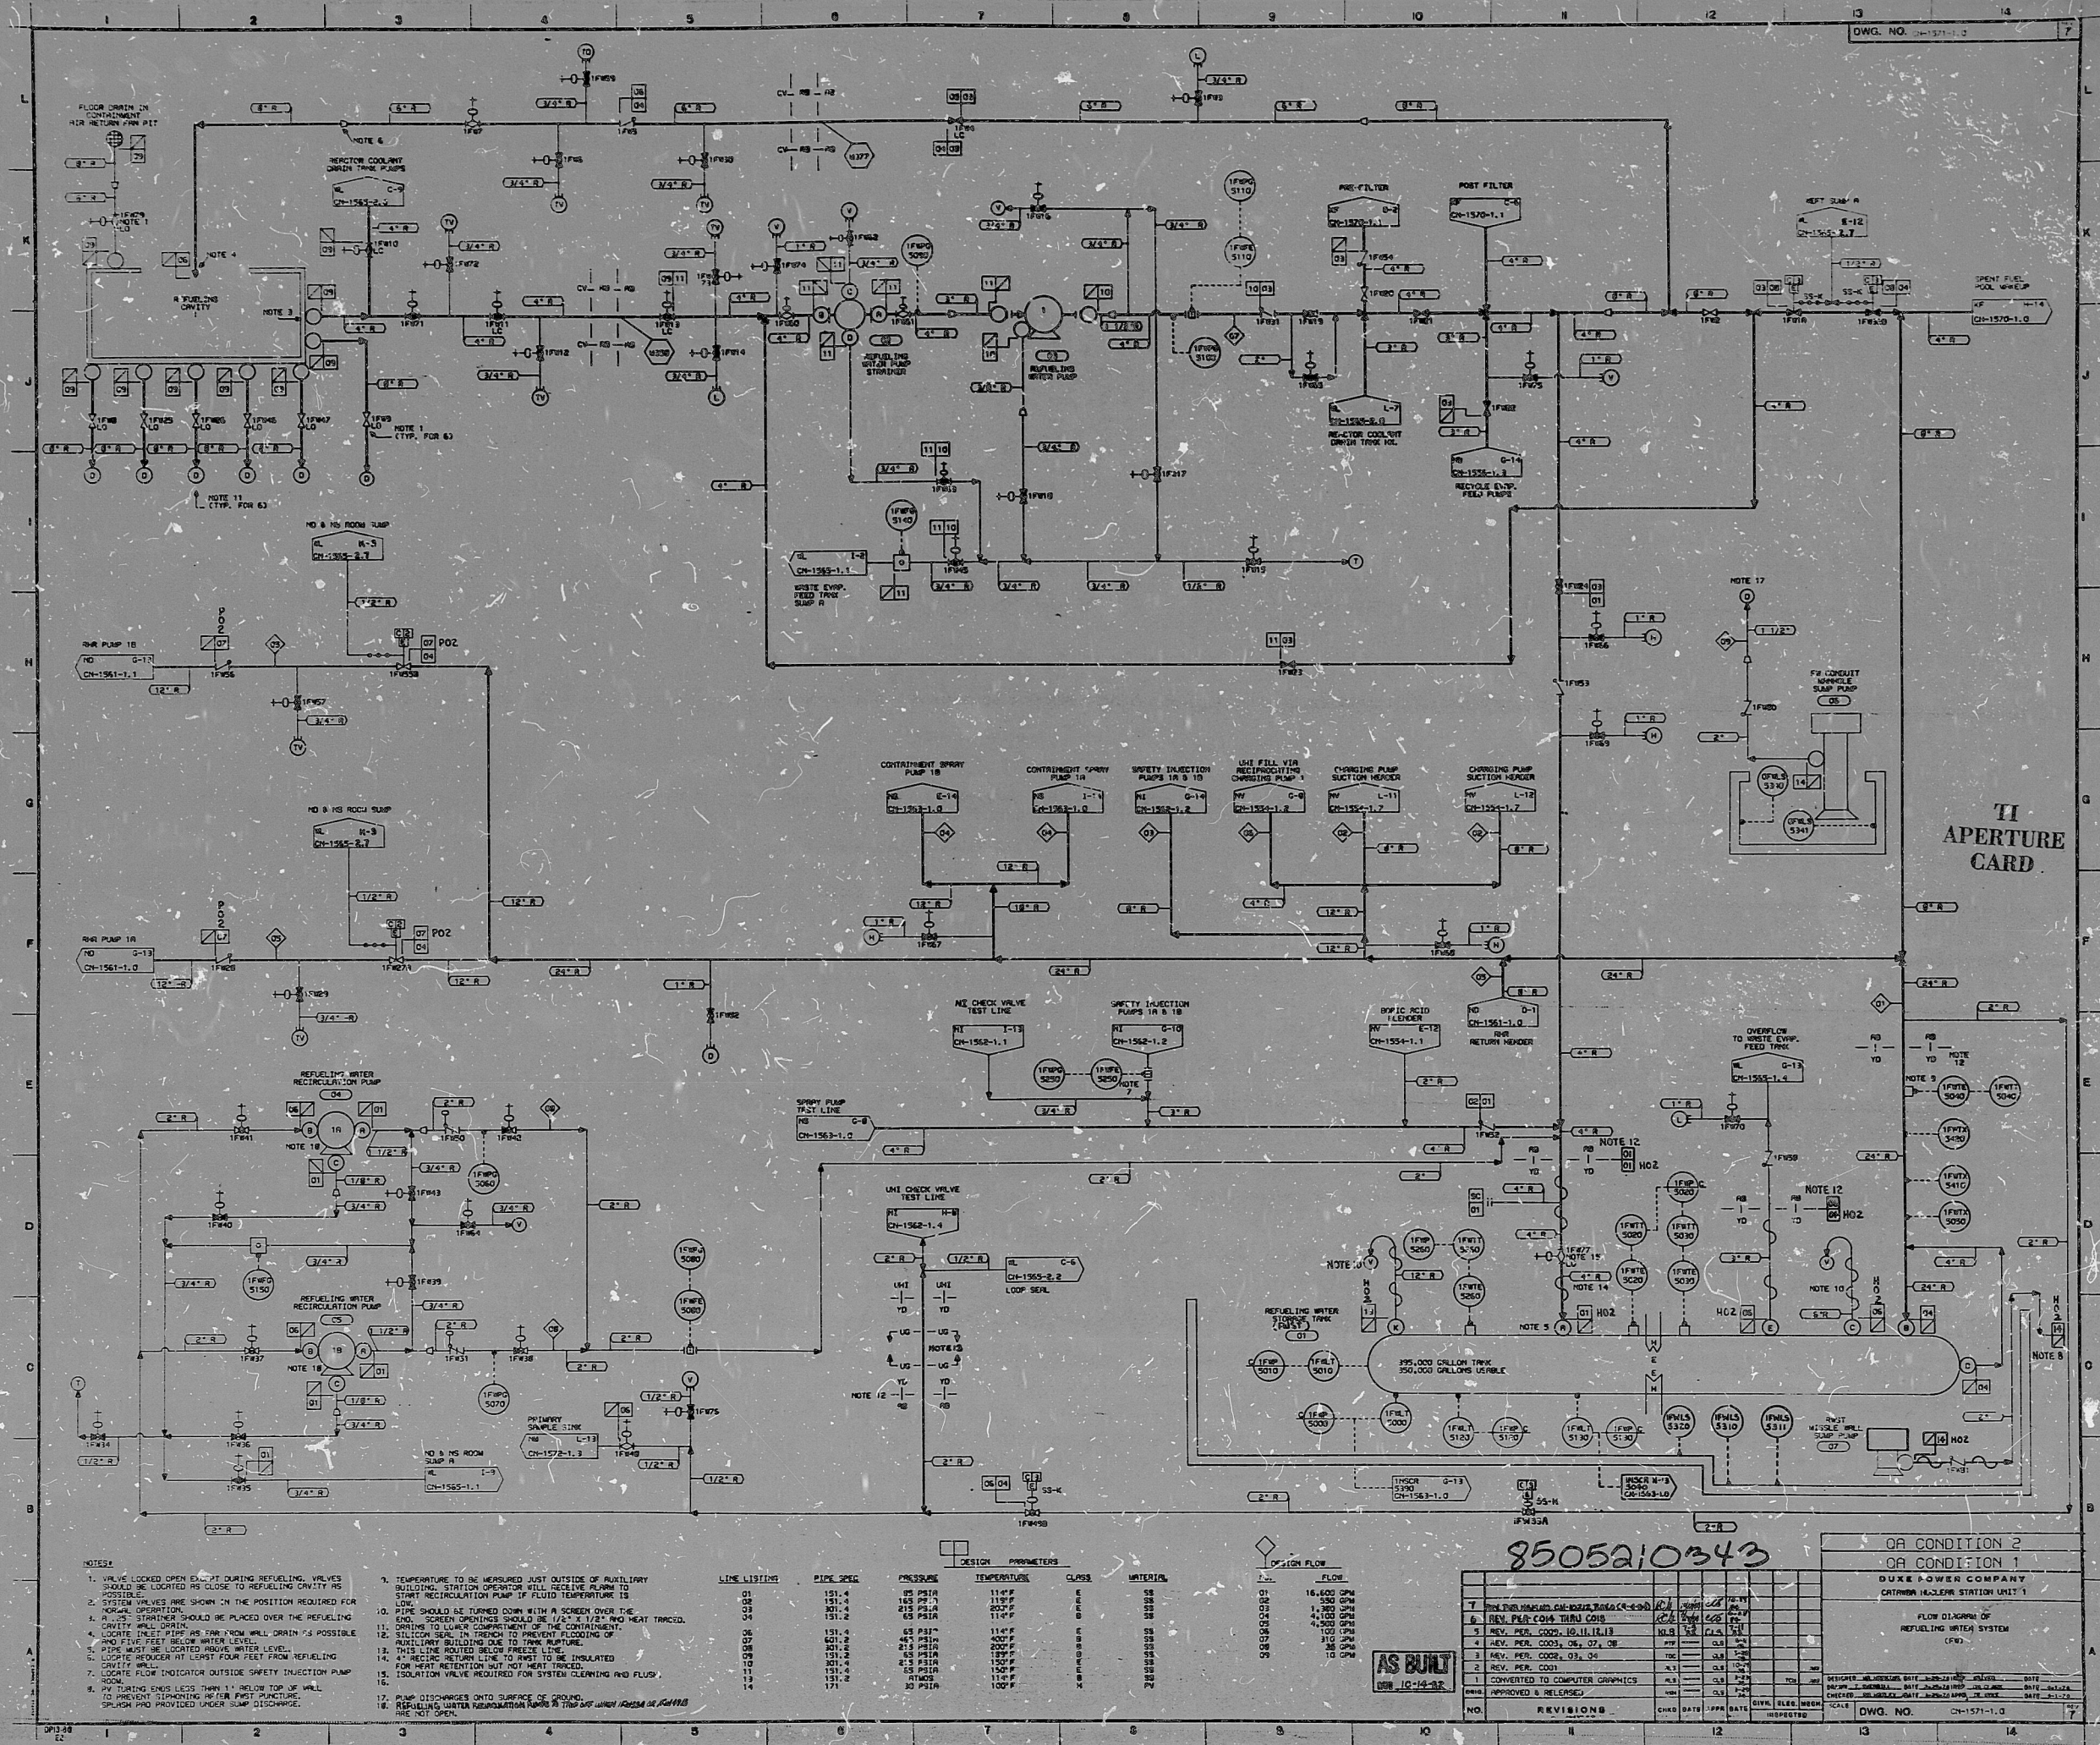

TI
APERTURE
CARD

8505210343

AS BUILT
REV. 10-14-82

QA CONDITION 2			
QA CONDITION 1			
DUKE POWER COMPANY			
CATHERINE HOLLER STATION UNIT 1			
FLOW DIAGRAM OF REFUELING WATER SYSTEM (FWS)			
A			
REVISION	DESCRIPTION	DATE	BY
1	AS BUILT	10-14-82	AS BUILT
2	AS BUILT	10-14-82	AS BUILT
3	AS BUILT	10-14-82	AS BUILT
4	AS BUILT	10-14-82	AS BUILT
5	AS BUILT	10-14-82	AS BUILT
6	AS BUILT	10-14-82	AS BUILT
7	AS BUILT	10-14-82	AS BUILT
8	AS BUILT	10-14-82	AS BUILT
9	AS BUILT	10-14-82	AS BUILT
10	AS BUILT	10-14-82	AS BUILT
11	AS BUILT	10-14-82	AS BUILT
12	AS BUILT	10-14-82	AS BUILT
13	AS BUILT	10-14-82	AS BUILT
14	AS BUILT	10-14-82	AS BUILT

PDR RIDS

8505210343

