



NOTES:

1. TERMINALS WITHOUT LOCATION MARKS ARE LOCATED IN ANNUNCIATOR CAB. (IH13-P630)
2. Δ DENOTES SEQUENCE OF EVENT RECORDER TERMINALS.
3. ALPHABETICAL WIRE MARKS ARE PREFIXED BY: SYSTEM NO., SHEET NO., AND LINE NO. (EXAMPLE R610101A).
4. DEVICE DESIGNATIONS ARE PREFIXED BY: SYSTEM NO. (EXAMPLE IE21-K5).
5. FOR GRAPHIC STANDARDS, REFER TO DRAWING B-208-001.
6. ALL ANNUNCIATOR INPUTS WITHOUT ISOLATORS ARE NON-SAFETY.
7. POWER TO ISOLATORS IS SHOWN ON DWG. B-208-222 SHTS. 925-931

LEGEND:

- EXTERNAL WIRE MARK (SEE NOTE 3)
- INTERNAL WIRE MARK
- IH13-P742 PGCC TERM. CAB.
- IH13-P744 PGCC TERM. CAB.
- IH13-P864 ANALOG LOOP "B" INSTRUMENTATION PNL
- IH13-P871 DIVISION 2 AUXILIARY RELAY PANEL
- CLASS IE-DIVISION 2
- IH51-P054B STDBY GEN#2 CONT. PUL
- IH51-P055B STDBY DIESEL#2 CONT. PUL
- ◇ SWGR. TERM.

CONTINUED FROM DWG. B-208-222 SHT. 225

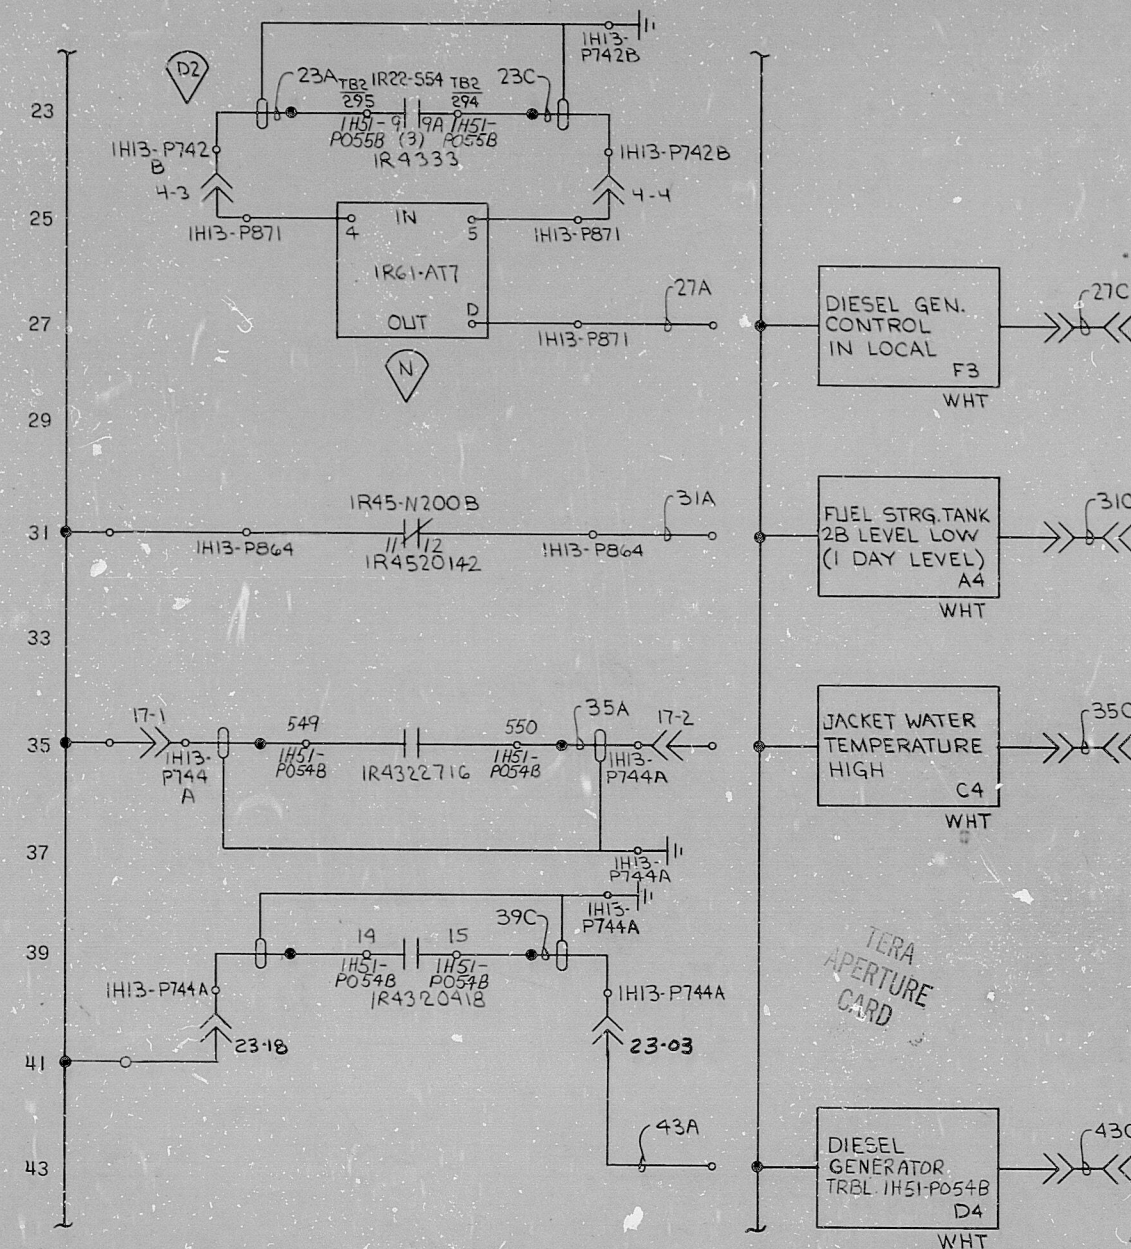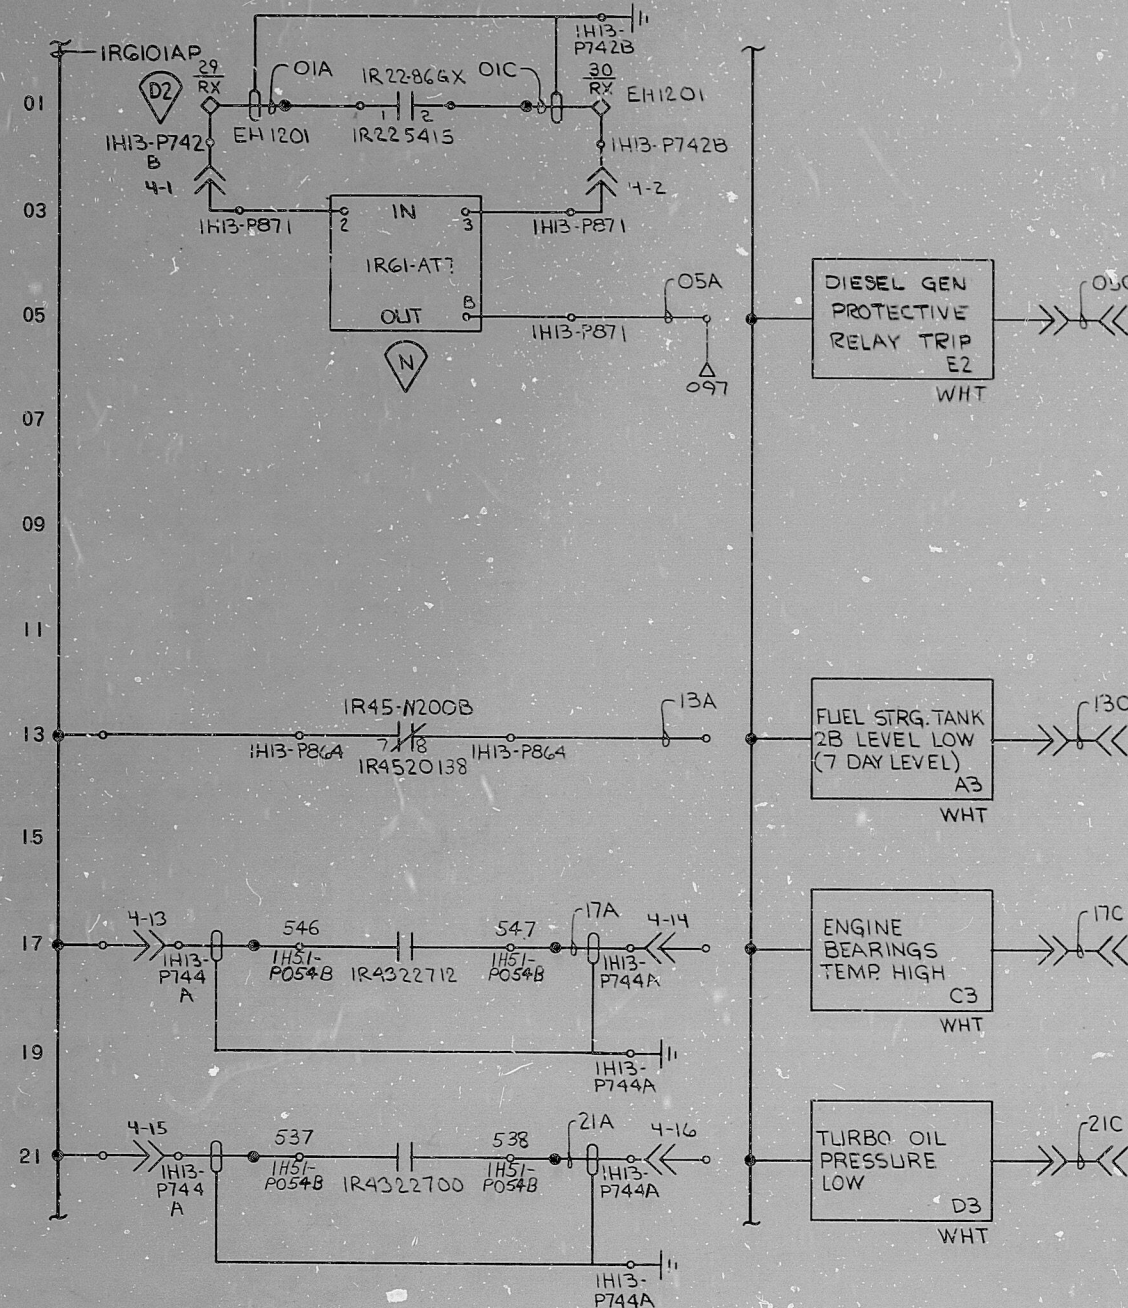

CONTINUED ON TO DWG. B-208-222 SHT. 227



NUCLEAR SAFETY RELATED

ADDED TERM. CAB. INFO. LINE 39
ADD "T" MOD INFO LW. 41
ECN-245-033-01-63

F SFH 1/1/80 G SFH 1/1/80

ADDED TERMINATION INFORMATION
ADDED SWGR. TERMS. & REFERENCE INFO TO LINES 1, 17, 21, 23, 35, & 39

E SFH 1/1/79 D 1/1/79 C 1/1/79

ADDED TERMINATION CABINET INFORMATION

REV MADE CHKD APPROVALS DATE

REVISED PER ECN 245-033-01-207 CHANGED NOMENCLATURE FOR ALARM POINT E2 SHOWN ON LINE 5

REV MADE CHKD APPROVALS DATE

REV PER ECN 245-033-01-207 REVISED LINES 13, 31, 39, 41 & 43

NO ECN REQUIRED REVISED LINES 17, 21, 23 & 35

REV MADE CHKD APPROVALS DATE

CONSTRUCTION PRELIMINARY

DATE RELEASED FOR ENGR.

GILBERT ASSOCIATES, INC. ENGINEERS AND CONSULTANTS

READING PA 044549-000 HM BAT DEG 1/1/79

THE CLEVELAND ELECTRIC ILLUMINATING CO.

PERRY NUCLEAR POWER PLANT UNIT 1

ELECTRICAL-ELEMENTARY DIAGRAM

CONTROL ROOM ANNUNCIATOR

DIESEL GEN BB (IH13-P877)

SECTION 2A

04 4549 B-208-222 R61 226 G

DRAWING NUMBER SYSTEM SH. NO. REV

ELEM DIAG ANNUN WIRING R61-226

RSDS-PD12

8103240654

