



CONTINUED FROM DWG 208-222 SH 280

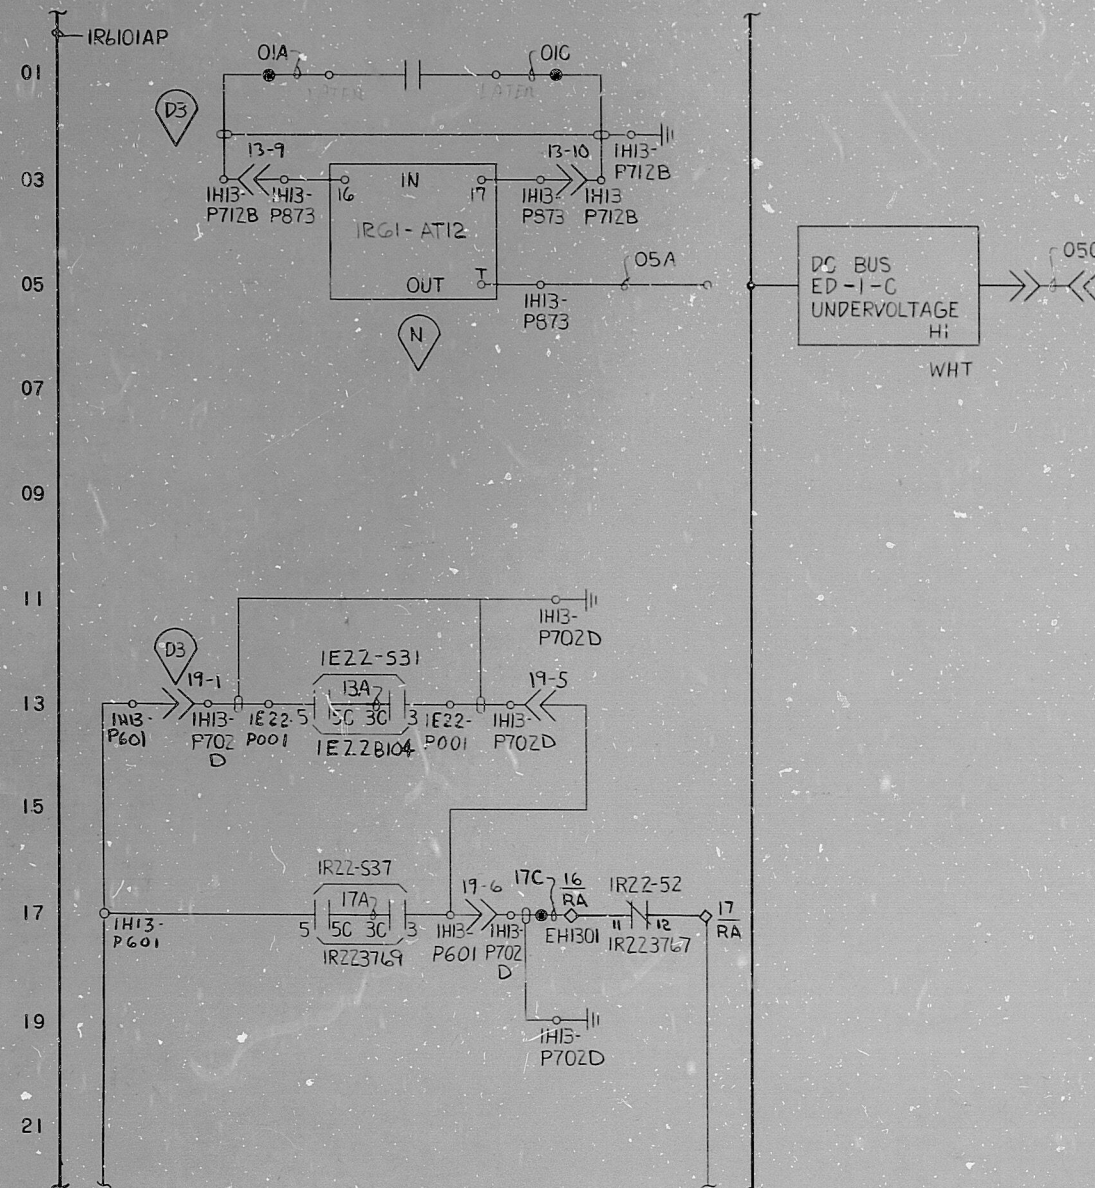

- NOTES:
1. TERMINALS WITHOUT LOCATION MARKS ARE LOCATED IN ANNUNCIATOR CAB. (IH13-P630)
  2. Δ DEMOTES SEQUENCE OF EVENT RECORDER TERMINALS.
  3. ALPHABETICAL WIRE MARKS ARE PREFIXED BY: SYSTEM NO., SHEET NO., AND LINE NO. (EXAMPLE R61C101A).
  4. DEVICE DESIGNATIONS ARE PREFIXED BY: SYSTEM NO. (EXAMPLE IE21-K5).
  5. FOR GRAPHIC STANDARDS, REFER TO DRAWING B-208-001.

- LEGEND:
- EXTERNAL WIRE MARK (SEE NOTE 3)
  - INTERNAL WIRE MARK
  - ◇ SWITCHGEAR
  - IH13-P702-P600 TERM. CAB
  - IH13-P712-P600 TERM. CAB
  - IH13-P873-DIV 3 AUX RELAY PANEL
  - IH13-P877-DIESEL GENERATOR BB

CLASS IE DW 3

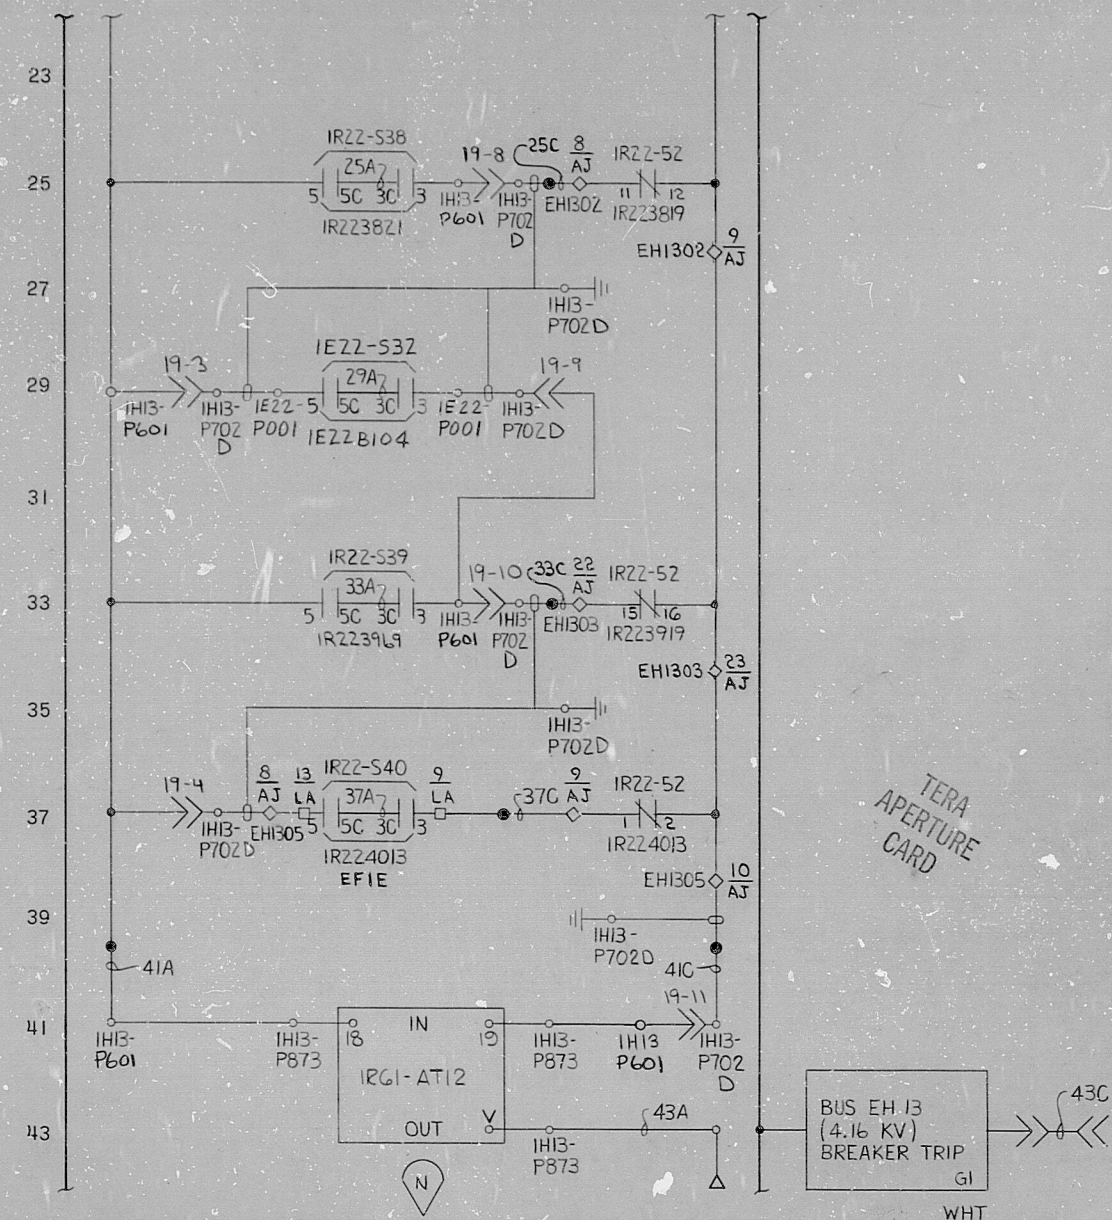

CONTINUED ON TO DWG B-208-222 SH 282

NUCLEAR SAFETY RELATED

THE CLEVELAND ELECTRIC ILLUMINATING CO.

PERRY NUCLEAR POWER PLANT UNIT 1

ELECTRICAL-ELEMENTARY DIAGRAM

CONTROL ROOM ANNUNCIATOR

ECCS BENCHBOARD (IH13-P601)

SECTION 16A

ADDED SWITCHGEAR  
TERMINATION INFO.

F SFH 2 1/2 1/31/79

ADDED TERM. INFO. TO  
LINES 11, 13, 17, 19, 25, 27, 29,  
33, 35, 37, 39, AND 41

ADDED TERMINATION  
CABINET INFORMATION

NO ECN REQ. - CHANGE P677  
TO P601 LINES 13, 25, 29,  
33, 41

REV PER EDN 245-033-01-85  
LINE 13 - LINE 17 & LINE 29

REV PER ECN 245-033-01-85  
DELETED OKT. ON LINE 21  
REV TERM NO. LINES 13, 17 & 29  
REV CONTACT NO. LINES 13 & 29

GILBERT ASSOCIATES, INC.  
ENGINEERS AND CONSULTANTS

044549-000

KJW BAT DEG

04 4549 B-208-222 R61 281 F

DRAWING NUMBER SYSTEM SH. NO. REV

REV MADE CHKD APPROVALS DATE

REV MADE CHKD APPROVALS DATE

REV MADE CHKD APPROVALS DATE

REV MADE CHKD APPROVALS DATE

REV MADE CHKD APPROVALS DATE

REV MADE CHKD APPROVALS DATE

REV MADE CHKD APPROVALS DATE

REV MADE CHKD APPROVALS DATE

REV MADE CHKD APPROVALS DATE

REV MADE CHKD APPROVALS DATE

ELEM DIAG ANNUN WIRING R61-281

RIDS-PDR

8103240715

