REF: GE DWG. 828E445CA SH 3A REV 3

NOTES:
1. TERMINALS WITHOUT LOCATION MARKS ARE LOCATED IN ANNUNCIATOR CAB.(1H13-P630)
2. Δ DENOTES SEQUENCE OF EVENT RECORDER TERMINALS.
3. ALPHABETICAL WIRE MARKS ARE PREFIXED BY: SYSTEM NO., SHEET NO., AND LINE NO. (EXAMPLE RG10101A).
4. DEVICE DESIGNATIONS ARE PREFIXED BY: SYSTEM NO. (EXAMPLE 1E21-K5).
5. FOR GRAPHIC STANDARDS, REFER TO DRAWING B-208-001.
6. POWER TO ISOLATORS IS SHOWN ON DWG B-208-040 SH A 13

LEGEND:
- EXTERNAL WIRE MARK (SEE NOTE 3)
- INTERNAL WIRE MARK.

1H13-P691 - DIV 1 RPS INSTR & AUX RELAY PNL
1H13-P692 - DIV 2 RPS INSTR & AUX RELAY PNL
1H13-P693 - DIV 3 RPS INSTR & AUX RELAY PNL
1H13-P694 - DIV 4 RPS INSTR & AUX RELAY PNL
1H13-P601 - ECCS BENCHBOARD

(A1) ASSOCIATED CIRCUIT DIV. 1
(A2) ASSOCIATED CIRCUIT DIV. 2
(N) NON-DIVISONAL
(A3) ASSOCIATED CIRCUIT DIV. 3
(A4) ASSOCIATED CIRCUIT DIV. 4

CONTINUED FROM DWG B-208-222 SH. 359

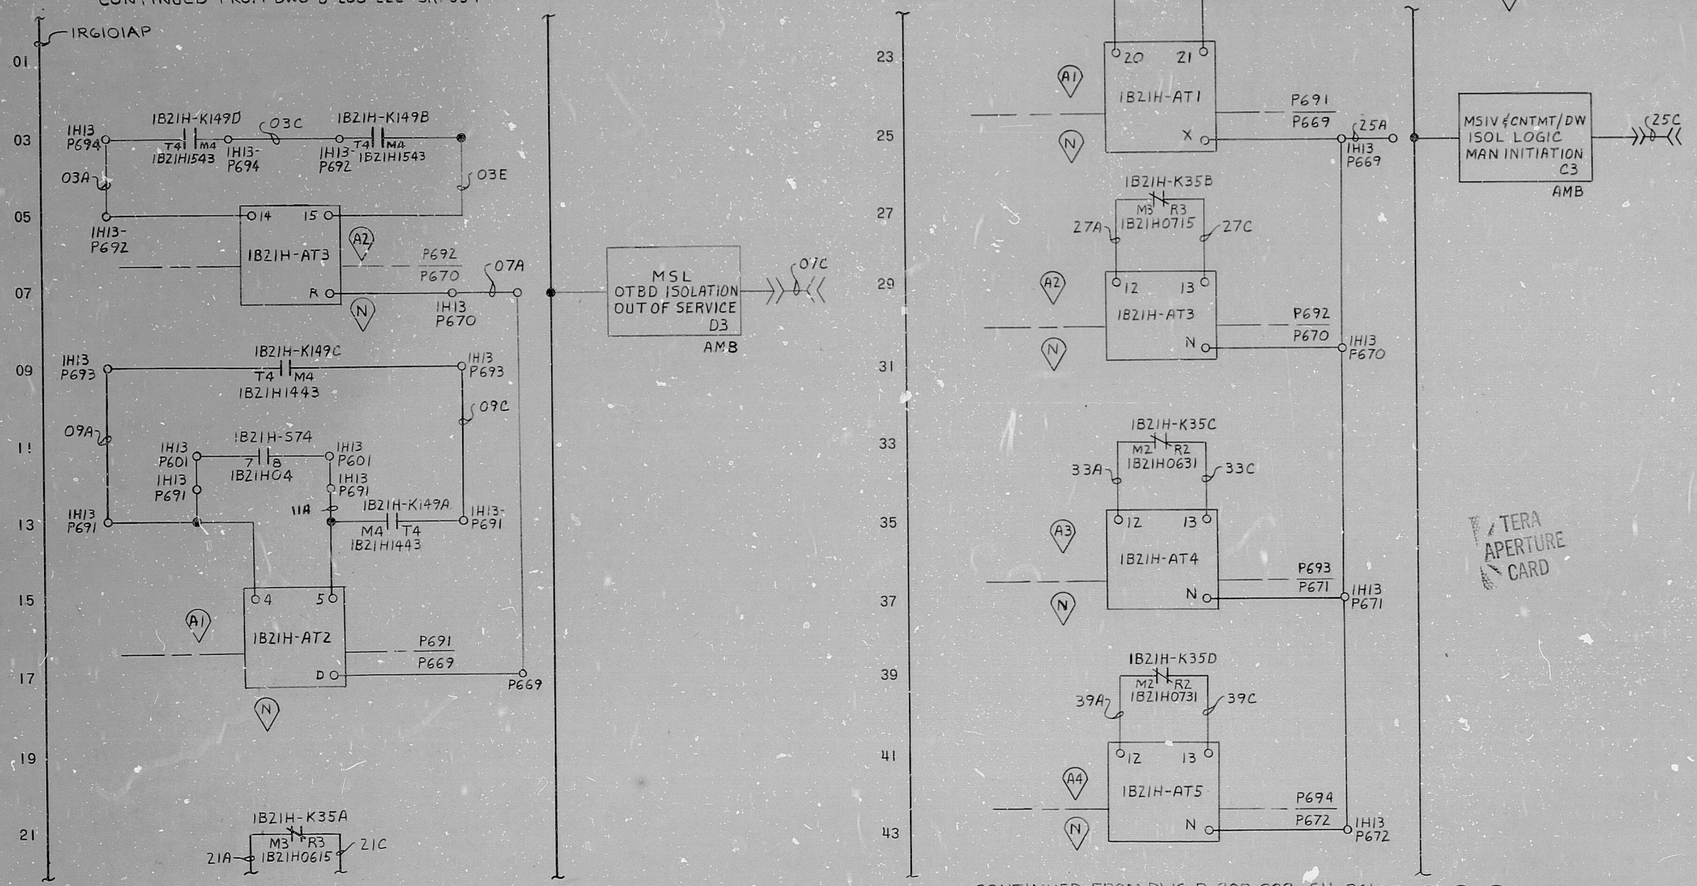

CONTINUED FROM DWG B-208-222 SH. 361

(A1) (A2) (A3) (A4) NUCLEAR SAFETY RELATED

TERA APERTURE CARD

8/24/77	CONSTRUCTION		
	PRELIMINARY		
DATE	RELEASED FOR	ENGR.	

REV.	MADE	CHKD	APPROVALS	DATE	REV.	MADE	CHKD	APPROVALS	DATE	REV.	MADE	CHKD	APPROVALS	DATE	REV.	MADE	CHKD	APPROVALS	DATE
															B	BZC	GAR	CJC	11/14/77
															A	BZC	BAT	GJC	9/23/77

REV. PER ECN 245-033-01-105 REDRAWN

REV. PER ECN 245-033-01-105 REDRAWN

READING PA.	GILBERT ASSOCIATES, INC. ENGINEERS AND CONSULTANTS					
044549-000	DJC	BAT	DEG			8/24/77
WORK ORDER	MADE	CHKD.	CHIEF APP.	ENG. APP.		DATE

THE CLEVELAND ELECTRIC ILLUMINATING CO.
PERRY NUCLEAR POWER PLANT UNIT 1
ELECTRICAL-ELEMENTARY DIAGRAM
CONTROL ROOM ANNUNCIATOR ECCS BENCHBOARD (1H13-P601) SECTION 19A

DRAWING NUMBER			SYSTEM	SH. NO.	REV.
04	4549	B-208-222	RG1	360	B

ELEM DIAG ANNUN WIRING RG1-360

RIDS-PDR

8103240806

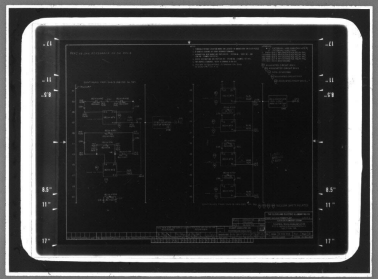

MMM 5824 — FILMSORT® Broad Aperture & Camera Cards and DUPLICARD® Broad Gray Cards — Product of 3M Company, St. Paul, Minn.